

## Numerical Prediction of Buoyant Air Flow in Livestock Buildings

Svidt, Kjeld

*Publication date:*  
1993

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Svidt, K. (1993). *Numerical Prediction of Buoyant Air Flow in Livestock Buildings*. Dept. of Building Technology and Structural Engineering. Indoor Environmental Technology Vol. R9351 No. 37

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### Take down policy

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

---

# INSTITUTTET FOR BYGNINGSTEKNIK

DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITETSCENTER • AUC • AALBORG • DANMARK

---

INDOOR ENVIRONMENTAL TECHNOLOGY  
PAPER NO. 37

Presented at the Fourth International Livestock Environment Symposium,  
Coventry, England, July 6-9, 1993

---

K. SVIDT  
NUMERICAL PREDICTION OF BUOYANT AIR FLOW IN LIVESTOCK  
BUILDINGS  
DECEMBER 1993

ISSN 0902-7513 R9351

---



The papers on INDOOR ENVIRONMENTAL TECHNOLOGY are issued for early dissemination of research results from the Indoor Environmental Technology Group at the University of Aalborg. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible reference should be given to the final publications (proceedings, journals, etc.) and not to the paper in this series.

---

**INSTITUTTET FOR BYGNINGSTEKNIK**  
DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITETSCENTER • AUC • AALBORG • DANMARK

---

**INDOOR ENVIRONMENTAL TECHNOLOGY**  
**PAPER NO. 37**

Presented at the Fourth International Livestock Environment Symposium,  
Coventry, England, July 6-9, 1993

---

**K. SVIDT**  
**NUMERICAL PREDICTION OF BUOYANT AIR FLOW IN LIVESTOCK**  
**BUILDINGS**  
**DECEMBER 1993**

---

**ISSN 0902-7513 R9351**

---



# NUMERICAL PREDICTION OF BUOYANT AIR FLOW IN LIVESTOCK BUILDINGS

K. Svidt\*

Aalborg University, Aalborg  
Royal Veterinary and Agricultural University, Copenhagen  
Denmark

## ABSTRACT

In modern livestock buildings air distribution and air quality are important parameters to animal welfare and to the health of full-time employees in animal production. Traditional methods for calculating air distribution in farm buildings are mainly based on formulas for air jets which do not include the effect of room geometry, obstacles or heat sources. This paper describes the use of Computational Fluid Dynamics to predict air flow patterns and temperature distribution in a ventilated space. Good agreement is found when results of numerical predictions are compared with experimental data.

**KEYWORDS:** Simulation, air flow, obstacles, buoyancy.

## INTRODUCTION

During the last decades livestock production has developed rapidly towards larger and more intensive production systems. In modern production systems air quality is important to animal welfare and important to the health of people who are full-time employed in animal production. Under these conditions design of proper ventilation systems is getting increasingly important.

Traditional methods for calculating air distribution in farm buildings are mainly based on formulas for free jets or wall jets. Using these methods it is not possible to include the effect of room geometry or the effect of obstacles on air flow patterns. Furthermore, traditional methods provide no possibilities to calculate important parameters such as contaminant concentration and ventilation efficiency for the ventilation system.

Computational Fluid Dynamics (CFD) is a technique for calculating air velocities and temperature distribution in a ventilated space. In principle, the ventilated space is divided into a number of small control volumes. In the centre of each control volume air velocities, pressure and temperature are calculated. The solution is determined by the boundary conditions which include room geometry, position of air inlet and outlet, inlet air velocity and air temperature and position of heat sources and obstacles.

Once the air flow field is described in this way, it is possible to calculate contaminant distribution in the room provided boundary conditions for the contaminant sources are known.

---

\*In previous publications the author has used the name *K.S. Christensen*. The author works at Aalborg University on a research project governed by the Royal Veterinary and Agricultural University in Copenhagen. The project is sponsored by the Danish Agricultural and Veterinary Research Council.

The principles of CFD have been used for about two decades (Launder and Spalding, 1974), (Nielsen, 1974). Today the required computer power is available to numerous researchers and many people are investigating the use of CFD for ventilation purposes.

The application of CFD to air flow in livestock buildings has been examined by a few authors. Choi et al. (1987, 1988, 1990, 1992) used a two-dimensional model to investigate the distribution of velocity and contaminants as well as the effects of buoyancy and obstacles. Krause and Janssen (1990) used a two-dimensional model to study how different air flow patterns could be used as a tool to minimize ammonia emission from livestock buildings. Hoff et al. (1992) investigated three-dimensional effects of buoyant flow in a slot-ventilated enclosure.

### MATHEMATICAL MODEL

A complete description of non-isothermal turbulent air flow in a room requires a number of partial differential equations. The governing differential equations can all be written in the following general form:

$$\rho \left( u \frac{\partial \phi}{\partial x} + v \frac{\partial \phi}{\partial y} + w \frac{\partial \phi}{\partial z} \right) = (\mu_l + \mu_t) \left( \frac{\partial^2 \phi}{\partial x^2} + \frac{\partial^2 \phi}{\partial y^2} + \frac{\partial^2 \phi}{\partial z^2} \right) + S_\phi \quad (1)$$

where

$\rho$	is the air density
$u$	is the velocity in the x - direction
$v$	is the velocity in the y - direction
$w$	is the velocity in the z - direction
$S_\phi$	is a source term of the variable $\phi$
$\phi$	can be any of the variables to be solved
$\mu_l$	is the constant laminar viscosity of the air
$\mu_t$	is the turbulent viscosity of the air

The left-hand side of eq. (1) represents convection and the right-hand side represents diffusion and source terms. More details about the governing equations are described by Schlichting (1979).

The turbulent viscosity describes the effects of turbulence on the air flow. The local value of the turbulent viscosity should be determined in each point of the solution domain by a turbulence model. Rodi (1984) describes the principles of different turbulence models. In this project the standard  $k, \epsilon$  turbulence model was used, in which the local value of turbulent viscosity is defined as:

$$\mu_t = \rho c_\mu \frac{k^2}{\epsilon} \quad (2)$$

where

$c_\mu$	is an empirical constant
$k$	is the turbulent kinetic energy
$\epsilon$	is the dissipation of turbulent kinetic energy

Like air velocities and air temperature the additional variables  $k$  and  $\epsilon$  should be calculated in each point of the solution domain, which is done by equations of same type as eq. (1) with different source terms. After introducing these variables the equation system to be solved consists of 7 partial differential equations with seven unknowns. The unknowns are the velocities  $u$ ,  $v$  and  $w$ ,

air pressure  $p$ , temperature  $T$ , and the turbulent quantities  $k$  and  $\epsilon$ . Techniques for numerical solution of the equations are described by Patankar 1980.

## RESULTS

The first test of the model was made on an isothermal two-dimensional model with a ceiling-mounted obstacle. The two-dimensional test case is shown in figure 1. The room has a length  $L$  of three times the height  $H$ . The inlet is in the upper left corner of the room and the outlet is in the lower left corner. Inlet height is  $h = 0.02 H$ . The inlet jet will form a horizontal two-dimensional wall jet. A ceiling-mounted obstacle of height  $f$  is placed at the distance  $x_f$  from the inlet. Values of  $x_f/h = 10, 30$  and  $60$  are used in this paper.

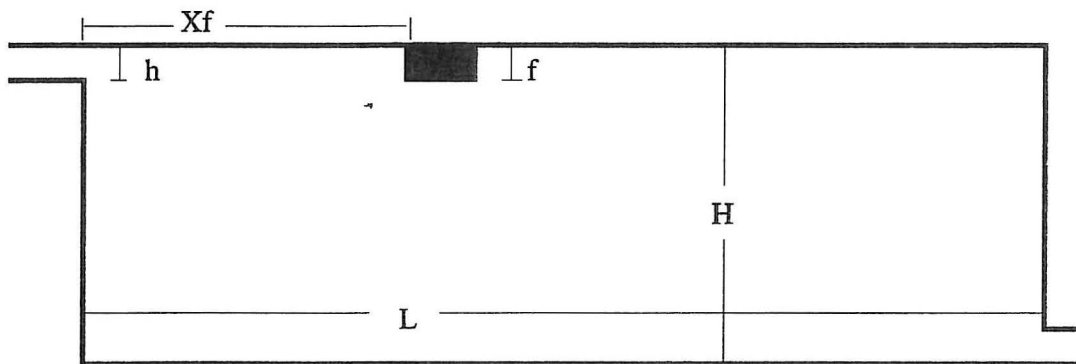


Figure 1. Geometry of the test case.

Nielsen (1983) presented experimental results of this test case. Velocity profiles were measured in the wall jet downstream of the obstacle in the distance  $x = 1.7 H$  from the inlet and also in the occupied zone at the distance  $x = 2.1 H$  from the inlet. Figure 2 shows calculated velocity vectors of a simulation where it can be seen how the inlet wall jet reattaches to the ceiling downstream of the obstacle.

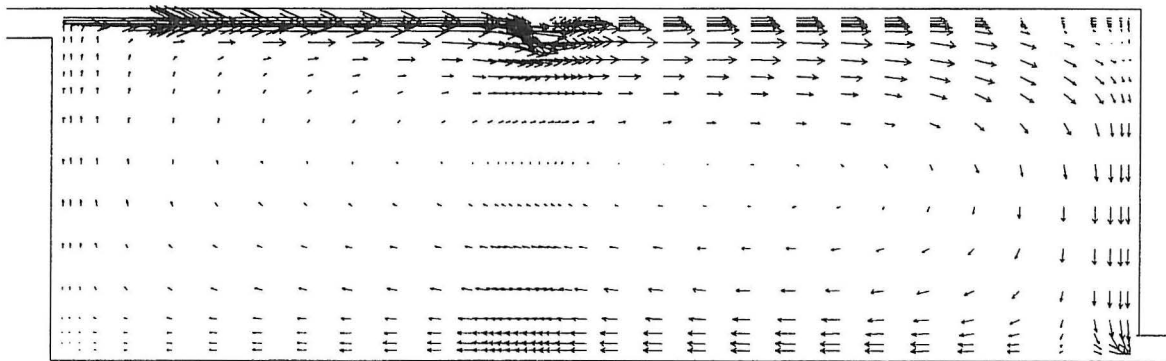


Figure 2. Calculated isothermal flow field with a ceiling-mounted obstacle.

In figure 3 calculated velocity profiles for different positions of the obstacle are compared with the experimental data of Nielsen (1983). It appears that good agreement is obtained, except when the obstacle is placed very close to the inlet. More details on this case are described by Christensen (1992).



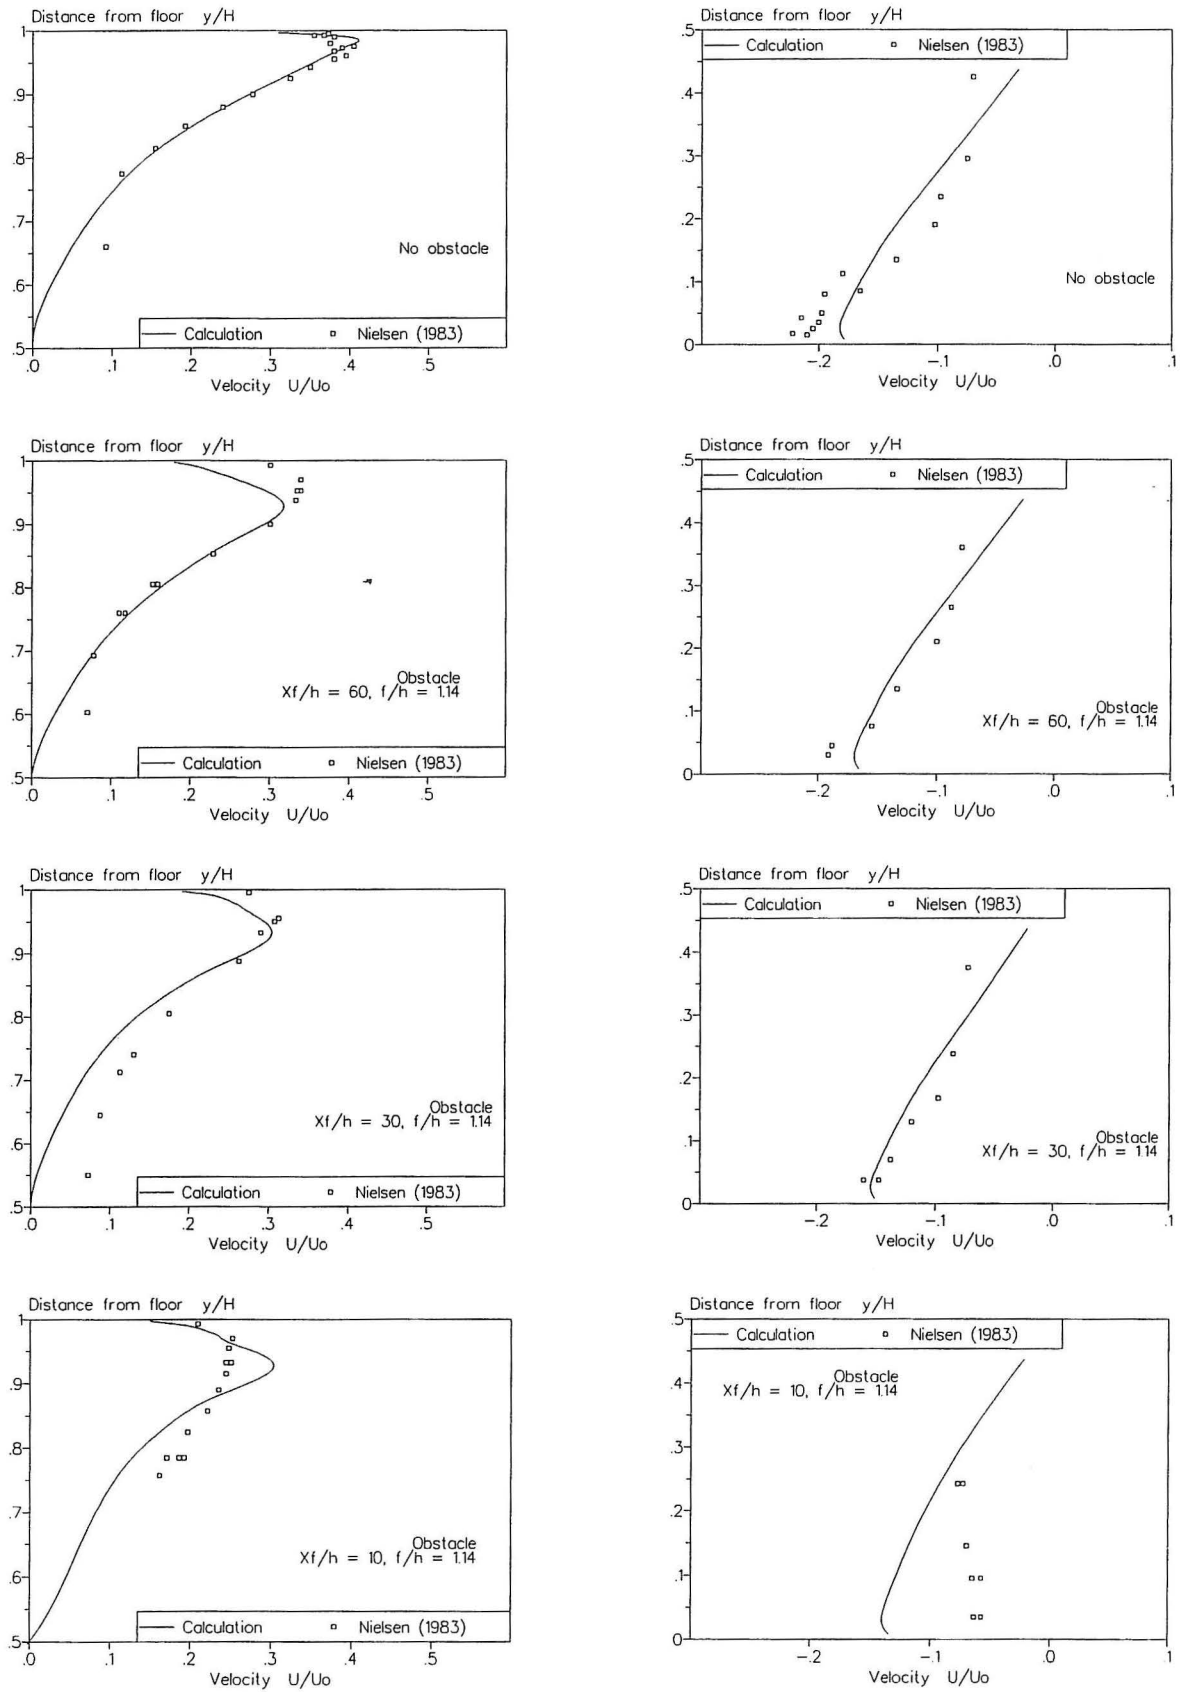


Figure. 3. Calculated and measured velocity profiles in the jet (left) and in the occupied zone (right).

Next step in the model validation was to include the temperature equation and buoyancy forces to predict non-isothermal air flow in a two-dimensional test case with a heat source evenly distributed along the floor and the same dimensions as in the previous case. In this case there were no obstacles. According to the test case specifications (Nielsen 1990) simulations should be carried out with increased Archimedes number until a reduced penetration depth of the inlet air jet is obtained.

Simulations carried out with a two-dimensional model were not able to predict a reduced penetration depth. Below a certain Archimedes number the inlet air jet would always penetrate to the end wall of the room (figure 4) and above this Archimedes number the inlet air would fall down immediately after entering the room (figure 5).

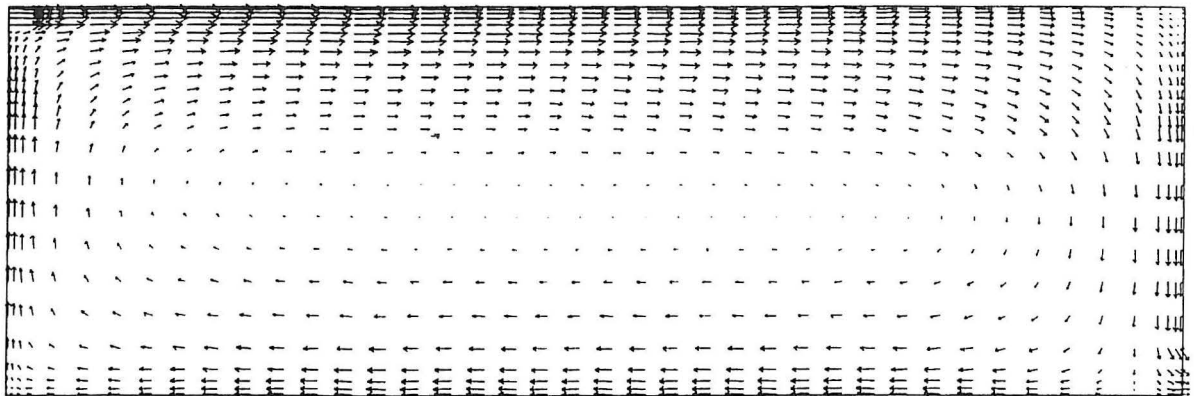


Figure 4. Below a certain Archimedes number the inlet air jet penetrates to the end wall.

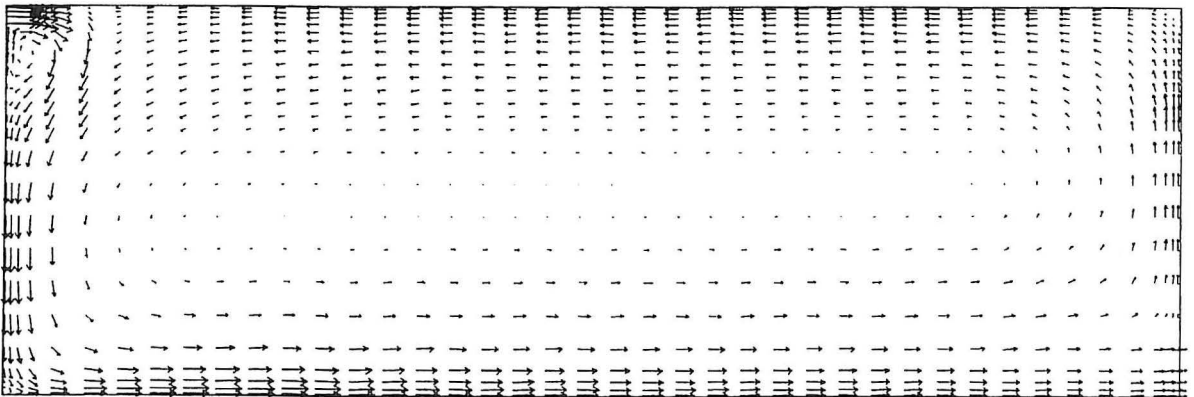


Figure 5. At higher Archimedes numbers the inlet air falls down directly from the inlet opening.

Now the three-dimensional simulation model was set up with the boundary conditions of the two-dimensional test case. It is shown in figure 6 that this model is able to predict a reduced penetration depth of the air jet. Furthermore the simulations show that there may be some instabilities and some three-dimensional effects in this case. Figure 7 shows an example of a calculated flow field in a horizontal plane at the same height as the inlet and figure 8 shows the corresponding flow field a few centimetres above the floor. Figures 6 - 8 show the three-dimensional nature of the flow. Three-dimensional effects in a similar test case with two-dimensional boundary conditions were also reported by Hoff (1992).

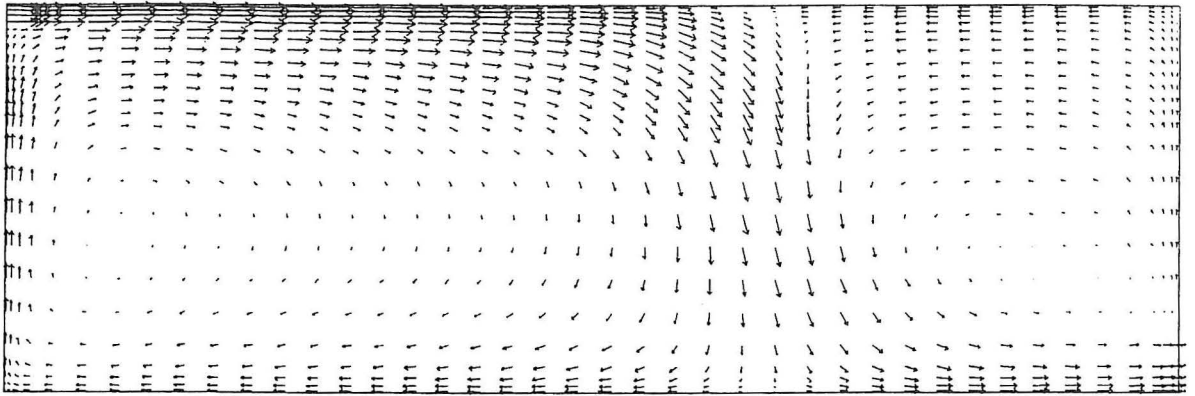


Figure 6. A reduced penetration depth was predicted by a three-dimensional simulation model.

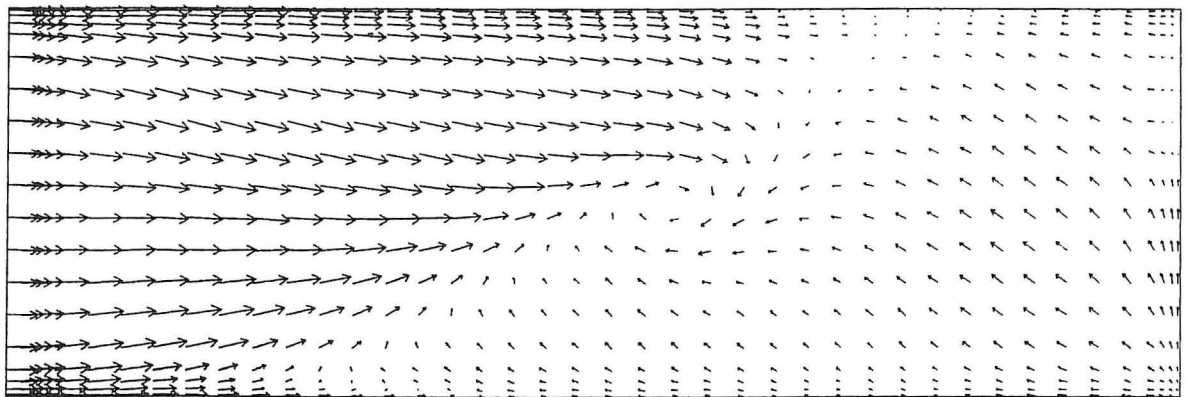


Figure 7. The simulated flow field in a horizontal plane near the ceiling.

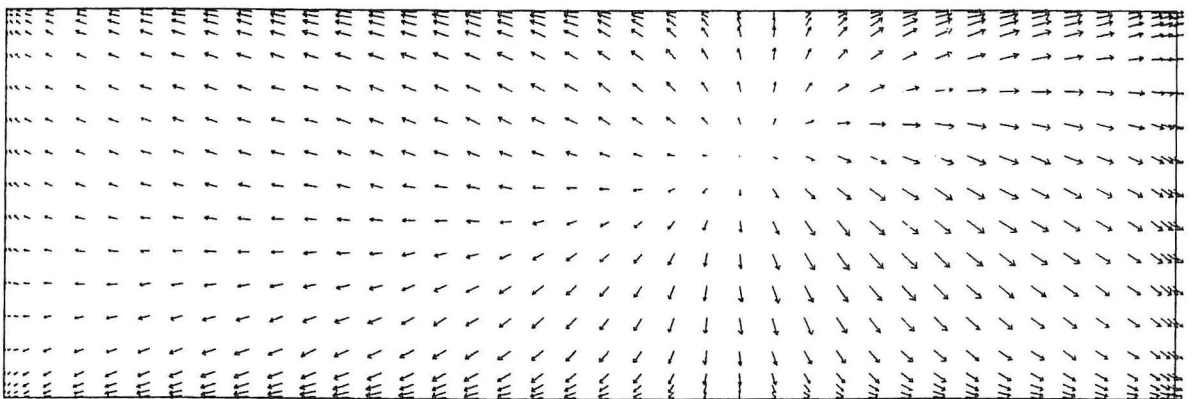


Figure 8. The simulated flow field in a horizontal plane near the floor.

## CONCLUSIONS

The numerical prediction of air flow in livestock buildings has been investigated by using a test case with ceiling-mounted obstacles such as light fittings or ceiling beams which are often found in livestock buildings. Predicted velocity profiles were in good agreement with experimental results for this test case.

Using a three-dimensional simulation model including the temperature equation and buoyancy forces it was possible to predict a reduced penetration depth of a non-isothermal inlet air jet.

Based on the results obtained in this project and results presented in the literature it is concluded that numerical prediction of air flow will be a valuable tool for research and design of ventilation systems for livestock buildings. A very interesting feature is the possibility to make detailed calculations of environmental conditions in the occupied zone, such as velocity and temperature distribution and contaminant concentrations.

Finally, it should be mentioned that one three-dimensional simulation of non-isothermal air flow may take several hours of computing time on a normal workstation, but this problem is expected to be reduced in the future with more efficient computer codes and faster computers.

## REFERENCES

*Christensen, K.S.:*

Numerical Prediction of Airflow in a Room with Ceiling-Mounted Obstacles. Proceedings, Roomvent'92, Third International Conference on Air Distribution in Rooms, Aalborg 1992.

*Choi, H.L., L.D. Albright, M.B. Timmons and Z. Warhaft:*

Air Velocity and Contaminant Distribution in a Slot-Ventilated Enclosure. ASAE Paper 87-4036.

*Choi, H.L., L.D. Albright, M.B. Timmons and Z. Warhaft:*

An Application of the K-Epsilon Turbulence Model to Predict Air Distribution in a Slot-Ventilated Enclosure. Transactions of the ASAE, Vol. 31 (6), November-December 1988.

*Choi, H.L., L.D. Albright, M.B. Timmons:*

An Application of the K-Epsilon Turbulence Model to Predict how a Rectangular Obstacle a Slot-Ventilated Enclosure Affects Air Flow. Transactions of the ASAE, Vol. 31 (6), November-December 1988.

*Choi, H.L. and K. Hyeon-Tae:*

An Application of K-Epsilon Turbulence model to Predict How a Rectangular Obstacle with Heat Flux in a Slot-Ventilated Enclosure Affects Air Flow. International Symposium on Room Air Convection and Ventilation Effectiveness, University of Tokyo, July 22 - 24, 1992.

*Hoff, S.J., K.A. Janni and L.D. Jacobson:*

Three-Dimensional Buoyant Turbulent Flows in a Scaled Model, Slot-Ventilated, Livestock Confinement Facility. Transactions of the ASAE, Vol. 35 (2), March-April 1992.

*Krause, K.H. and J. Janssen:*

Measuring and Simulation of the Distribution of Ammonia in Animal Houses. Proceedings, Roomvent'90, International Conference on Engineering Aero- and Thermodynamics of Ventilated Rooms, Oslo 1990.

*Launder, B.E. and D.B. Spalding:*

The Numerical Computation of Turbulent Flows. Computer Methods in Applied Mechanics and Engineering 3, pp 269-289, 1974.

*Nielsen, P. V.:*

Flow in Air Conditioned Rooms. Ph.D. dissertation, Danish Technical University, 1974.

*Nielsen, P. V.:*

Air Diffusion in Rooms with Ceiling-mounted Obstacles and Two-Dimensional Isothermal Flow. 16th international congress of refrigeration, Paris 1983.

*Nielsen, P. V.:*

Specification of a Two-Dimensional Test Case. International Energy Agency, Annex 20, 1990.

*Patankar, Suhas V.:*

Numerical Heat Transfer and Fluid Flow. Hemisphere Publishing Corporation 1980.

*Rodi, Wolfgang:*

Turbulence Models and their Application in Hydraulics - a State of the Art Review. IAHR 1984.

*Schlichting, Hermann:*

Boundary-Layer Theory. McGraw-Hill 1979.





## PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 7: Peter Kofoed, Peter V. Nielsen: *Thermal Plumes in Ventilated Rooms - An Experimental Research Work*. ISSN 0902-7513 R8833.

PAPER NO. 8: Peter V. Nielsen, Lars Hoff, Lars Germann Pedersen: *Displacement Ventilation by Different Types of Diffusers*. ISSN 0902-7513 R8834.

PAPER NO. 9: Per Heiselberg, Peter V. Nielsen: *Flow Conditions in a Mechanically Ventilated Room with a Convective Heat Source*. ISSN 0902-7513 R8835.

PAPER NO. 10: Peter V. Nielsen: *Displacement Ventilation in a Room with Low-Level Diffusers*. ISSN 0902-7513 R8836.

PAPER NO. 11: Peter V. Nielsen: *Airflow Simulation Techniques - Progress and Trends*. ISSN 0902-7513 R8926.

PAPER NO. 12: M. Skovgaard, C. E. Hyldgaard & P. V. Nielsen: *High and Low Reynolds Number Measurements in a Room with an Impinging Isothermal Jet*. ISSN 0902-7513 R9003

PAPER NO. 13: M. Skovgaard, P. V. Nielsen: *Numerical Prediction of Air Distribution in Rooms with Ventilation of the Mixing Type using the Standard  $K, \epsilon$ -Model*. ISSN 0902-7513 R9042.

PAPER NO. 14: P. Kofoed, P. V. Nielsen: *Thermal Plumes in Ventilated Rooms - Measurements in Stratified Surroundings and Analysis by Use of an Extrapolation Method*. ISSN 0902-7513 R9043.

PAPER NO. 15: P. Heiselberg, M. Sandberg: *Convection from a Slender Cylinder in a Ventilated Room*. ISSN 0902-7513 R9044.

PAPER NO. 16: C. E. Hyldgaard: *Water Evaporation in Swimming Baths*. ISSN 0902-7513 R9045.

PAPER NO. 17: H. Overby, M. Steen-Thøde: *Calculation of Vertical Temperature Gradients in Heated Rooms*. ISSN 0902-7513 R9046.

PAPER NO. 18: P. V. Nielsen, U. Madsen, D. Tveit: *Experiments on an Exhaust Hood for the Paint Industry*. ISSN 0902-7513 R9146.

PAPER NO. 19: L. Germann Pedersen, P. V. Nielsen: *Exhaust System Reinforced by Jet Flow*. ISSN 0902-7513 R9147.

PAPER NO. 20: P. V. Nielsen: *Models for the Prediction of Room Air Distribution*. ISSN 0902-7513 R9148.

PAPER NO. 21: M. Skovgaard, P. V. Nielsen: *Modelling Complex Inlet Geometries in CFD - Applied to Air Flow in Ventilated Rooms*. ISSN 0902-7513 R9149.

PAPER NO. 22: M. Skovgaard, P. V. Nielsen: *Numerical Investigation of Transitional Flow over a Backward Facing Step using a Low Reynolds Number  $k - \epsilon$  Model*. ISSN 0902-7513 R9150.



## PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 23: P. Kofoed, P. V. Nielsen: *Auftriebsströmungen verschiedener Wärmequellen - Einfluss der umgebenden Wände auf den geförderten Volumenstrom*. ISSN 0902-7513 R9151.

PAPER NO. 24: P. Heiselberg: *Concentration Distribution in a Ventilated Room under Isothermal Conditions*. ISSN 0902-7513 R9152.

PAPER NO. 25: P. V. Nielsen: *Air Distribution Systems - Room Air Movement and Ventilation Effectiveness*. ISSN 0902-7513 R9250.

PAPER NO. 26: P. V. Nielsen: *Description of Supply Openings in Numerical Models for Room Air Distribution* ISSN 0902-7513 R9251.

PAPER NO. 27: P. V. Nielsen: *Velocity Distribution in the Flow from a Wall-mounted Diffuser in Rooms with Displacement Ventilation*. ISSN 0902-7513 R9252.

PAPER NO. 28: T. V. Jacobsen & P. V. Nielsen: *Velocity and Temperature Distribution in Flow from an Inlet Device in Rooms with Displacement Ventilation*. ISSN 0902-7513 R9253.

PAPER NO. 29: P. Heiselberg: *Dispersion of Contaminants in Indoor Climate*. ISSN 0902-7513 R9254.

PAPER NO. 30: P. Heiselberg & N. C. Bergsøe: *Measurements of Contaminant Dispersion in Ventilated Rooms by a Passive Tracer Gas Technique*. ISSN 0902-7513 R9255.

PAPER NO. 31: K. S. Christensen: *Numerical Prediction of Airflow in a Room with Ceiling-Mounted Obstacles*. ISSN 0902-7513 R9256.

PAPER NO. 32: S. G. Fox & P. V. Nielsen: *Model Experiments in 1990 and On-Site Validation in 1992 of the Air Movement in the Danish Pavilion in Seville*. ISSN 0902-7513 R9335.

PAPER NO. 33: U. Madsen, N. O. Breum & P. V. Nielsen: *Local Exhaust Ventilation - a Numerical and Experimental Study of Capture Efficiency*. ISSN 0902-7513 R9336.

PAPER NO. 34: T. V. Jacobsen, P. V. Nielsen: *Numerical Modelling of Thermal Environment in a Displacement-Ventilated Room*. ISSN 0902-7513 R9337.

PAPER NO. 35: P. Heiselberg: *Draught Risk from Cold Vertical Surfaces*. ISSN 0902-7513 R9338.

PAPER NO. 36: P. V. Nielsen: *Model Experiments for the Determination of Airflow in Large Spaces*. ISSN 0902-7513 R9339.

PAPER NO. 37: K. S. Christensen: *Numerical Prediction of Buoyant Air Flow in Livestock Buildings*. ISSN 0902-7513 R9351.

Department of Building Technology and Structural Engineering  
The University of Aalborg, Sohngaardsholmsvej 57. DK 9000 Aalborg  
Telephone: 45 98 15 85 22    Telefax: 45 98 14 82 43