



**AALBORG UNIVERSITY**  
DENMARK

**Aalborg Universitet**

## **Computational optimization techniques applied to microgrids planning**

*a review*

Gamarra, Carlos; Guerrero, Josep M.

*Published in:*  
Renewable & Sustainable Energy Reviews

*DOI (link to publication from Publisher):*  
[10.1016/j.rser.2015.04.025](https://doi.org/10.1016/j.rser.2015.04.025)

*Publication date:*  
2015

*Document Version*  
Early version, also known as pre-print

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Gamarra, C., & Guerrero, J. M. (2015). Computational optimization techniques applied to microgrids planning: a review. *Renewable & Sustainable Energy Reviews*, 48, 413–424. <https://doi.org/10.1016/j.rser.2015.04.025>

### **General rights**

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- ? Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- ? You may not further distribute the material or use it for any profit-making activity or commercial gain
- ? You may freely distribute the URL identifying the publication in the public portal ?

### **Take down policy**

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

# Computational optimization techniques applied to microgrids planning: a review

Carlos Gamarra<sup>a</sup> and Josep M. Guerrero<sup>b,\*</sup>

a Department of Electromechanical Engineering, University of Burgos, Spain

b Department of Energy Technology, Aalborg University, Denmark

\* Corresponding author

Josep M. Guerrero, Professor in Microgrid  
Department of Energy Technology, Aalborg University  
Microgrids Research Programme [www.microgrids.et.aau.dk](http://www.microgrids.et.aau.dk)  
Pontoppidanstraede 101, room 79, 9220 Aalborg East, Denmark  
Phone: (+45) 9940 9726 , Email: [joz@et.aau.dk](mailto:joz@et.aau.dk)

## Keywords

Microgrid; optimization; planning; sizing; siting; scheduling, feasibility, methodology

## Acronyms

International Energy Agency (IEA), Information and Communications Technologies (ICTs), Combined Heat and Power (CHP); Distributed Energy Resources (DER); Renewable Energy Sources (RES); Consortium of Electric Reliability Technology Solutions (CERTS); Web of Science (WOS); Linear Programming (LP); Integer Linear Programming (ILP); Integer Programming (IP); Simulated Annealing (SA); Tabu Search (TS); Greedy Randomized Adaptive Search Procedures (GRASP); Variable Neighbourhood Search (VNS); Iterated Local Search (ILS); Karush-Kuhn-Tucker (KKT); Evolutionary Strategy (ES); Integer Minimization Problem (IMP); Genetic Algorithm (GA); Particles Swarm Optimization (PSO); Artificial Immune System (AIS); Mixed Integer Programming (MIP); Mixed Integer Non Linear Problem (MINLP); Energy Storage System (ESS); Mixed Integer Linear Programming (MILP); Artificial Neural Networks (ANN); Medium Voltage (MV); Vaccine-enhanced Artificial Immune System (Vaccine-AIS); Modified Discrete Particle Swarm Optimization (MDPSO); Versatile Energy Resource Allocation (VERA); Sequential Quadratic Programming technique (SQP); Dynamic Programming (DP); Multi-Path Dynamic Programming (MPDP); Time Of Use (TOU); Direct Current (DC); Mesh Adaptive Direct Search (MADS); Modified Gravitational Search Algorithm (MGSA); Energy Management System (EMS); Adaptive Modified Firefly Algorithm (AMFA); Gravitational Search Algorithm (GSA); Self-adaptive Charged System Search (SCSS); Bacterial Foraging Algorithm (BFA); Competitive Heuristic Algorithm for Scheduling Energy-generation (CHASE); Multi-Agent System (MAS); Geographical Information System (GIS); Virtual Power Plants (VPP); District Heating (DH).

## Abstract

Microgrids are expected to become part of the next electric power system evolution, not only in rural and remote areas but also in urban communities. Since microgrids are expected to coexist with traditional power grids (such as district heating does with traditional heating systems), their planning process must be addressed to economic feasibility, as a long-term stability guarantee. Planning a microgrid is a complex process due to existing alternatives, goals, constraints and uncertainties. Usually planning goals conflict each other and, as a consequence, different optimization problems appear along the planning process. In this context, technical literature about optimization techniques applied to microgrid planning have been reviewed and the guidelines for innovative planning methodologies focused on economic feasibility can be defined. Finally, some trending techniques and new microgrid planning approaches are pointed out.

## 1. Introduction

Modern societies are highly dependent on electric energy supply. Following IEA energy statistics, this dependence has been increasing during the last 40 years. Nevertheless, electric power systems have not been significantly upgraded for decades. Since new enabling technologies for energy systems are being developed (such as ICT, microCHP, energy storage and renewable energy sources, smart meters, etc.), new concepts are appearing in modern power systems. One of the most popular is the microgrid concept, being a novel power grid structure based on DER, RES, power electronics and ICTs.

One of the earliest definitions of microgrids was made by CERTS. They define microgrids as *clusters of generators, including heat recovery, storage, and loads, which are operated as single controllable entities*. In addition a comparison between microgrid concepts is done by J.I. Ping et al. in [1]

Some microgrid classifications have been presented in technical papers since this concept appeared in 1998, according to Web of Science (WOS) references. P. Lilienthal points out in [2] different criteria for microgrid classification such as: other grids connection, types of energy generation, voltage level of distribution system, peak load, generation capacity, energy production, number of customers served, load management and metering. He also makes a proposal for microgrid classification regarding size and grid connection, defining four main microgrids types such as: large grid-connected microgrids, small grid-connected microgrids, large remote microgrids and small remote microgrids.

Due to the modular nature of microgrids, they can operate both independently or in conjunction with the main electrical grid. Microgrids not only have less financial commitments and require fewer technical skills to operate, but also rely more on automation [3,4]. **These advantages make microgrids a suitable solution to gradually modernize existing power grids.** Other advantages for microgrid establishment are the integration of renewable resources from local areas and the independence of the consumer from large corporations that manage actual power grids.

**Despite all these advantages, planning a cost-effective microgrid is considered as a complex process due to all alternatives to consider at any decision level.** Every decision taken in a planning process will influence the capacities of the system in a competitive energy market. Every planning process is built around specific goals and constraints. Not only goals and constraints (such as technical, environmental, geographical, social and regulatory constraints) define by themselves the whole framework of the planning process, but also uncertainties are a key factor in every planning process. They are a powerful source of risks that system planners need to avoid, or at least to control. S. French in [5] identifies several sources of uncertainties in all the main steps of a decision making process: *uncertainties in modelling, uncertainty expressed during the exploration of the model and uncertainties in the interpretation of results*. But other authors in [6], motivated by practical needs for modelling the decision making problem, have classified every uncertainties under two main categories:

- External uncertainty: related to the lack of knowledge (about the consequences of an action, outside of the control of the decision-maker), and to the nature of the environment.
- Internal uncertainties: presented in the process of identification, structuring and analysis of the decision-maker (depending on the decision maker).

Beyond these uncertainties, constraints and planning objectives, every commercial microgrid must be addressed towards two main goals: cost efficiency and customer satisfaction. In a microgrid, consumer satisfaction means reliability and quality keeping, causing as low environmental impact as possible. Hence, some of these objectives can be opposed to the others regarding costs of the system. It is generally accepted that it is necessary to invest in renewable power sources and in energy efficiency-based technologies in order to minimize the environmental impact of a microgrid. These investments may upgrade the system, but also influences economic feasibility. For instance, economic feasibility for renewable power sources will depend on different issues such as local electricity costs, space requirements, allocation, initial investment, operational and management costs, grid-connection charges, taxes and grants. Strong investments are also needed in order to raise the reliability or the quality of supply, but every project has its own economical constraints, especially at the design stage. **That is the reason why the microgrid planning process is usually based on an optimal or trade-off solution searching process.**

**A microgrid (considered as a community energy system) usually encompasses a mix of traditional and renewable power sources-based technologies.** Different authors have previously reviewed planning tools for microgrid-related technologies [7,8]. For example, in [7] G. Mendes et al. introduce the most common available tools for community energy systems planning. They include a survey of these tools, qualifying them as *bottom-up, simulation, equilibrium, operation optimization and investment optimization tools*. Some of these tools are suitable for microgrid planning, such as HOMER, DER-CAM, EAM, MARKAL/TIMES, RETScreen and H2RES. Also D. Conolly et al. presents in [8] a deep comparison of 37 different analysis software tools used to evaluate renewable energy sources integration projects. This paper also includes HOMER, MARKAL/TIMES, RETScreen and H2RES.

Since a **microgrid planning process can be approached as a sequence of optimization problems**, along technical literature different optimization problems have been considered at different planning levels. In this context, different researches have decided to reviewed optimization applied to microgrid-related technologies such as renewable power sources [9–11]. R. Baños et al review in [10] optimization methods applied to wind power, solar energy, hydropower, bioenergy, geothermal energy and hybrid systems. Different approaches to optimal design of renewable energy based on hybrid systems are also reviewed in [9] by O. Erdinc *et al.* M. Iqbal *et al* present in [11] a generic list of inputs, outputs, objectives and constraints resource allocation problem of renewable energy sources. They also introduce a list of optimization tools, a conflicting objective matrix, and an optimization techniques review.

Hence, several optimization planning techniques have been applied not only to renewable energy sources, but also to energy community systems, e.g. district heating [12–15]. Different energy community systems may require different optimization techniques due to system constraints (mainly technical, environmental and economical) and uncertainties. The appearance of new computational optimization methods and algorithms are allowing new approaches to planning problems. **The coexistence of these widely used mathematical optimization techniques with new ones makes more attractive the idea of reviewing microgrid planning problems.**

## 2. Computational optimization techniques: a brief introduction

The term computational optimization refers to a group of mathematical techniques focused on the selection of an optimal solution (with regard to some criteria) from a set of available alternatives. Indeed, optimization includes finding the best available values of some objective function given a defined domain or a set of constraints, including a wide range of objective functions and types of domains. The generalization of optimization theory and techniques to other formulations comprises a large area of applied mathematics. R. Baños et al. introduce in [10] different disciplines included into computational optimization such as *mathematics to formulate the model, operations research to model the system, computer science for algorithmic design and analysis, and software engineering to implement the model.*

U. Diwerak describes optimization process as an iterative procedure, which is basically composed of an optimizer and a model [16]. Modelling is defined as the *process of identifying objectives, variables and constraints for a given problem* [17]. *The optimizer invokes the model with a set of values of decision variables, while the model calculates the objective function and constraints. This information is utilized by the optimizer to calculate a new set of decisions variables. This iterative sequence continues until the optimization criteria pertaining to the optimization algorithm are satisfied* [16].

Optimization algorithms, iterative and heuristics methods are cited among computational optimization techniques. The use of different optimization algorithms depends upon the type of optimization problem. At the same time, there exist many different optimization problem classifications, depending

on the type of decision variables, objective functions and constraints. J. Nocedal and S.J. Wright [17] define different categories such as: continue and discrete, constrained and unconstrained, global and local, stochastic [18] and deterministic, multimodal and multiobjective and heuristic and metaheuristic optimization [19].

Despite of the name, an optimization method will not always find the optimum solution. Sometimes an optimization problem can be unfeasible due to the characteristics of the problem. For example, when in a LP optimization problem all the unknown variables are required to be integers, the problem is called ILP or IP problem. In contrast to linear programming, which can be solved efficiently, IP problems are in many practical situations Non-deterministic Polynomial-time hard (NP-hard) [20]. Algorithms used to solve a NP-hard problem might need exponential computation time to obtain the optimum, which leads too high times for practical purposes. Thus, during the last years many authors have proposed approximate methods (including heuristic and metaheuristic approaches) to solve optimization problems.

Heuristic methods are designed to find a good solution among a large set of feasible solutions with less computational effort than optimization techniques [9]. They are useful approaches for optimization problems when classic optimization techniques are not able to find the optimal solution. Besides heuristics there exists metaheuristics. Metaheuristics are used to find an optimal solution from discrete search-space The point of metaheuristics is that they can combine more than one heuristic method: the first one can be used to find a primary solution and later another heuristic method can be used in order to find a better solution. Perhaps the most popular way of classifying metaheuristic algorithms is based on trajectory methods vs. population-based methods, but other classifications such as bio-inspired one [21] are often used:

- Trajectory meta-heuristics use a single-solution approach focused on modifying and improving a single candidate solution during the search process. The outcome is also a single optimized solution. The main meta-heuristic methods in this category includes: SA, TS, GRASP, VNS and ILS.
- Population-based meta-heuristics use a population of solutions, which evolve during a previously fixed number of iterations, returning a population of solutions when the stop condition is fulfilled. Perhaps GA and PSO are the most popular algorithms in this category.
- Bio inspired metaheuristics: are metaheuristics that mimics the nature for solving optimization problems. In [21] S. Binitha and S. Shatia classify these techniques into three main types: Evolutionary algorithms, Swarm intelligence and Ecology-based algorithms.

In addition, other kind of metaheuristics can be considered, such as *hybrid* and *parallel* metaheuristics. The *hybrid metaheuristic* combines other optimization approaches with the metaheuristic one. Meanwhile the *parallel metaheuristic* is an algorithm that runs multiple metaheuristic searches in parallel by using parallel computing techniques.

In some cases, the complexity of the problems to solve is so high that no heuristic neither metaheuristic method is able to obtain accurate solutions in reasonable runtimes. Hence, parallel computing becomes an interesting way to obtain good solutions with reduced runtimes. Parallel computing is a form of computation in which large problems can be divided into smaller ones, carrying out many calculations simultaneously. Common types of problems found in parallel computing for microgrid applications are Monte Carlo Simulation [22–24] and Dynamic Programming [25,26].

Regarding this brief introduction to computational optimization, it could be asserted that a holistic real-life microgrid planning problem can be considered constrained, stochastic, and multi-objective. But several authors have applied different approaches to microgrid planning problems. Those problems will be reviewed in the following sections, together with optimization techniques applied to solve them.

### 3. Optimization techniques applied to microgrid planning problems.

Community energy systems planning problems have been traditionally addressed towards cost minimization objectives [27–29]. Beyond economic goals, during the planning process other different goals can be considered, such as total environmental impact, power quality and reliability [30].

Even though each microgrid planning process has its own constraints and specific goals, **some planning problems can be considered common to every microgrid, according to the reviewed technical literature.** These planning problems are:

- **Power generation mix selection and sizing:** Microgrid design engineers are responsible of choosing the best available power system to satisfy demand requirements for a particular area. Power sources selection requires a deep analysis of suitable electric power supplies for microgrid applications in the influence area. Power generation and energy storage equipment must be sized according the peak-load demand and cost effectiveness criteria. Not only a high percentage of the initial investment is done at this stage, but also other critical decisions must be done. Types of fuels suitable for the power plant must also be selected, which is a critical issue regarding cost efficiency and reliability of the system. In summary, this problem must be considered among strategic issues for the system and there exist three main objectives to fulfil during this planning stage: high cost-effectiveness, low environmental impact and high reliability.
- **Siting problem** covers power sources allocation and power lines layout in order to keep quality constraints. In this process not only actual consumers, but also potential customers must be considered. As a result power lines must serve customers areas and also must be addressed to potential areas. This problem can also be considered among strategic level problems. As in sizing problem, initial investment depends directly on final design at this stage. In this planning stage not only it is necessary to provide high cost-effectiveness and high reliability as in the previous one, but also low power losses are required.

- **Scheduling** is the main problem of tactical planning level, because it is focused on available resources planning, such as generators and storage devices. Scheduling problem is aimed at minimizing operational costs, environmental impact and quality keeping while demand is covered. Optimal operational conditions for different microgrid configurations are searched using different **optimization techniques towards one or more than one objective optimization**.

These stages are common in every feasibility study when planning a microgrid. A survey of optimization techniques taking part in these stages is presented in this section. In addition, some related mathematical techniques such as simulation, fuzzy logic and forecasting, including uncertainty management, will also be presented.

### 3.1. *Power generation mix selection and sizing: economic load dispatch problem basis*

Economic issues are a high priority in the microgrid planning in order to address long-term establishment for the system. The successful deployment of a microgrid depends on the economic success of small clusters of mixed technology generators, grouped with storage devices and other reliability-based factors such as fuels allowed. Main problems in technical papers at strategic planning level are power sources selection [31] and sizing [9], energy storage devices selection and sizing [32] and siting. Determination of the real power outputs for the generators so that the total cost of the system is minimized is also known as **the problem of economic load dispatch**. As it will be described below, power mix selection and sizing problems are addressed towards ELD problem.

**Traditional optimization** techniques are used in [33] by M. Vafaei and M. Kazerani, selecting and sizing, different power generation technologies and storage devices for a microgrid, in order to minimize operational costs. The optimization model is formulated as a MIP (Mixed Integer Programming) problem in GAMS environment. Also, a classical optimization method is reviewed towards microgrid modelling purposes in [34] by Augustine *et al.* They perform the power mix selection of four different types of microgrids by using the *Reduced-Gradient Method for Economic Dispatch* algorithm and Matlab software in order to simulate the system. In this paper the final selection is based on economic dispatch costs, taking into account renewable energy sources penetration, costs and receipts associated.

Y. Han et al. in [35] solve the ELD problem using the Karush-Kuhn-Tucker (KKT) conditions. Allowing inequality constraints, the KKT approach to nonlinear programming generalizes the method of Lagrange multipliers, which allows only equality constraints. The KKT approach guarantees to find the true optimum (versus heuristic search approaches), but is also readily capable of being extended with further realistic constraints/costs, versus purely analytic approaches.

In [36] T. Logenthiran compares a classical Integer Minimization Problem (IMP) with Evolutionary Strategy (ES) method (a generic population-based optimization metaheuristic algorithm) in order to size



power equipment for an islanded microgrid. The optimization aim is to minimize the sum of the total capital, operational and maintenance cost of DERs.

**Heuristics** are widely used in sizing and power generation mix selection. Erdinc in [9] highlights some heuristic optimization techniques for hybrid renewable energy systems sizing such as: GA, PSO, SA and some promising techniques such as Ant Colony and AIS. In [37] S.M.M. Tafreshi et al model a microgrid using MATLAB and GA to solve the sizing problem with some restrictions. They evaluate the system considering costs and benefits such as: the cost function annualized capital, replacement, operational, maintenance, fuel costs and annual earning by selling power to grid. SA algorithm is used to solve the optimal sizing problem for renewable energy generations and combined heat and power (CHP) units in a hybrid energy microgrid in [38]. Stochastic variability of renewable energy resources and the heat and power requirements are considered in order to meet customer requirements with minimum system annual cost.

Energy efficiency and renewable power sources are nowadays the guidelines to minimize the environmental impact of a microgrid. But since renewable power sources are not always ready to produce energy at their peak power, energy storage becomes an important topic in microgrids. Thus, **sizing problem concerns not only to power sources but also to energy storage devices**. These devices must be sized and located regarding cost-effectiveness, environmental impact, reliability and quality goals. This topic is introduced by S. Bahramirad et al. in [39] in which the optimal ESS sizing problem is proposed both for initial investment and expansion problems. The problem is analysed from an economical point of view, using a MIP approach in order to minimize investment in storage devices and microgrid operational costs.

S.X. Chen et al. propose in [32] a method based on the cost-benefit analysis for optimal sizing of an energy storage system in a microgrid. *Time series* and *Feed-forward neural network* techniques are used for forecasting the wind speed and solar radiations respectively. The main problem is formulated as a MILP, which is solved in AMPL (*A Modelling Language for Mathematical Programming*). A specific Artificial Neural Network algorithm is used for production forecasting, meanwhile a classical approach is used for the optimization problem. An heuristic method is again used in [40] by Navaeefard *et al.* They introduce uncertainty in a microgrid sizing problem that includes photovoltaic PV/wind hybrid system with storage energy systems. Wind power uncertainty is proposed and reliability index are considered as a constraint. PSO algorithm is used to obtain global optimal solutions using MATLAB.

In [41] O. Menniti et al. propose a **methodology** to determine the optimum sizing and configuration of a grid-connected hybrid Photovoltaic/Wind system, including energy storage systems and ensuring that the system total cost is minimized while guaranteeing a highly reliable source of load power. They base their analysis on simulation techniques.

Some of these mathematical programming methods **are nowadays implemented by software tools**, which are widely used in microgrid planning. Most of these tools, instead of not being specifically focused on microgrids, are suitable for microgrid modelling. ETAP is introduced as one of these tools in [42]. A comparison between two different technology selection and sizing softwares such as HOMER and

WEBOPT is done by A. Litchy et al. in [43]. Since WebOpt is based in a MILP optimization, HOMER is based on alternatives simulation, creating a list of feasible configurations sorted by net present cost. DER-CAM software is the main tool for a commercial-building microgrid technology selection and operation in [44]. The output from DER-CAM is a cost-minimizing equipment combination for a building, including CHP equipment and RES. The results of DER-CAM suggest not only an optimal (potentially mixed technology) microgrid, but also an optimal operating schedule that can serve as the basis for a microgrid control strategy.

HOMER software is widely used with microgrid modelling purposes. It is used by C. Nayar et al. in [45] in order to define a layout of power plants for an hybrid microgrid in remote islands in Republic of Maldives. A stand-alone microgrid is also designed in [46] for Pulau Ubin Island of Singapore. In this paper authors simulate different systems using HOMER in order to fit the needs with optimum cost and available renewable sources, including storage units sizing. A similar work is presented in [47], selecting and sizing power generators for a rural microgrid in India. Environmental objectives can also be considered using this modelling software. In [48] W. Su et al. study the planning and operation of micro-source generators to accommodate the high demand of renewable energy and the environment policy.

### 3.2. Siting

Nowadays there exist many papers on allocation of energy resources, not only for DERs and RES, but also for energy community systems, such as district heating [49]. However, there exist two main approaches: power lines layout and equipment siting (power and storage equipment). Both are focused on power loss minimization and quality keeping goals.

Q. Cui et al. presents in [50] a **traditional approach** to design cost-optimized microgrid architectures subject to reliability constraints. The method is based on DP and consists on determining the optimal power line layout between microsources and load points, given their locations and the rights of way for possible interconnections.

A. Khodaei presents in [51] an algorithm for microgrid planning as an alternative to the optimization of traditional electric power systems regarding generation and transmission. The optimization problem is decomposed into a planning problem and an annual reliability problem. The objective is to minimize the total system planning cost, and a software called *Versatile Energy Resource Allocation* (VERA) is used. A prediction of demand coverage based on local weather conditions is also performed. Nonlinear aspects of the problem are solved with Sequential Quadratic Programming technique (SQP).

In [52] V. Verda and C. Ciano deals with the choice of the optimal configuration of a district heating network to be built in an urban area. Users to be connected to the network are determined and an economic objective function is optimized using SA. Despite this is not a specific microgrid planning problem, a similar method could be used when a microgrid has to deal with competence in an urban area. The technique *Modified Discrete Particle Swarm Optimization* is used in [53] by M.T. Wishart et al.

to plan a distribution system upgrade over a 20 year period. The objective is to minimize the system total lifetime cost regarding: line loss, reliability costs and investment needed in DGs, capacitors, lines, and transformers. The bus voltage, feeder current and the DG output power are incorporated in the optimization procedure as constraints. M.V. Kirthiga et al. in [54] propose a methodology to transform an existing radial distribution network into an autonomous microgrid, in which sizing and siting strategies for distributed generators and structural modifications for autonomous microgrids are developed. The optimal sites and corresponding sizes of renewable resources for autonomous operation are obtained using PSO and GA. An optimization problem for system losses and costs is formulated, considering quality constraints, generators loads and balance.

Regarding microgrids siting problems, some **multi-objective optimization** algorithms are combined with sensitivity analysis. For example, in [55] K. Buayai et al. carry out using MATLAB a two stage multi-objective optimization process for MG planning in two primary distribution systems. In the first stage, loss sensitivity factor is proposed to identify the MG area in a primary distribution system. In the second stage, a Pareto-based NSGA-II is proposed to find locations and sizes of a specified number of distributed generators within microgrids. Multi-objective functions include system real power loss, load voltage deviation and annualized investment cost. A fuzzy decision making analysis is used to obtain the final trade-off optimal solution. Another multi-objective method is proposed by G. Celli et al in [56] to solve sizing and siting problems in distribution networks. The objective is to achieve the best alternative between cost of network upgrading, cost of power losses, cost of energy not supplied, power quality cost and the cost of energy required by the served customers. Using a GA, they apply the  $\mathcal{E}$ -constrained technique to obtain a compromised non-inferior solution.

As it has been described in [56], **heuristics** have also been applied to siting problems. A. Basu et al. selects in [57] bus locations by loss sensitivity analysis. PSO is implemented using MATLAB in order to maximize the value of *benefit to cost ratio* (BCR). Cost of electricity generation is minimized, not only using CHP-based DER technology but also deploying them in the microgrid system regarding their type, capacity-size and bus-location. G. Celli et al. propose in [58] a new software procedure based on a GA, capable to establish the optimal distributed generation allocation on an existing medium voltage (MV) distribution network, considering technical constraints of real size scenarios with several hundreds of nodes. In [59] G. Carpinelli presents a three step procedure, based on GA, applied to establish the best distributed generation siting and sizing on an MV distribution network.

M.R. Vallem et al in [60,61] describe a method for siting of DER within the framework of an optimal microgrid architecture regarding minimum cost interconnection, sizing, and siting of DER subject to stipulated global and local reliability criteria. The siting problem considers factors like deployment costs and savings gained by the use of CHP and it is formulated as a SA optimization problem. An optimal economic and allocation model of an industrial photovoltaic microgrid is proposed in [62] by M. Mao. The economic indexes analysed include energy cost, emission reduction benefits and payback period. The optimization problem is solved using PSO optimization technique. S.Tan considers necessary in [63] to integrate microgrid load dispatch and network reconfiguration together. This results in a non-convex

non-linear problem. Four evolution computational optimization methods have been compared in this paper such as *GA, PSO, AIS and Vaccine-AIS*.

### 3.3. *Operation scheduling: economic load dispatch problem*

The control strategy of each microgrid has a great impact on the energy contribution of the different DGs. The Economic Dispatch Problem is usually solved by mathematical computing techniques and specific computer software. Final scheduling must fulfil system goals in the framework shaped by demand, operational and system constraints of the available resources and corresponding transmission capabilities. In [64] C. Colson and M. Nehrir reviewed microgrid management challenges emphasizing tasks in DER and CHP integration, power management and control as the main fields of development.

A **classical approach** for other energy community systems is presented in [65]. A Combined Cooling and Heating Power model of a rural microgrid is built and optimized by using a MINLP optimization process to improve system efficiency of energy utilization and other goals with a BONMIN solver. The whole system model is mathematically programmed into the platform of GAMS. Again MINLP is used in [66]. C.A. Hernandez-Aramburo et al. try to minimize the fuel consumption rate for a two-generation unit microgrid, while constraining it to fulfil the local energy demand (both electrical and thermal) and provide a certain minimum power reserve. P. Stluka et al. focus in [67] the problem of powering a set of buildings through a microgrid, formulating a cost-minimizing problem. Load forecasting and sitting problems are solved using a MINLP approach with the optimization software VERA.

In fact, as it can be seen in [68] and [69], classical optimization methods such as IP and LP are still a good approach depending on the problem definition, being GAMS a widely used modelling system. In both papers the optimization model for a microgrid based in a CHP generation unit operation is formulated. LP is also used in [70] by D. Quiggin et al. to model a microgrid including a mix of renewable generation technologies, energy storage and DR, based on real world data of residential energy consumption and weather variables.

DP is used to solve optimization problems in [71] by A. Sobu and in [72] by M.Y. Nguyen, et al.. A. Sobu defines a dynamic optimal schedule management method for an isolated or grid-connected microgrid system, considering forecast errors with uncertainties of solar radiation, wind speed and local user demand. Nguyen et al. try to maximize the profit that owner might achieve from energy trading in a day, either in isolated or grid-connected microgrids. C. Huang et al consider tariffs inside the ELD problem in [73]. A power-scheduling problem, solved by a MPDP approach, and considering load/generation changes and TOU tariff for a low voltage DC microgrid is developed.

F. Mohamed and H. Koivo propose in [74–77] different **multiobjective algorithms**, which are also used to determine the optimal operating strategy for a microgrid such as: SQP, GA, and MADS. MADS is a generalization of the pattern search algorithm. The aim of these papers is to minimize the cost function

of the system. Multiobjective optimization based on modified game theory is applied in [76] to the environmental and economic problem of the MG.

T.S. Mahmoud introduces in [78] **fuzzy logic techniques** for storage devices scheduling. A fuzzy logic based adaptive charging price is set for charging the storage device based on the microgrids local generation price at the time of charging, and the amount of daily storage device participation in the microgrid dispatch. A multi-objective PSO method is applied to optimize the energy dispatch for the managed microgrid. H. Kanchev et al. in [79] presents a microgrid energy tactical optimization in the presence of PV-based active generators. The optimization objective function is focused on the CO<sub>2</sub> equivalent emissions (environmental criteria), the fuel consumption (economical criteria) or a trade off between these two. This study is developed using fuzzy logic theories and PSO. Tools as MATLAB, TRNSYS, GenOpt and TRNOPT are proposed to solve this kind of problems [46,86]

T. Niknam et al propose in [82] a probabilistic approach for economic/emission management of microgrids from a **probabilistic optimization method**, including uncertainties covering and a modified multi-objective algorithm based on the MGSA to find Pareto-optimal front of the operation management problem.


**Forecasting** techniques have been introduced in optimization problems due to stochastic nature of demand and renewable energy resources. R.Y. Jaganmohan et al, design in [83] a system that forecasts the short (daily), medium (seasonal) and long term (yearly) load demand and the availability of energy resources at the microgrids. They use ANN feature to forecast both load and availability of energy resources at microgrids in different scenarios like daily, seasonal, and yearly. The layered ANN architecture is developed and trained with Levenberg-Marquardt Back Propagation Algorithm. Other authors use in [84,85] forecasting techniques based on ANN. Although forecasting technique changes from some papers to others, the most common objective of these techniques is to forecast both load and availability of energy resources, as in [86].

In [87] C. Chen et al. propose one unified model so that smart management of ESS, economic load dispatch and operation optimization of distributed generation are simplified into a single-objective optimization problem. They use an improved GA to solve the problem. Same algorithm is used by C. Chansong et al. in [93] to determine an optimal schedule of all available units over a planning horizon so as to meet all system, plant and unit constraints, as well as meet the load and ancillary service demands. An ANN power forecasting is used to predict hourly power outputs. A GA is developed to make good operation and trading decisions while meeting constraints.

S. Obara and E.G. El-Sayed in [89] develop an optimal operation algorithm of a compound microgrid using numerical weather information (NWI) which is freely available and a GA is developed to minimize system fuel consumption. L Ricalde et al. introduce in [90] some forecasting methods depending on temporal range of look-ahead times, and they address ANN as excellent approximations for nonlinear and stochastic models.

Operation of a microgrid with more than two DER units, especially in an autonomous mode, requires an Energy Management System (EMS). Fast response of the EMS is more critical for a microgrid compared with a conventional power system. The real-time management block receives the present and the forecasted values of load, generation, and market information to impose appropriate controls on power flow, output generation, consumption level of the utility grid, dispatchable sources, and controllable loads, respectively, as it is shown in figure 1. An EMS should ensure a set of control function, such as supply of electrical energy, participation in the energy market, pre-specified service level for critical loads, black start subsequent to a failure, provision for ancillary services, and so forth. The objectives are achieved through either a centralized or a decentralized supervisory control that includes three hierarchical levels:

- ✓ distribution network and market operator (PCC Level)
- ✓ local controllers (LCs) associated with each DER unit and/or load
- ✓ Customer level associated to demand-based control strategies

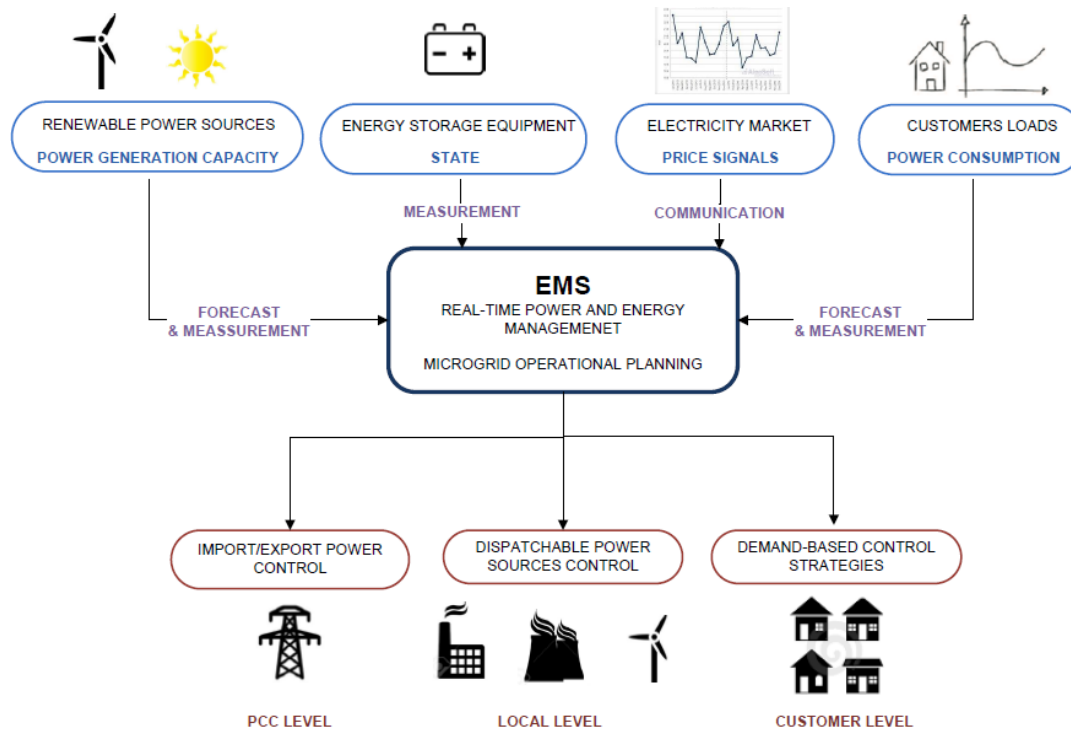

**Figure 1. Energy Management System**

**Trends in microgrid control** have been recently pointed out by D. Olivares et al. in [91]. They also present a brief review of the existing **EMS** architectures for microgrids in [92], identifying the main advantages of each approach, and have proposed a centralized EMS architecture for implementation on isolated microgrids in stand-alone mode of operation. D. Olivares D. y C.A. Cañizares search for a proper dispatch of the energy power and storage units, designing a centralized energy management system in [93]. In this paper, energy management problem is decomposed into unit commitment and optimal power flow problems in order to avoid a mixed-integer non-linear formulation.

**Some authors look for new approaches for power sources scheduling in microgrids.** A calculation method of microgrid surplus load is proposed by M. Chen et al. and the features and influencing factors of its ultra-short-term forecasting are discussed in [94]. A simulation model of microgrid with wind farms, micro-turbines and fuel cells is established. A similar vision of the same problem, including demand side management is introduced by R. Palma-Behnke et al. in [95]. An energy management system (EMS) minimizes the operational costs while supplying the load demands. Also, a neural network method for a two days ahead electric consumption forecasting is presented.

G. Celli et al in [96] develop a novel EMS that uses a Multi Layer Perceptron Neural Network for the optimal scheduling of generators in an industrial park. They train the Neural Network by using information about energy price, weather conditions and the forecasts on the energy and thermal load demand.

H. Kanchev in [97] proposes a deterministic EMS for a microgrid, including advanced PV generators with embedded storage units and a gas microturbine. A. Borghetti describes in [98] the functions of an energy resources scheduler implemented in a microgrid management system. The scheduler periodically updates the set points of DERs regulators in order to achieve economic, reliability and power quality objectives, starting from the load and renewable production forecasts and from the results of the system state estimation.

S. Chakraborty and M.G. Simoes in [99] and in [100], focus on renewable energy sources integration in a distributed generation system, implementing a distributed intelligent EMS to optimize operating costs. A Fuzzy ARTMAP Neural Network is used to predict hourly day-type outputs, based on which generation can be forecasted. Same authors introduce in [101] a Distributed Intelligent Energy Management System (DIEMS) to optimize operating costs of a representative PV-based microgrid.

A probabilistic EMS based on an efficient Point Estimate Method is proposed in [102] by S. Mohammadi. This method models the uncertainty in the power generation of the wind farms and the PV systems, the market prices and the load demands. Moreover, an AMFA is employed to achieve an optimal operational planning with regard to cost minimization. Niknam et al. introduce in [103,104] two different probabilistic algorithms in order to optimize a microgrid operation: a self-adaptive mutation technique of the GSA and a self-adaptive Charged System Search called SCSS, devised to upgrade the original CSS algorithm.

H. Vahedi et al study in [105], the optimal operating strategy and cost optimization scheme using Bacterial Foraging Algorithm (BFA). L. Lu et al. study in [106] propose a class of competitive online algorithms, called CHASE, which tracks the offline optimal in an online fashion. They also extend these algorithms to intelligently leverage on limited prediction of the future, such as near-term demand or wind forecast.

S. Tan et al in [107] search for an integrated solution that takes care of both microgrid load dispatch and network reconfiguration problems. The stochastic nature of wind, PV and load is taken into consideration and the bio-inspired optimization scheme Vaccine-AIS is adopted to solve the problem. A bio-inspired algorithm description is elaborated by S. Binitha and S. Sathya in [21]. In [108] a new bi-level prediction strategy is proposed for short-term load forecasting of microgrids by N. Amjady et al.. They propose a strategy composed of a feature selection technique and a forecast engine (including NN and EA) in the lower level as the forecaster and an enhanced differential evolution algorithm in the upper level for optimizing the performance of the forecaster.

**In order to manage all the aspects that influence a microgrid deployment, the design of multi-agent and energy management systems is proposed by some authors** towards an optimal microgrid control. Multi-agent systems in microgrid applications are review by A. Kulasekera y K. Hemapala in [109]. N. Hatziaargyriou develops in [110] a centralized control for optimizing microgrids operation regarding information exchange, market policies, demand-side bidding and security, and quantifies economical, environmental and operational benefits for centralized controlled-microgrids in [111]. But the same authors have also published some papers about agent-based control for virtual power plants [112] and microgrids [113–116]. They present in a MAS-based control architecture for an islanded microgrid, and compares it with a centralized approach. Along these papers, these authors developed an agent control structure focused in allowing the agents to learn and adapt to the environment based on a reinforcement learning algorithm. Agents should be capable to learn to cooperate between each other and to solve a problem that requires planning for the future in a stochastic environment without the existence of a central controller.

T. Funabashi et al in [117] propose a microgrid control system using multi-agent technologies. In this control system, operation planning is realized based on generation and load forecasting by using ANN and fuzzy systems.

#### 4. Conclusions and future trends

This paper provides an overview of the latest research developments concerning the use of optimization algorithms to aid microgrid planning. Since a general approach to microgrid planning has been developed, economic feasibility has been taken into account along the paper as a key factor. This survey of mathematical methods applied to microgrid planning can be useful for microgrid planners, or even to introduce power system engineers and young researchers in this field. After this review, some conclusions will be presented.



**First of all**, reviewed papers are classified in table 1 regarding the planning problem they try to solve and the optimization approach (classical vs multi-objective optimization). As it has been described in this table, linear optimization can be considered a good approach depending on the objective and constraints. Linear and non-linear problems are faced in technical papers in order to minimize operational costs or initial investment in generators and energy storage devices. Many optimization methods are based on traditional approaches, such as mixed-integer and interval linear-programming, while a growing number of research papers trend to use heuristic optimization. Heuristics, as it is shown in table 2, have become very popular in energy planning and designing problems such as GA, PSO and SA. As a consequence some new bio-inspired heuristics have been recently applied to microgrid planning such as AMFA, BFA, AIS and Vaccine-AIS. **GA and PSO are widely used algorithms for planning purposes in microgrids.** Operation scheduling is the most popular problem regarding economic feasibility issues for microgrids, as it has been summarized in table 3, in which a detailed list of references is presented. Regarding modern mathematical techniques, it can be highlighted that parallel processing has not been deeply explored for microgrid planning purposes.

**The second conclusion** of this review paper is about planning methodology. When reviewing technical literature about community systems planning, some defined problems may appear, as it is shown in figure 2. In this paper four common problems have been identified for an economic feasibility approach to microgrids: *power mix selection, sizing, siting and scheduling*. Most researchers propose techniques to solve these individual problems, but real-world planning problems require wider and deeper approaches. Since microgrid planning problems must be considered in an aggregated way. Planning and feasibility guidelines have been proposed for some specific islanded microgrid scenarios with defined constraints and uncertainties, such as for instance in military campus [118]. But suitable conditions for the long-term success of a commercial microgrid have not been still addressed. The more the real-market restrictions, uncertainties and optimization problems they can address, the better the conditions for a microgrid establishment will be defined. In conclusion, more complete optimization and multi-criteria approaches towards market-oriented solutions are expected to appear, focused not only on newer and better approaches to solve single planning problems, but also to solve global ones.

**Finally, some trends in microgrid planning are described.** Some of these new approaches to planning process may include GIS based techniques [50,55,119,120] and new algorithms associated to optimization, forecast and other microgrid related aspects. Other energy community systems, such as virtual power plants or district heating have many points in common with microgrids. Design and establishment processes of DH systems have been studied for a long time, such as control techniques for VPP. As a consequence, microgrid planning can be faced out using similar techniques. Technical literature previously applied to district heating systems have been considered in this paper. Regarding microgrid distributed control and operation, MAS are a hot topic in microgrids scheduling [64,121–124]. MAS-based systems are having a strong development, linking GIS, forecasting, optimization, risk analysis and decision making methods. They have been addressed to different objectives such as cost effectiveness, reliability, environmental, quality, protection and interaction with other microgrids.

Additional objectives can be considered in microgrids referring to economic feasibility. Microgrids can also be designed for supplying ancillary services. Indeed voltage support, reactive power support, peak load reduction, spinning reserve provision and thermal energy supplying are considered in some papers as [27,30,125]. As aforementioned in section 2 a real microgrid planning process can be described as a multi-objective, constrained, and stochastic optimization problem. That is the reason why sensitivity analysis has been revealed as a critical step in the microgrid planning in order to develop a robust architecture towards economic feasibility. A proposal for a microgrid planning process is presented in figure 2.

As it can be seen in this figure, an additional stage in microgrid planning called *pricing* has been also identified in this review. Pricing stage is the final stage of a commercial microgrid planning process. During this stage, microgrid managers define the final price of energy and ancillary services regarding different operational scenarios, costs and particular pricing policies. This last is out of scope of this review because: it is only applied to commercial microgrids, it is not usually based on optimization techniques, and it is a topic far from technical approach to microgrid planning. Microgrid pricing strategies may be considered in future work.

In authors' opinion, microgrids are destined to become the next electric power system evolution. At the same time, smartcities strategies are designed to integrate, or at least to coordinate different urban systems or urban services. Following this approach, electric power lines can also be used as communication buses and microgrids could be a good test bench not only for smartgrid applications, but also for smartcities system integration. This perspective will also affect the microgrid planning process in a near future.

**Table 1 MG planning problems, methods and references regarding single or multiple objective optimization**

APPROACH	METHOD-ALGORITHM	MAIN PROBLEM	REFERENCES	
<b>SINGLE-OBJECTIVE OPTIMIZATION</b>	MILP	Power generation mix selection and sizing	32, 43, 44	
	Lagrange multipliers-KKT conditions	Power generation mix selection and sizing	35	
	Reduced Gradient Method	Storage devices mix selection and sizing	34	
	MIP		Power generation mix selection and sizing	33, 36
			Storage devices mix selection and sizing	39
	SQP		Siting	51
			Operation scheduling	77
	DP		Siting	50
			Operation scheduling	71, 72
	MINLP		Operation scheduling	65, 66, 67
	IP		Operation scheduling	68
	LP		Operation scheduling	69,70
	MPDP		Operation scheduling	73
	<b>MULTI-OBJECTIVE OPTIMIZATION</b>	NSGA-II	Siting	55
Simulation-accounting		Power generation mix selection and sizing	41, 42, 45, 46, 47, 48	
		Storage devices mix selection and sizing	41	
		Operation scheduling	42, 96, 97, 98, 99, 100, 101, 102	
Game theory		Operation scheduling	76	

**Table 2 MG planning problems, methods and references using heuristic optimization**

<b>HEURISTIC AND METAHEURISTIC OPTIMIZATION</b>	EA	Power generation mix selection and sizing	36
	GA	Power generation mix selection and sizing	37
		Siting	54, 56, 58, 59, 63
		Operation scheduling	75, 88, 89, 90
	SA	Power generation mix selection and sizing	38
		Siting	52, 60, 61
	PSO	Storage devices sizing	40
		Siting	54, 57, 62,63
		Operation scheduling	77, 79
	AIS	Siting	63
	VACCINE-AIS	Siting	63
		Operation scheduling	107
	MDPSO	Siting	53
	MADS	Operation scheduling	74, 78
	MGSA	Operation scheduling	82
	AMFA	Operation scheduling	102
	GSA	Operation scheduling	103
SCSS	Operation scheduling	103	
BFA	Operation scheduling	105	
CHASE	Operation scheduling	106	

**Table 3 References per planning problem and optimization approach**

<b>APPROACH</b>	<b>MAIN PROBLEM</b>	<b>PAPERS</b>
Single objective optimization	Power generation mix selection and sizing	32, 33, 35, 36, 43, 44
	Storage generation mix selection and sizing	34, 39
	Siting	50,51
	Operation scheduling	65, 66, 67, 68, 69, 70, 71, 72, 73, 77
MO optimization	Power generation mix selection and sizing	41, 42, 45, 46, 47, 48
	Storage generation mix selection and sizing	41
	Siting	55
	Operation scheduling	42, 76, 96, 97, 98, 99, 100, 101, 102
Heuristic optimization	Power generation mix selection and sizing	36, 37, 38
	Storage generation mix selection and sizing	40
	Siting	52, 53, 54, 56, 57, 58, 59, 60, 61, 62, 63
	Operation scheduling	74, 77, 78, 79, 82, 102, 103, 105, 106, 107

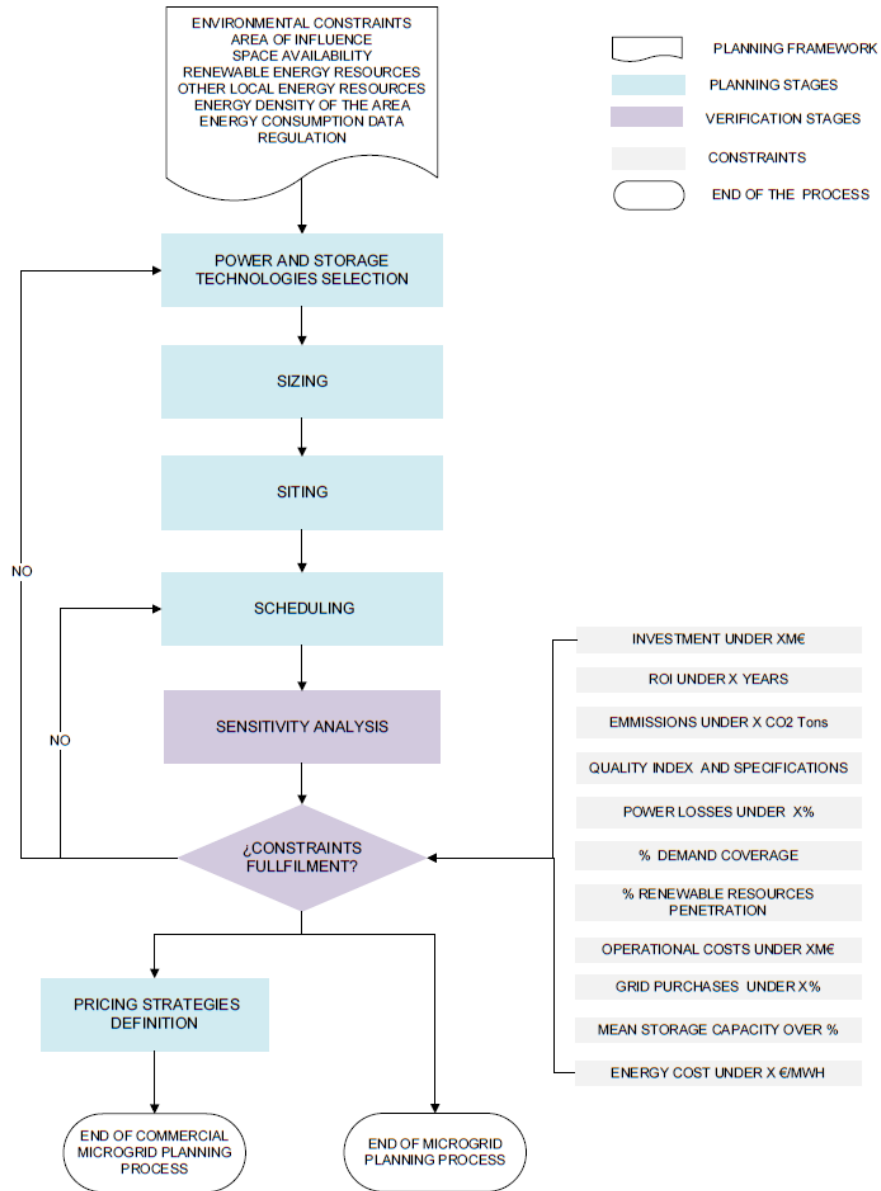


Figure 2. Microgrid planning process scheme

## References

- [1] Ji P, Zhou XX, Wu S. Review on sustainable development of island microgrid. APAP 2011 - Proc. 2011 Int. Conf. Adv. Power Syst. Autom. Prot., vol. 3, 2011, p. 1806–13. doi:10.1109/APAP.2011.6180631.
- [2] Lilienthal P. How to Classify Microgrids: Setting the Stage for a Distributed Generation Energy Future. [Http://blog.homerenergy.com/how-to-Classify-Microgrids-Setting-the-Stage-for-a-Distributed-Generation-Energy-Future/](http://blog.homerenergy.com/how-to-Classify-Microgrids-Setting-the-Stage-for-a-Distributed-Generation-Energy-Future/) n.d. (Last access date 11/03/2015)
- [3] Huang W, Lu M, Zhang L. Survey on Microgrid Control Strategies. Energy Procedia 2011;12:206–12. doi:10.1016/j.egypro.2011.10.029.
- [4] Guerrero JM, Chandorkar M, Lee T, Loh PC. Advanced Control Architectures for Intelligent Microgrids; Part I: Decentralized and Hierarchical Control. Ind Electron IEEE Trans 2013;60:1254–62. doi:10.1109/TIE.2012.2194969.
- [5] French S. Uncertainty and Imprecision: Modeling and Analysis. J Oper Res Soc 1995;46:70–9.
- [6] Stewart TJ. Dealing with Uncertainties in MCDA. Mult Criteria Decis Anal State Art, Surv Int Ser Oper Res Manag Sci 2005;78:445–66.
- [7] Mendes G, Ioakimidis C, Ferrão P. On the planning and analysis of Integrated Community Energy Systems: A review and survey of available tools. Renew Sustain Energy Rev 2011;15:4836–54.
- [8] Connolly D, Lund H, Mathiesen B V, Leahy M. A review of computer tools for analysing the integration of renewable energy into various energy systems. Appl Energy 2010;87:1059–82. doi:10.1016/j.apenergy.2009.09.026.
- [9] Erdinc O, Uzunoglu M. Optimum design of hybrid renewable energy systems: Overview of different approaches. Renew Sustain Energy Rev 2012;16:1412–25. doi:10.1016/j.rser.2011.11.011.
- [10] Baños R, Manzano-Agugliaro F, Montoya FG, Gil C, Alcayde a., Gómez J. Optimization methods applied to renewable and sustainable energy: A review. Renew Sustain Energy Rev 2011;15:1753–66. doi:10.1016/j.rser.2010.12.008.
- [11] Iqbal M, Azam M, Naeem M, Khwaja a. S, Anpalagan a. Optimization classification, algorithms and tools for renewable energy: A review. Renew Sustain Energy Rev 2014;39:640–54. doi:10.1016/j.rser.2014.07.120.
- [12] Sanaei SM, Nakata T. Optimum design of district heating: Application of a novel methodology for improved design of community scale integrated energy systems. Energy 2012;38:190–204.
- [13] Ajah AN, Patil AC, Herder PM, Grievink J. Integrated conceptual design of a robust and reliable waste-heat district heating system. Appl Therm Eng 2007;27:1158–64. doi:10.1016/j.applthermaleng.2006.02.039.
- [14] Chow TT, Chan ALS, Song CL. Building-mix optimization in district-cooling system implementation. Appl Energy 2004;77:1–13.
- [15] Bando S, Matsuzaki K, Asano H, Yanai T, Sasajima K-I, Kinoshita M, et al. Feasibility study of network-based energy use among multiple district heating and cooling areas - Report i - Scheme development of profitability analysis of a microgrid consisting of multiple district heating and cooling areas. Nihon Enerugi Gakkaishi/Journal Japan Inst Energy 2010;89:658–64.
- [16] Diwerak U. Introduction to applied optimization. 2nd ed. Springer; 2008.
- [17] Nocedal J, Wright SJ. Numerical optimization. 2nd editio. Springer; 2006.
- [18] Fouskakis D, Draper D. Stochastic Optimization: a Review. Int Stat Rev 2002;70:315–49. doi:10.1111/j.1751-5823.2002.tb00174.x.

- [19] Bianchi L, Dorigo M, Gambardella LM, Gutjahr WJ. A survey on metaheuristics for stochastic combinatorial optimization. *Nat Comput* 2008;8:239–87. doi:10.1007/s11047-008-9098-4.
- [20] Kogan K, Nikolenko S, Keshav S, Lopez-Ortiz A. Efficient demand assignment in multi-connected microgrids with a shared central grid. 2013 *Sustain. Internet ICT Sustain. Sustain.* 2013, 2013. doi:10.1109/SustainIT.2013.6685197.
- [21] Binitha S, Sathya S. A survey of bio inspired optimization algorithms. *Int J Soft Comput Eng* 2012;2:137–51.
- [22] Rueda-Medina AC, Padilha-Feltrin A. Pricing of reactive power support provided by distributed generators in transmission systems. 2011 *IEEE Trondheim PowerTech, IEEE*; 2011, p. 1–7. doi:10.1109/PTC.2011.6019300.
- [23] Paschalidis IC, Li B, Caramanis MC. Demand-side management for regulation service provisioning through internal pricing. *IEEE Trans Power Syst* 2012;27:1531–9.
- [24] Paschalidis IC, Li B, Caramanis MC. A market-based mechanism for providing demand-side regulation service reserves. *IEEE Conf. Decis. Control Eur. Control Conf., IEEE*; 2011, p. 21–6. doi:10.1109/CDC.2011.6160541.
- [25] Kanchev H, Francois B, Lazarov V. Unit commitment by dynamic programming for microgrid operational planning optimization and emission reduction. *Int. Aegean Conf. Electr. Mach. Power Electron. ACEMP 2011 Electromotion 2011 Jt. Conf., 2013*, p. 502–7. doi:10.1109/ACEMP.2011.6490650.
- [26] St<sup>o</sup> M, Berka J. Microgrid Energy Management based on Approximate Dynamic Programming. 4th *IEEE PES Innov Smart Grid Technol Eur (ISGT Eur 2013:1–5*. doi:10.1109/ISGTEurope.2013.6695439.
- [27] Asano H, Bando S. Economic evaluation of microgrids. *IEEE Power Energy Soc. 2008 Gen. Meet. Convers. Deliv. Electr. Energy 21st Century, PES, IEEE*: 2008.
- [28] Asano H, Bando S. Optimization of a microgrid investment and operation: Energy saving effects and feasibility of ancillary service provision. *Transm. Distrib. Conf. Expo. Asia Pacific, T D Asia 2009, Central Research Institute of Electric Power Industry, University of Tokyo, 2-11-1 Iwadokita, Komae-Shi, Tokyo, Japan*: 2009.
- [29] Asano H, Watanabe H, Bando S. Methodology to design the capacity of a microgrid. 2007 *IEEE Int. Conf. Syst. Syst. Eng. SOSE, Department of Mechanical Engineering, University of Tokyo, Tokyo, Japan*: 2007.
- [30] Morris GY, Abbey C, Wong S, Joos G. Evaluation of the costs and benefits of Microgrids with consideration of services beyond energy supply. 2012 *IEEE Power Energy Soc. Gen. Meet., IEEE*; 2012, p. 1–9. doi:10.1109/PESGM.2012.6345380.
- [31] Nishikawa K, Baba J, Shimoda E, Kikuchi T, Itoh Y, Nitta T, et al. Design methods and integrated control for microgrid. 2008 *IEEE Power Energy Soc. Gen. Meet. - Convers. Deliv. Electr. Energy 21st Century, IEEE*; 2008, p. 1–7. doi:10.1109/PES.2008.4596065.
- [32] Chen SX, Gooi HB, Wang MQ. Sizing of energy storage for microgrids. *IEEE Trans Smart Grid* 2012;3:142–51.
- [33] Vafaei M, Kazerani M. Optimal unit-sizing of a wind-hydrogen-diesel microgrid system for a remote community. 2011 *IEEE Trondheim PowerTech, IEEE*; 2011, p. 1–7. doi:10.1109/PTC.2011.6019412.
- [34] Augustine N, Suresh S. Economic dispatch for a microgrid considering renewable energy cost functions. *Innov Smart Grid ...* 2012:1–7.
- [35] Han Y, Young P, Zimmerle D. Optimal selection of generators in a microgrid for fuel usage minimization. 2013 *IEEE Power Energy Soc. Gen. Meet., IEEE*; 2013, p. 1–5. doi:10.1109/PESMG.2013.6672746.



- [36] Logenthiran T, Srinivasan D, Khambadkone AM, Sundar Raj T. Optimal sizing of an islanded microgrid using Evolutionary Strategy. 2010 IEEE 11th Int. Conf. Probabilistic Methods Appl. to Power Syst., IEEE; 2010, p. 12–7. doi:10.1109/PMAPS.2010.5528840.
- [37] Tafreshi SMM, Zamani HA, Ezzati SM, Baghdadi M, Vahedi H. Optimal unit sizing of Distributed Energy Resources in MicroGrid using genetic algorithm. 2010 18th Iran. Conf. Electr. Eng., IEEE; 2010, p. 836–41. doi:10.1109/IRANIANCEE.2010.5506961.
- [38] Yang Y, Pei W, Qi Z. Optimal sizing of renewable energy and CHP hybrid energy microgrid system. IEEE PES Innov. Smart Grid Technol., IEEE; 2012, p. 1–5. doi:10.1109/ISGT-Asia.2012.6303122.
- [39] Bahramirad S, Reder W, Khodaei A. Reliability-Constrained Optimal Sizing of Energy Storage System in a Microgrid. IEEE Trans Smart Grid 2012;3:2056–62. doi:10.1109/TSG.2012.2217991.
- [40] Navaeefard A, Tafreshi SMM, Barzegari M, Shahrood AJ. Optimal sizing of distributed energy resources in microgrid considering wind energy uncertainty with respect to reliability. 2010 IEEE Int Energy Conf 2010:820–5. doi:10.1109/ENERGYCON.2010.5771795.
- [41] Menniti D. A method to improve microgrid reliability by optimal sizing PV/Wind plants and storage systems. CIRED 2009. 20th Int. Conf. Exhib. Electr. Distrib., 2009, p. 1–4.
- [42] Farahmand F, Khandelwal T, Dai JJ, Shokoo F. An enterprise approach to the interactive objectives and constraints of Smart Grids. 2011 IEEE PES Conf. Innov. Smart Grid Technol. - Middle East, ISGT Middle East 2011, 2011, p. 1–6. doi:10.1109/ISGT-MidEast.2011.6220790.
- [43] Litchy A, Young C, Pourmousavi SA, Nehrir MH. Technology selection and unit sizing for a combined heat and power microgrid: Comparison of WebOpt and HOMER application programs. 2012 North Am. Power Symp., IEEE; 2012, p. 1–6. doi:10.1109/NAPS.2012.6336337.
- [44] Marnay C, Venkataramanan G, Stadler M, Siddiqui AS, Firestone R, Chandran B. Optimal technology selection and operation of commercial-building microgrids. IEEE Trans Power Syst 2008;23:975–82.
- [45] Nayar C, Tang M, Suponthana W. Wind/PV/diesel micro grid system implemented in remote islands in the Republic of Maldives. ... Energy Technol. 2008 ..., 2008, p. 1076–80.
- [46] Fan Y, Rimali V, Tang M, Nayar C. Design and Implementation of stand-alone smart grid employing renewable energy resources on Pulau Ubin Island of Singapore. 2012 Asia-Pacific Symp Electromagn Compat 2012:441–4. doi:10.1109/APEMC.2012.6237907.
- [47] Kumaravel S, Ashok S, Balamurugan P. Techno-economic feasibility study of biomass based hybrid renewable energy system for microgrid application. 2012 Int Conf Green Technol 2012:107–10. doi:10.1109/ICGT.2012.6477956.
- [48] Su W, Yuan Z, Chow M-Y. Microgrid planning and operation: Solar energy and wind energy. IEEE PES Gen. Meet. PES 2010, Department of Electrical and Computer Engineering, North Carolina State University, Raleigh, NC 27606, United States: 2010.
- [49] Verda V, Ciano C. Procedures for the search of the optimal configuration of district heating networks. Int J Thermodyn 2005;8:143–53.
- [50] Cui Q, Shu J, Zhang X, Zhou Q. The application of improved BP neural network for power load forecasting in the island microgrid system. 2011 Int. Conf. Electr. Control Eng., vol. 3, IEEE; 2011, p. 6138–41. doi:10.1109/ICECENG.2011.6058239.
- [51] Khodaei A, Shahidehpour M. Microgrid-Based Co-Optimization of Generation and Transmission Planning in Power Systems 2012:1–9.
- [52] Verda V, Ciano C. Procedures for the Search of the Optimal Configuration of District Heating Networks 2005;8:143–53.

- [53] Wishart MT, Dewadasa M, Ziari I, Ledwich G, Ghosh A. Intelligent distribution planning and control incorporating microgrids. IEEE Power Energy Soc. Gen. Meet., Queensland University of Technology, Brisbane, QLD, Australia: 2011.
- [54] Kirthiga MV, Daniel SA, Gurunathan S. A Methodology for Transforming an Existing Distribution Network Into a Sustainable Autonomous Micro-Grid. IEEE Trans Sustain Energy 2013;4:31–41. doi:10.1109/TSTE.2012.2196771.
- [55] Buayai K, Ongsakul W, Mithulanathan N. Multi-objective micro-grid planning by NSGA-II in primary distribution system. Eur Trans Electr Power 2012;22:170–87.
- [56] Celli G, Ghiani E, Mocci S, Pilo F. A multi-objective formulation for the optimal sizing and siting of embedded generation in distribution networks. 2003 IEEE Bol Power Tech Conf Proceedings, 2003;1:67–74. doi:10.1109/PTC.2003.1304113.
- [57] Basu A, Chowdhury S, Chowdhury SP. Strategic deployment of CHP-based distributed energy resources in microgrids. 2009 IEEE Power Energy Soc. Gen. Meet., IEEE; 2009, p. 1–6. doi:10.1109/PES.2009.5275186.
- [58] Celli G, Pilo F. Optimal distributed generation allocation in MV distribution networks. Pica 2001 Innov Comput Power - Electr Energy Meets Mark 22nd IEEE Power Eng Soc Int Conf Power Ind Comput Appl (Cat No01CH37195) 2001:81–6. doi:10.1109/PICA.2001.932323.
- [59] Carpinelli G, Celli G, Pilo F, Russo A. Distributed Generation siting and sizing under uncertainty. 2001 IEEE Porto Power Tech Proc., vol. 4, 2001, p. 335–41. doi:10.1109/PTC.2001.964856.
- [60] Vallem MR, Mitra J. Siting and sizing of distributed generation for optimal microgrid architecture. Proc. 37th Annu. North Am. Power Symp. 2005, vol. 2005, IEEE: 2005, p. 611–6.
- [61] Vallem M, Mitra J, Patra S. Distributed Generation Placement for Optimal Microgrid Architecture. 2005/2006 IEEE PES TD, IEEE; 2006, p. 1191–5. doi:10.1109/TDC.2006.1668674.
- [62] Mao M, Jin P, Zhao Y, Chen F, Chang L. Optimal allocation and economic evaluation for industrial PV microgrid. 2013 IEEE Energy Convers Congr Expo 2013:4595–602. doi:10.1109/ECCE.2013.6647316.
- [63] Tan S, Xu J-X, Panda SK. Optimization of Distribution Network Incorporating Distributed Generators: An Integrated Approach. IEEE Trans Power Syst 2013;28:2421–32. doi:10.1109/TPWRS.2013.2253564.
- [64] Colson C, Nehrir M. A review of challenges to real-time power management of microgrids. 2009 IEEE Power Energy Soc. Gen. Meet., IEEE; 2009, p. 1–8. doi:10.1109/PES.2009.5275343.
- [65] Zhang X, Sharma R. Optimal energy management of a rural microgrid system using multi-objective optimization. 2012 IEEE PES Innov. Smart Grid Technol., IEEE; 2012, p. 1–8. doi:10.1109/ISGT.2012.6175655.
- [66] Hernandez-Aramburo C a., Green TC, Mugniot N. Fuel Consumption Minimization of a Microgrid. IEEE Trans Ind Appl 2005;41:673–81. doi:10.1109/TIA.2005.847277.
- [67] Stluka P, Godbole D, Samad T. Energy management for buildings and microgrids. Proc. IEEE Conf. Decis. Control, 2011, p. 5150–7. doi:10.1109/CDC.2011.6161051.
- [68] Chen Y-H, Lu S-Y, Chang Y-R, Lee T-T, Hu M-C. Economic analysis and optimal energy management models for microgrid systems: A case study in Taiwan. Appl Energy 2013;103:145–54. doi:10.1016/j.apenergy.2012.09.023.
- [69] Majic L, Krzelj I, Delimar M. Optimal scheduling of a CHP system with energy storage. 36th Int. Conv. Inf. Commun. Technol. Electron. Microelectron., 2013, p. 1253–7.
- [70] Quiggin D, Cornell S, Tierney M, Buswell R. A simulation and optimisation study: Towards a decentralised microgrid, using real world fluctuation data. Energy 2012;41:549–59. doi:10.1016/j.energy.2012.02.007.

- [71] Sobu A. Dynamic optimal schedule management method for microgrid system considering forecast errors of renewable power generations. 2012 IEEE Int. Conf. Power Syst. Technol., IEEE; 2012, p. 1–6. doi:10.1109/PowerCon.2012.6401287.
- [72] Nguyen MY, Yoon YT, Choi NH. Dynamic programming formulation of Micro-Grid operation with heat and electricity constraints. 2009 Transm Distrib Conf Expo Asia Pacific 2009:1–4. doi:10.1109/TD-ASIA.2009.5356870.
- [73] Huang CC, Chen MJ, Liao YT, Lu CN. DC microgrid operation planning. 2012 Int. Conf. Renew. Energy Res. Appl. ICRERA 2012, 2012. doi:10.1109/ICRERA.2012.6477447.
- [74] Mohamed F a., Koivo HN. Multiobjective optimization using Mesh Adaptive Direct Search for power dispatch problem of microgrid. Int J Electr Power Energy Syst 2012;42:728–35. doi:10.1016/j.ijepes.2011.09.006.
- [75] Mohamed F, Koivo H. Multiobjective Genetic Algorithms for Online Management Problem of Microgrid. Int Rev Electr Eng 2008.
- [76] Mohamed FA, Koivo HN. Multiobjective optimization using modified game theory for online management of microgrid. Eur Trans Electr Power 2011;21:839–54. doi:10.1002/etep.480.
- [77] Mohamed F a., Koivo HN. System modelling and online optimal management of MicroGrid using Mesh Adaptive Direct Search. Int J Electr Power Energy Syst 2010;32:398–407. doi:10.1016/j.ijepes.2009.11.003.
- [78] Mahmoud TS, Habibi D, Bass O. Fuzzy logic for smart utilisation of Storage Devices in a typical microgrid. 2012 Int Conf Renew Energy Res Appl 2012:1–6. doi:10.1109/ICRERA.2012.6477333.
- [79] Kanchev H, Lazarov V, Francois B. Environmental and economical optimization of microgrid long term operational planning including PV-based active generators 2012:1–8.
- [80] Kyriakarakos G, Dounis AI, Arvanitis KG, Papadakis G. A fuzzy logic energy management system for polygeneration microgrids. Renew Energy 2012;41:315–27.
- [81] Manfren M, Caputo P, Costa G. Paradigm shift in urban energy systems through distributed generation: Methods and models. Appl Energy 2011;88:1032–48. doi:10.1016/j.apenergy.2010.10.018.
- [82] Niknam T, Golestaneh F, Reza A. Probabilistic model of polymer exchange fuel cell power plants for hydrogen , thermal and electrical energy management. J Power Sources 2013;229:285–98. doi:10.1016/j.jpowsour.2012.11.052.
- [83] Jaganmohan Reddy Y, Pavan Kumar Y V, Sunil Kumar V, Padma Raju K. Distributed ANNs in a layered architecture for energy management and maintenance scheduling of renewable energy HPS microgrids. 2012 Int. Conf. Adv. Power Convers. Energy Technol., IEEE; 2012, p. 1–6. doi:10.1109/APCET.2012.6302067.
- [84] Chaouachi A, Kamel R, Nagasaka K. Neural Network Ensemble-based Solar Power Generation Short-Term Forecasting. J Adv Comput Intell Informatics 2010;1:69–75.
- [85] Cui Q, Shu J, Zhang X, Zhou Q. The application of improved BP neural network for power load forecasting in the island microgrid system. 2011 Int. Conf. Electr. Control Eng., 2011, p. 6138–41.
- [86] Tan S, Xu J-X, Panda SK. Optimization of Distribution Network Incorporating Distributed Generators: An Integrated Approach. IEEE Trans Power Syst 2013;28:2421–32. doi:10.1109/TPWRS.2013.2253564.
- [87] Chen C, Duan S, Cai T, Liu B. Microgrid energy management model based on improved genetic arithmetic. Trans China Electrotech Soc 2013;28:196–201.

- [88] Changsong C, Shanxu D, Tao C, Bangyin L, Jinjun Y. Energy trading model for optimal microgrid scheduling based on genetic algorithm. 2009 IEEE 6th Int Power Electron Motion Control Conf 2009;3:2136–9. doi:10.1109/IPEMC.2009.5157753.
- [89] Obara S -y., El-Sayed AG. Compound microgrid installation operation planning of a PEFC and photovoltaics with prediction of electricity production using GA and numerical weather information. *Int J Hydrogen Energy* 2009;34:8213–22.
- [90] Ricalde L, Cruz B, Catzin G. Forecasting for smart grid applications with Higher Order Neural Networks. *World Autom. Congr.*, 2012, p. 1–6.
- [91] Olivares DE, Mehrizi-Sani A, Etemadi AH, Cañizares CA, Iravani R, Kazerani M, et al. Trends in microgrid control. *IEEE Trans Smart Grid* 2014;5:1905–19. doi:10.1109/TSG.2013.2295514.
- [92] Olivares DE, Cañizares CA, Kazerani M. A centralized optimal energy management system for microgrids. *IEEE Power Energy Soc. Gen. Meet.*, 2011, p. 1–6. doi:10.1109/PES.2011.6039527.
- [93] Olivares DE, Canizares CA, Kazerani M. A centralized energy management system for isolated microgrids. *IEEE Trans Smart Grid* 2014;5:1864–75. doi:10.1109/TSG.2013.2294187.
- [94] Chen M, Zhu B, Xu R, Xu X. Ultra-short-term forecasting of microgrid surplus load based on hybrid intelligence techniques. *Electr Power Autom Equip* 2012;32:13–8.
- [95] Palma-Behnke R, Benavides C, Aranda E, Llanos J, Sáez D. Energy management system for a renewable based microgrid with a demand side management mechanism. *IEEE Symp. Comput. Intell. Appl. Smart Grid*, 2011, p. 131–8. doi:10.1109/CIASG.2011.5953338.
- [96] Celli G, Pilo F, Pisano G, Soma GG. Optimal participation of a microgrid to the energy market with an intelligent EMS. 2005 *Int. Power Eng. Conf.*, IEEE; 2005, p. 663–8 Vol. 2. doi:10.1109/IPEC.2005.206991.
- [97] Kanchev H, Lu D, Colas F, Lazarov V, Francois B. Energy management and operational planning of a microgrid with a PV based active generator for smart grid applications. *IEEE Trans Ind Electron* 2011;58:4583–92.
- [98] Borghetti A, Bosetti M, Bossi C, Massucco S, Micolano E, Morini A, et al. An energy resource scheduler implemented in the automatic management system of a microgrid test facility. 2007 *Int. Conf. Clean Electr. Power, ICCEP '07*, 2007, p. 94–100.
- [99] Chakraborty S, Weiss MD, Simões MG. Distributed intelligent energy management system for a single-phase high-frequency AC microgrid. *IEEE Trans Ind Electron* 2007;54:97–109.
- [100] Chakraborty S, Simões MG. Fuzzy ARTMAP based forecast of renewable generation for a high frequency AC microgrid. *IECON Proc. (Industrial Electron. Conf.)*, 2005, p. 762–7.
- [101] Chakraborty S, Simoes MG. PV microgrid operational cost minimization by neural forecasting and heuristic optimization\_2008\_Conference-Record---. *IAS Annu. Meet. (IEEE Ind. Appl. Soc.)*, 2008. doi:10.1109/08IAS.2008.147.
- [102] Mohammadi S, Mozafari B, Solimani S, Niknam T. An Adaptive Modified Firefly Optimisation Algorithm based on Hong's Point Estimate Method to optimal operation management in a microgrid with consideration of uncertainties. *Energy* 2013;51:339–48. doi:10.1016/j.energy.2012.12.013.
- [103] Niknam T, Golestaneh F, Malekpour A. Probabilistic energy and operation management of a microgrid containing wind/photovoltaic/fuel cell generation and energy storage devices based on point estimate method and self-adaptive gravitational search algorithm. *Energy* 2012;43:427–37. doi:10.1016/j.energy.2012.03.064.

- [104] Niknam T, Golestaneh F, Shafiei M. Probabilistic energy management of a renewable microgrid with hydrogen storage using self-adaptive charge search algorithm. *Energy* 2013;49:252–67. doi:10.1016/j.energy.2012.09.055.
- [105] Noroozian R, Vahedi H. Optimal management of MicroGrid using bacterial foraging algorithm. *Proc. - 2010 18th Iran. Conf. Electr. Eng. ICEE 2010*, vol. 5, 2010, p. 895–900. doi:10.1109/IRANIANCEE.2010.5506951.
- [106] Lu L, Tu J, Chau C-K, Chen M, Lin X. Online energy generation scheduling for microgrids with intermittent energy sources and co-generation. *Proc ACM ...* 2013;41:53–66.
- [107] Tan S, Xu J, Panda SK. Optimization of distribution network incorporating microgrid using vaccine-AIS. *IECON 2012 - 38th Annu. Conf. IEEE Ind. Electron. Soc., IEEE; 2012*, p. 1381–6. doi:10.1109/IECON.2012.6388539.
- [108] Amjady N, Keynia F, Zareipour H. Short-term load forecast of microgrids by a new bilevel prediction strategy. *IEEE Trans Smart Grid* 2010;1:286–94.
- [109] Kulasekera AL, Gopura RARC, Hemapala KTMU, Perera N. A review on multi-agent systems in microgrid applications. *2011 IEEE PES Int. Conf. Innov. Smart Grid Technol. ISGT India 2011*, 2011, p. 173–7. doi:10.1109/ISGT-India.2011.6145377.
- [110] Tsikalakis AG, Hatziargyriou ND. Centralized control for optimizing microgrids operation. *IEEE Trans Energy Convers* 2008;23:241–8. doi:10.1109/TEC.2007.914686.
- [111] Hatziargyriou ND, Anastasiadis AG, Vasiljevska J, Tsikalakis AG. Quantification of economic, environmental and operational benefits of microgrids. *2009 IEEE Bucharest PowerTech Innov. Ideas Toward. Electr. Grid Futur.*, 2009, p. 1–8. doi:10.1109/PTC.2009.5281860.
- [112] Dimeas A, Hatziargyriou N. Agent based control of Virtual Power Plants. *2007 Int Conf Intell Syst Appl to Power Syst 2007*. doi:10.1109/ISAP.2007.4441671.
- [113] Dimeas A, Hatziargyriou N. Multi-agent reinforcement learning for microgrids. *Power Energy Soc Gen Meet 2010 IEEE 2010*:1–8. doi:10.1109/PES.2010.5589633.
- [114] Dimeas AL, Hatziargyriou ND. Operation of a multiagent system for microgrid control. *IEEE Trans Power Syst* 2005;20:1447–55. doi:10.1109/TPWRS.2005.852060.
- [115] Dimeas a. L, Hatzivasiliadis SI, Hatziargyriou ND. Control agents for enabling customer-driven microgrids. *2009 IEEE Power Energy Soc Gen Meet 2009*:1–7. doi:10.1109/PES.2009.5275335.
- [116] Dimeas AL, Hatziargyriou ND, Member S. Agent based Control for Microgrids. *Power Eng. Soc. Gen. Meet. 2007. IEEE, 2007*, p. 1–5.
- [117] Funabashi T, Fujita G, Koyanagi K, Yokoyama R. Field tests of a microgrid control system. *41st Int. Univ. Power Eng. Conf. UPEC 2006*, 2006, p. 232–6. doi:10.1109/UPEC.2006.367750.
- [118] Rahman S. Feasibility and Guidelines for the Development of Microgrids in Campus-Type Facilities. *Arlintong*: 2012.
- [119] Joaquin MSJ, Carlos RP. Model of application of distributed generation in Colombia rural zones. *Proc. IEEE Power Eng. Soc. Transm. Distrib. Conf.*, 2012. doi:10.1109/TDC.2012.6281445.
- [120] Quijano R, Domínguez J. Diseño de un proyecto integrado para la planificación energética y el desarrollo regional de las energías renovables en Colombia basado en sistemas de información geográfica. *Tecnol La Inf Geográfica Para El Desarro Territ* 2008:729–36.
- [121] Maity I, Rao S. Simulation and pricing mechanism analysis of a solar-powered electrical microgrid. *Syst Journal, IEEE* 2010;4:275–84. doi:10.1109/JSYST.2010.2059110.

- [122] Hartono BS, Budiyanto, Setiabudy R. Review of microgrid technology. 2013 Int. Conf. QiR, IEEE; 2013, p. 127–32. doi:10.1109/QiR.2013.6632550.
- [123] Darvishi a., Alimardani a., Abdi B. Optimized Fuzzy Control Algorithm in Integration of Energy Storage in Distribution Grids. Energy Procedia 2011;12:951–7. doi:10.1016/j.egypro.2011.10.125.
- [124] Wang Z, Paranjape R, Sadanand A, Chen Z. Residential demand response: An overview of recent simulation and modeling applications. 2013 26th IEEE Can. Conf. Electr. Comput. Eng., IEEE; 2013, p. 1–6. doi:10.1109/CCECE.2013.6567828.
- [125] Asano H, Ariki W, Bando S. Value of investment in a microgrid under uncertainty in the fuel price. IEEE PES Gen. Meet. PES 2010, Central Research Institute of Electric Power Industry, 2-11-1 Iwadokita, Komae-Shi, Tokyo, Japan: 2010.