



Aalborg Universitet

AALBORG UNIVERSITY  
DENMARK

## Decentralized Adaptive Overcurrent Protection for Medium Voltage Maritime Power Systems

Ciontea, Catalin-Iosif; Bak, Claus Leth; Blåbjerg, Frede; Madsen, Kjeld Kilsgaard; Sterregaard, Claes Høll

*Published in:*

Proceedings of the IEEE PES Asia-Pacific Power and Energy Engineering Conference (APPEEC), 2016

*DOI (link to publication from Publisher):*

[10.1109/APPEEC.2016.7779952](https://doi.org/10.1109/APPEEC.2016.7779952)

*Publication date:*

2016

*Document Version*

Early version, also known as pre-print

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*

Ciontea, C.-I., Bak, C. L., Blaabjerg, F., Madsen, K. K., & Sterregaard, C. H. (2016). Decentralized Adaptive Overcurrent Protection for Medium Voltage Maritime Power Systems. In Proceedings of the IEEE PES Asia-Pacific Power and Energy Engineering Conference (APPEEC), 2016 IEEE Press. <https://doi.org/10.1109/APPEEC.2016.7779952>

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- ? Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- ? You may not further distribute the material or use it for any profit-making activity or commercial gain
- ? You may freely distribute the URL identifying the publication in the public portal ?

### Take down policy

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

# Decentralized Adaptive Overcurrent Protection for Medium Voltage Maritime Power Systems

Catalin Iosif Ciontea, Claus Leth Bak,  
Frede Blaabjerg  
Department of Energy Technology  
Aalborg University  
Aalborg, DENMARK

Catalin Iosif Ciontea, Kjeld Kilsgaard Madsen,  
Claes Høll Sterregaard  
Department of Research and Development  
DEIF A/S  
Skive, DENMARK

**Abstract** — more and more maritime applications as marine vessels and offshore platforms need an adaptive protection power system. However, the adaptive protection is yet to be implemented in the maritime sector. Usually, the adaptive protection implies the existence of a central control unit that monitors the entire electrical network and changes the relay settings accordingly, but this approach is not adequate for the maritime power systems. This paper propose a decentralized adaptive protection method, where each protection relay is able to identify by itself the network status without the need of a central control unit. The new adaptive protection method is based on communication between the overcurrent relays and the equipment that could affect the protection system, such as circuit breakers and generators. Using PSCAD, the proposed method is implemented in a test medium voltage maritime power system that possess some of the characteristics of the maritime applications, as variable generation and network reconfiguration.

**Index Terms** — adaptive protection, inter-tripping, maritime applications, overcurrent characteristic, protective relays.

## I. INTRODUCTION

A set of specific characteristics of the maritime power systems differentiate them from the conventional land based distribution networks. These characteristics are discussed in [1], alongside with the challenges of the protection system in the maritime sector. In brief, the maritime power systems are islanded distribution networks with a radial structure and protected manly by OverCurrent (OC) relays [1]. Security of supply during the fault conditions is achieved by utilization of several distributed generators connected at different bus bars and by reconfiguration of the distribution network so that a load can be powered using various electric paths [1]. However, these features of the power network challenge the protection system, as the fault itself depends on system conditions, thus affecting the fault current seen by the OC relays. Therefore, the maritime applications need a protection system that is adaptive to the network conditions.

The adaptive protection techniques, characterized by online adjustment of the protective relays settings according to

network topology and conditions have become more and more popular in the recent years [2]. Several studies proposed different approaches for implementation of an adaptive protection system in different networks in order to solve the protection issues [2]. Authors in [3] suggest utilization of an adaptive protection solution based on communication between a central control unit and the protective relays, where the central control unit monitors the network status and update the relays settings accordingly. However, a central control unit represents a critical point in a network, as its failure may cause problems to the entire adaptive protection system [2]. In addition, the existence of a possible single point of failure is not acceptable in the maritime applications [1]. Other authors suggest an adaptive protection solution where each relay locally detects the network status and based on this information, it selects the appropriate settings [4]. In this way, any problem with a protective relay is limited to that relay only [4]. Nonetheless, this method still needs a communication channel between the component relays and an increased computational power for them. Authors in [5] propose a zonal approach, where a zonal control unit coordinates the relays from its zone. The zone is defined in such way that any modification within its limits require a change of settings only for the protective relays from the affected zone. However, according to [2], this solution is not suitable for the power systems with a reconfigurable topology, including the maritime applications.

The key feature of any adaptive protection system is the ability to acquire relevant information for protection purposes from the electric network and based on it to adjust the relays settings. This feature is possible through communication, but an increased communication burden is a major drawback for any type of protection [2]. Moreover, the communication infrastructure needs to be economically feasible, while the overall protection system needs to be simple and reliable [1].

This paper proposes a decentralized adaptive protection solution based on communication between different relays, Circuit Breakers (CBs) and power generators. Implementation of such communication infrastructure is feasible in the maritime power systems due to the short distance between the

equipment [1]. Moreover, the communication capabilities exist anyway for control purposes in some applications. Only the protection concept is discussed in this paper, while the technical details regarding the communication are not approached. The proposed protection method targets the Medium Voltage (MV) maritime power systems and it is implemented in a test network using PSCAD. In this paper only the 3-phase faults are considered, but the proposed concept is applicable for other types of phase faults as well.

The remainder of this paper is structured as follows. Section II describes the structure and modeling of the test MV maritime network. The proposed protection methodology is explained in details in Section III. Simulation results are presented in Section IV, while Section V concludes this paper.

## II. DESCRIPTION OF THE MV MARITIME POWER SYSTEM

Fig. 1 illustrates a MV maritime power network in which the proposed adaptive protection solution is tested. It consists of 7 bus bars powered by 3 main diesel generators, represented  $G_1$ ,  $G_2$  and  $G_3$ . Each bus bar feeds a load and the loads connected to  $Bus3$ ,  $Bus5$ ,  $Bus7$  can also be fed by the emergency generator  $G_4$ , if needed. Each generator is able to perform a synchronization operation with the rest of the network. Fig. 1 does not show the electric loads, as well as other components, in order to avoid over-congestion of the diagram. The bus bars are interconnected through several feeders. A feeder consist of a cable, denoted  $L_{xy}$ , where  $x, y$  are the indicators of the interconnected bus bars, a transformer for some feeders, represented  $Tr.x$  and 2 CBs at the both ends of the feeder. Only  $CB_{12}$ ,  $CB_{45}$ ,  $CB_{74}$  and  $CB_{75}$  are shown in Fig. 1 as they are used for the network reconfiguration.

The standard models available in PSCAD for the internal combustion engine and synchronous machine are used to model the diesel generators based on the parameters given in TABLE I. The power transformers are also modeled using the standard models available in PSCAD based on the parameters given in TABLE II. The electric cables are modeled using the  $\pi$ -model and the electric loads are modeled as constant impedances. TABLE III and TABLE IV give the cables data and the consumed power at the rated voltage for each load.

As mentioned previously, some CBs are used not only to disconnect a faulted section from the rest of the network, but also to reconfigure the power system. For example,  $CB_{45}$  allows the power transfer from  $Bus4$  to  $Bus5$  or opposite, if needed. However,  $CB_{45}$  never closes as long as both  $Bus4$  and

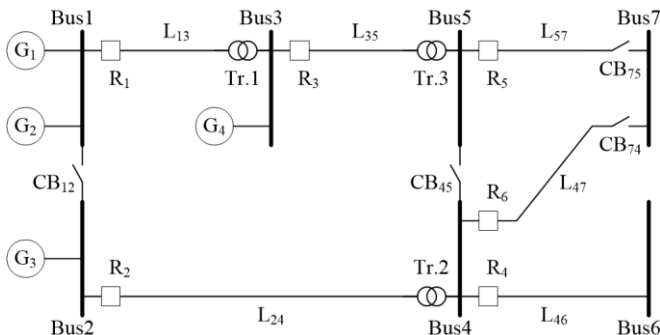


Fig. 1. Test MV maritime power system

TABLE I. Diesel Generators Data

Parameters	$G_1, G_2, G_3$	$G_4$
<b>Synchronous machine</b>		
Rated power [kVA]	3600	2400
Rated voltage [kV]	11	6.6
Rated frequency [Hz]	50	50
Stator resistance [p.u.]	0.01	0.015
Stator reactance [p.u.]	0.11	0.08
d-axis synchronous reactance [p.u.]	1.80	1.65
d-axis transient reactance [p.u.]	0.275	0.225
d-axis subtransient reactance [p.u.]	0.185	0.145
q-axis synchronous reactance [p.u.]	1.15	1.15
q-axis subtransient reactance [p.u.]	0.205	0.195
d-axis transient time [s]	0.55	0.42
d-axis subtransient time [s]	0.08	0.06
q-axis subtransient time [s]	0.08	0.06
Inertia constant [s]	2.0	1.5
Neutral series resistance [ $\Omega$ ]	320	190
AC exciter type <sup>a</sup>	AC1A	AC1A
<b>Internal combustion engine</b>		
Rated output power [kW]	3000	2000
Rated speed [rpm]	1500	1500
Gearbox ratio	1	1
Gearbox efficiency	0.98	0.98
Regulator type	PI	PI
Regulator proportional gain	12.5	12.5
Regulator integral time constant [s]	0.075	0.075
Regulator output upper limit	1.2	1.2
Regulator output lower limit	0	0

<sup>a</sup>. Parameters of the AC1A exciter used in this paper are given in [6]

TABLE II. Power Transformers Data

Parameters	Tr.1	Tr.2	Tr.3
Rated power [kVA]	2000	2000	2000
Primary voltage [kV]	11	11	6.6
Secondary voltage [kV]	6.6	3.3	3.3
Copper losses [p.u.]	0.011	0.01	0.0105
Iron losses [p.u.]	0.00175	0.002	0.00175
Short-circuit impedance [p.u.]	0.06	0.06	0.06
No-load current [%]	1	1	1.1
Vector group	Dyn5	Dyn5	Dyn5
Neutral series impedance [ $\Omega$ ]	190	95	95

TABLE III. Electric Cables Data

Cable	Resistance [m $\Omega$ ]	Inductance [ $\mu$ H]	Capacitance/2 [nF]
$L_{13}$	52.4	37.6	29.3
$L_{24}$	10.48	7.52	5.86
$L_{35}$	26.8	33.1	37.1
$L_{46}, L_{57}$	14.54	7.94	5.22
$L_{47}$	36.35	19.85	13.05

TABLE IV. Load Data

Load on	Rated voltage [kV]	Consumed power [kVA]	Power factor
Bus1, Bus2	11	2236	0.88
Bus3	6.6	894	0.89
Bus4, Bus5	3.3	335	0.91
Bus6, Bus7	3.3	335	0.92

*Bus5* are already energized. Similarly,  $CB_{74}$  and  $CB_{75}$  are logically interlocked so that *Bus7* is energized from *Bus4* or *Bus5*, but not from both simultaneously.

Each feeder of the test MV maritime power systems is protected by an OC relay  $R_x$ , where  $x$  is the indicator of the feeding bus bar. Fig. 2 presents the arrangement of the OC relays, Current Transformers (CTs) and CBs for 2 generic feeders. When an OC relay trips, it sends a signal to the 2 CBs placed at the both ends of its corresponding feeder. The same 2 CBs are also used to disconnect the feeder from the network in order to reconfigure the power system or to allow the maintenance operations. In the followings, the 2 CBs placed at the booth ends of a feeder are referred as  $CB_{xy}$  and  $CB_{yx}$ , where  $x$  and  $y$  are the indicators of the bus bars interconnected by that feeder.

### III. PROPOSED METHODOLOGY

The main purpose of the proposed adaptive protection algorithm is to achieve proper coordination of the OC relays and clearance of the fault as fast as possible. As mentioned in Section I, the new adaptive protection concept is based on the communication network between different equipment. Each relay is able to obtain online information about the status of the generators or CBs position, thus to correctly identify the network status. The relays are also able to communicate with each other. Each relay is provided with 2 protection functions: an OC protection and an inter-tripping function that allows to a relay to stimulate the tripping operation of another relay. The inter-tripping function is based on communication between the relays. Both functions are dependent on the network conditions and are described in the followings.

#### A. OverCurrent function

The OC protection function consists from a definite time delay function and an inverse time delay function. The pick-up current  $I_p^{DTD}$  for the definite time delay OC protection is set in such way that the bolted faults within the relay's protection zone are cleared after a definite time delay. In this paper, the definite time delay is set to  $40\text{ ms}$  and it accounts for operation of the physical relays. The pick-up current  $I_p^{ITD}$  for the inverse time delay OC protection is set to 1.5 times the nominal current seen by the relay in normal conditions. The IEC very inverse characteristic is selected to obtain the inverse time delay based on the mathematical expression given in (1).

$$t_{ITD} = TMS \cdot \left[ \frac{k}{\left( \frac{I}{I_p^{ITD}} \right)^{\alpha+c}} \right] \quad (1)$$

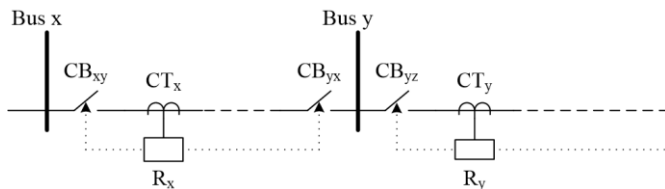


Fig. 2. Arrangement of the protection equipment for a generic feeder

$t_{ITD}$  is the operating time (inverse time delay) of the relay,  $TMS$  is the Time Multiplier Setting,  $I$  represents the actual current seen by the relay and  $k, c, \alpha$  are constants whose values are respectively  $13.5, 0, 1$  for the IEC very inverse characteristic [7].  $TMS$  is selected in such way that the relay provides backup protection with sufficient margin time for the faults that are not cleared by the downstream relays.

An offline analysis of the power system is performed in order to compute the proper settings of the OC protection relays ( $I_p^{DTD}$ ,  $I_p^{ITD}$  and  $TMS$ ) for each possible status of the network. Each relay stores the calculated settings in its internal memory, but only a single set of settings is active at once. Selection of the active settings is realized based on the network status detected by the relay. The relay continuously adjusts the OC settings, so that the optimal OC settings are always active. The discussed adaptive protection algorithm is presented in Fig. 3.

#### B. Inter-tripping function

As mentioned in the previous section, each OC relay provides backup protection for the electrical faults located outside its protection zone in the event that the primary protection suffer a failure. However, the time needed by the primary protection to clear such faults can be relatively long in some cases. The damage produced to the electrical equipment is proportional with the fault current and the fault duration, so a decrease of the trip time can reduce the equipment damage and the danger to which the personnel is exposed [8].

Malfunction of the primary protection system can be caused by a failure of its corresponding CBs to interrupt the fault current. In order to mitigate the negative effects of the fault in this situation and to limit the equipment damage, an inter-tripping function is implemented for each OC relay. More specifically, if a relay trips, but its corresponding CBs

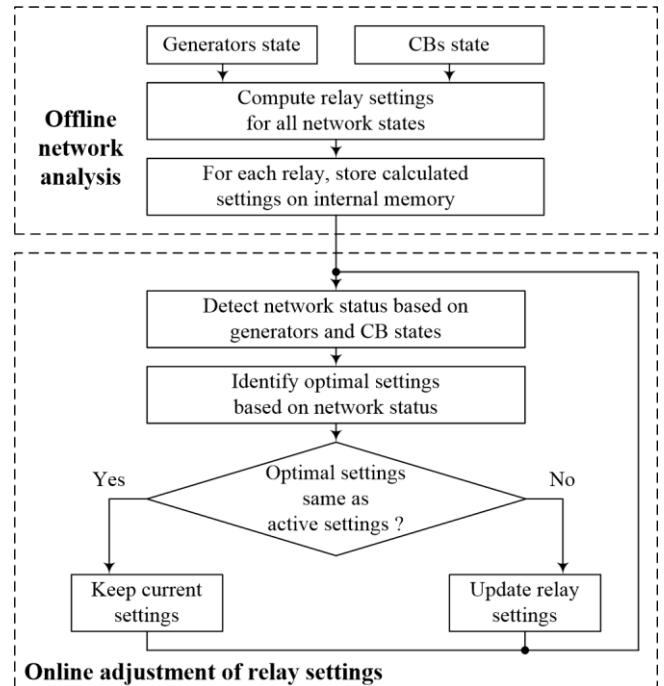


Fig. 3. Adaptive OC protection algorithm

fail to clear the fault, the same relay sends an inter-trip command to the nearest OC relay placed upstream. The inter-trip command overrides the OC function of the upstream relay and impels it to trip instantaneously.

Considering Fig. 2, if  $R_y$  trips, but  $CB_{yz}$  fails to open within a certain timeframe,  $R_y$  sends the inter-trip command to  $R_x$ , which trips instantaneously, thus clearing the fault on the downstream feeder. There is chance that  $R_x$  would have tripped anyway due to its inverse time characteristic, but not as fast as using the inter-trip function. The timeframe between the moment when a protection relay trips and it sends the inter-trip signal to another relay should be longer than the time needed by a CB to operate. In this paper, this time interval is set to  $200\text{ ms}$ .

The inter-tripping function is adaptive to the network status because for a given relay, its nearest upstream relay could be different for different configurations of the power system. For example, in Fig. 1, the nearest upstream relay for  $R_5$  could be  $R_2$  or  $R_3$ , depending on the status of  $CB_{45}$ . Note that the inter-tripping function is effective only against a malfunction of the CB, as it cannot operate if the OC protection function of the relay is defective. Moreover, the inter-tripping function still needs the proper relay coordination that is provided by the adaptive OC protection algorithm.

#### IV. SIMULATION RESULTS

The proposed adaptive protection method is compared with a traditional OC protection approach using the test MV maritime network. The performance of the 2 protection methods is evaluated using a 3-phase bolted fault applied on the primary side of  $Tr.3$ . For both protection methods, the arrangement of the relays is identical and as it is described in Section II, but for the traditional OC protection approach, the relay settings are not adaptive. To challenge these 2 protection systems, 3 different states of the test MV network are considered. The fault is applied successively for each state of the test MV network and for each protection system.


Status of the test MV power system is determined by the operating generators and by CBs status. For each network state, those power generators that are connected to the network and those CBs that are open are presented in TABLE V. *Status 1* represents the normal configuration of the MV network. The relay settings for the traditional OC relays are computed based on this network state. *Status 2* represents the MV network with the same configuration as in *Status 1*, but powered by 3 main generators, so an increased short-circuit power is available during the fault. In *Status 3*, the feeder corresponding to  $R_1$  is disconnected, so  $Bus3$ ,  $Bus5$  and  $Bus7$  are powered by the emergency generator and the available short-circuit power for these bus bars is reduced compared to the previous states of the network.

TABLE V. Analyzed States of the Test MV Maritime Power System


Network Status	Operating generator	Open CBs
Status 1	$G_1, G_3$	$CB_{45}, CB_{74}$
Status 2	$G_1, G_2, G_3$	$CB_{45}, CB_{74}$
Status 3	$G_1, G_2, G_4$	$CB_{45}, CB_{74}, CB_{13}, CB_{31}$

The relay settings of the adaptive protection method for all states of the test MV power system are obtain from the offline network analysis. Settings of the traditional OC protection and the active settings of the adaptive OC protection for *Status 1* are identical. The time-current curves of the adaptive protection system for different states of the test MV network for  $R_1$ ,  $R_3$  and  $R_5$  on 3.3 kV base are given in Fig. 4 and their corresponding settings are presented in TABLE VI.


Due to the location of the applied fault on the primary side of  $Tr.3$ , the fault needs to be cleared by  $R_3$ , while  $R_1$  is to provide backup protection for  $R_3$ . Moreover, as the considered fault is a 3-phase bolted fault within the protection zone of  $R_3$ , it is desirable for this relay to trip with the definite time delay (set to  $40\text{ ms}$ ). Acting as a backup,  $R_1$  should trip if  $R_3$  fails to

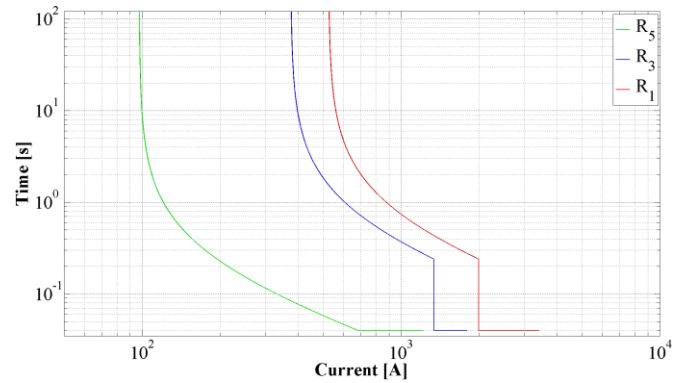

a) Time-current curves for Status 1

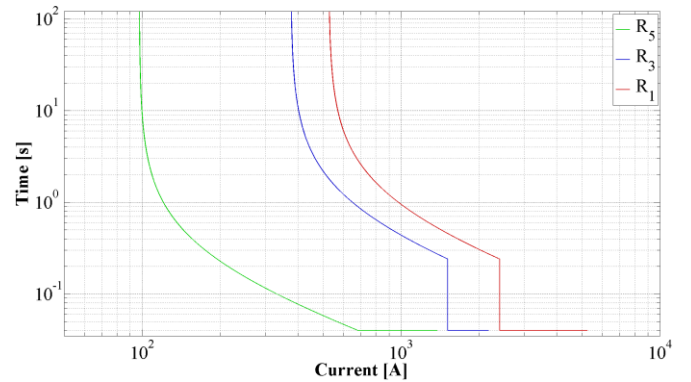

b) Time-current curves for Status 2

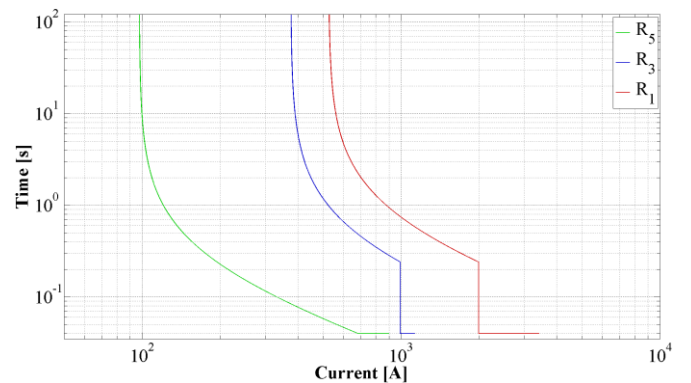

a) Time-current curves for Status 3

Fig. 4. Time-current curves (on 3.3 kV base) of adaptive protection system for different states of the test MV maritime network for  $R_1$ ,  $R_3$  and  $R_5$

TABLE VI. Relay settings of the adaptive protection system for different states of the test MV maritime network for  $R_1$ ,  $R_3$  and  $R_5$

System status	Relay	$I_p^{DTD}$ [A]	$I_p^{DT}$	TMS
Status 1	$R_1$	1995	525	0.0498
	$R_3$	1341	375	0.0458
	$R_5$	682.5	97.5	0.0178
Status 2	$R_1$	2407	525	0.0637
	$R_3$	1517	375	0.0541
	$R_5$	682.5	97.5	0.0178
Status 3	$R_1$	1995	525	0.0498
	$R_3$	994.5	375	0.0294
	$R_5$	682.5	97.5	0.0400

clear the fault, but with a sufficient time margin (set to 200 ms) in order for the protection system to be selective. The other relays are unable to sense the applied fault, so only the tripping signals of  $R_1$  and  $R_3$  are relevant in this situation.

Simulation results for  $R_1$  and  $R_3$ , for the traditional and adaptive protection systems for the considered states of the test MV network are presented in TABLE VII. Note that for the adaptive OC protection, there are 2 times for  $R_1$ : the values on parentheses represent the operating times if the inter-tripping function is active and the other values represent the operating times with the inter-tripping function disabled.

Both protection systems perform similarly for *Status 1* of the network. However, for the other 2 network states, the adaptive protection system is superior. For *Status 2*, the adaptive protection method behaves as intended:  $R_3$  operates in 40 ms and the operating time of  $R_1$  is sufficient to fulfill the selectivity condition. The traditional OC protection is not selective for *Status 2*, as  $R_1$  and  $R_3$  operate simultaneously. Of course that the traditional OC protection can be graded in such way that it will be selective for *Status 2*, but then its behavior will not be optimal for *Status 1*. For *Status 3*, the fault current is provided by  $G_4$ , thus  $R_1$  is not affected in this case. The adaptive protection system operates in 40 ms, while it takes 308 ms to the traditional OC protection to operate.

The inter-tripping function shortens the operating times of a relay if its backup function is needed, but not beyond the selectivity margin, as it can be observed in TABLE VII for *Status 1* and *Status 2*. The difference between the operating time of  $R_1$  with a disabled inter-tripping function and with an active inter-tripping function is 36 ms for *Status 1* and 33 ms for *Status 2*. Considering that another 200 ms are needed for a CB to interrupt the fault current, it results that the inter-tripping function reduces the overall clearance time of a backup OC relay with about 8% in the simulated conditions.

## V. CONCLUSIONS

The protection systems in the MV maritime networks are challenged by several factors, including variable generation and network reconfiguration. Therefore, the traditional OC protection techniques are not capable to perform optimal for the entire set of network states and the protection selectivity could be lost in some cases. Consequently, the protection system needs to be adaptive to the network status, but

TABLE VII. Operating times of the protective relays for traditional OC protection and adaptive OC protection for different states of the MV network

Network status	Relay operating time [ms]			
	Traditional OC protection		Adaptive OC protection	
	$R_1$	$R_3$	$R_1$	$R_3$
Status 1	276	40	276 (240)	40
Status 2	40	40	273 (240)	40
Status 3	-	308	-	40

simultaneously, a centralized approach for an adaptive power system should be avoided in the maritime sector.

A decentralized adaptive protection system based on communication between the OC relays, CBs and generators is proposed in this paper. The communication infrastructure is needed and sometimes already existent in the maritime applications for control purposes. Therefore, implementation of the proposed protection method is feasible from technical and economic points of view in maritime MV power system. The novelty of the proposed adaptive protection system is the absence of a central control unit, as each relay is able to acquire information from the network equipment, with the advantage that a possible single point of failure is eliminated.

Additionally, an inter-tripping function of the OC relays is suggested in order to improve the backup operation of the protection system. The cost of such function is reduced because it does not require any additional hardware and it is based on the same communication infrastructure as the proposed adaptive protection method.

## REFERENCES

- [1] C. I. Ciontea, C. Leth Bak, F. Blaabjerg, K. K. Madsen, C. H. Sterregaard, "Review of network topologies and protection principles in marine and offshore applications", *25<sup>th</sup> Australasian Universities Power Engineering Conference*, Wollongong, Australia, Sep. 2015
- [2] B. P. Bhattarai, B. Bak-Jensen, S. Chaudhary, J. R. Pillai, "An adaptive overcurrent protection in smart distribution grid", *11<sup>th</sup> IEEE PES Powertech Conference*, Eindhoven, Netherlands, June 2015
- [3] F. Coffele, C. Booth, A. Dysko, "An adaptive overcurrent protection scheme for distribution networks", *IEEE Trans. On Power Delivery*, vol. 30, no. 2, pp. 561-568, Apr. 2015
- [4] P. Mahat, Z. Chen, B. Bak-Jensen, C. Leth Bak, "A simple adaptive overcurrent protection of distribution systems with distributed generation", *IEEE Trans. On Smart Grid*, vol. 2, no. 3, pp. 428-437, Sep. 2011
- [5] S. M. Brahma, A. A. Girgis, "Development of adaptive protection scheme for distribution systems with high penetration of distributed generation", *IEEE Trans. On Power Delivery*, vol. 19, no. 1, pp. 58-63, Jan. 2004
- [6] F. Zhang, Z. Xu, "Effect of exciter and PSS on SSR damping", *IEEE PES General Meeting*, June 2007
- [7] *IEC International Standard for Measuring relays and protection equipment – Part 151: Functional requirements for over/under current protection*, IEC Std. 60255-151, Edition 1.0, Aug. 2010
- [8] J. A. Kay, J. Arvola, L. Kumpulainen, "Protecting at the speed of light: combining arc flash sensing and are-resistant technologies", *IEEE Pulp and Paper Industry Technical Conference*, San Antonio, Texas, USA, June 2010