



**AALBORG UNIVERSITY**  
DENMARK

**Aalborg Universitet**

## **Diffuse Ceiling Inlet Systems and the Room Air Distribution**

Nielsen, Peter V.; Jensen, Rasmus Lund; Rong, Li

*Publication date:*  
2010

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Nielsen, P. V., Jensen, R. L., & Rong, L. (2010). *Diffuse Ceiling Inlet Systems and the Room Air Distribution*. Poster presented at Clima 2010, Antalya, Turkey.

### **General rights**

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### **Take down policy**

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

# Diffuse Ceiling Inlet Systems and the Room Air Distribution

Peter V. Nielsen, Rasmus L. Jensen, Li Rong  
Aalborg University, Denmark




## SUMMARY

A diffuse ceiling inlet system is an air distribution system which is supplying the air through the whole ceiling. The system can remove a large heat load without creating draught in the room. The paper describes measurements in the case of both cooling and heating, and CFD predictions are given for the heating case.


## FULL-SCALE EXPERIMENTS

The system is tested in a full-scale room with the length, width and height equal to 4.1 m, 3.2 m and 2.45 m, respectively. Both cooling (in a general situation), and heating (for the night situation) are tested.

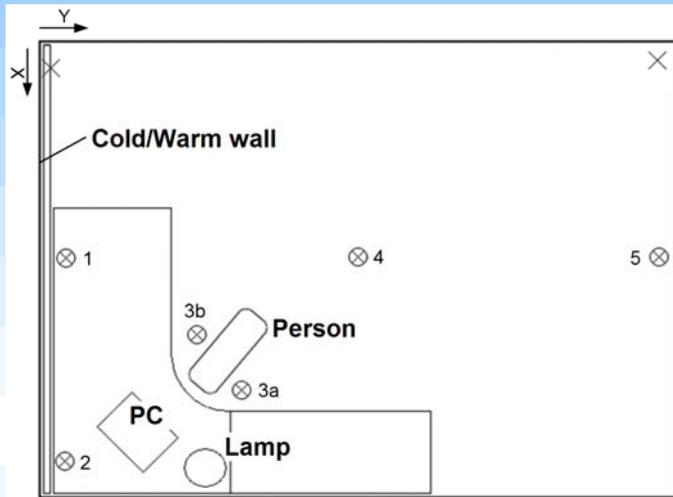


## CFD



The full-scale room is only one quarter of the full room in the office building. The experiments are therefore extended by CFD predictions for the full room with the dimensions, length, width, height equal to 7.2 m x 10 m x 2.7 m. The CFD predictions are focused on the heating situation.

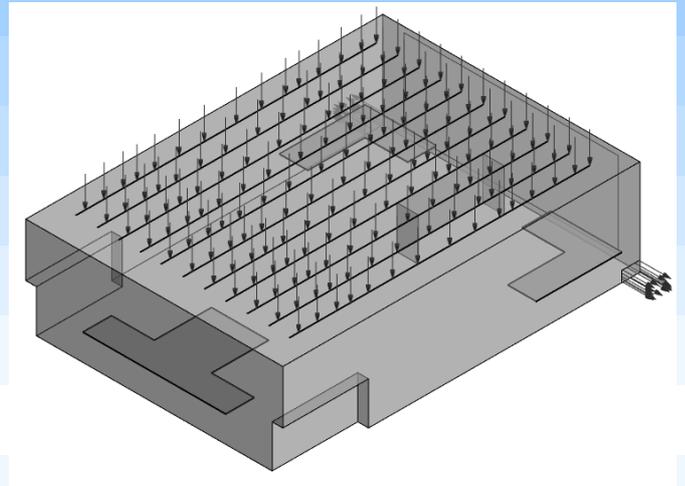

## RESULTS - Heating

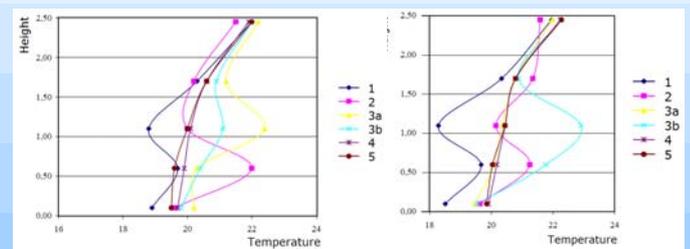

## RESULTS - Cooling

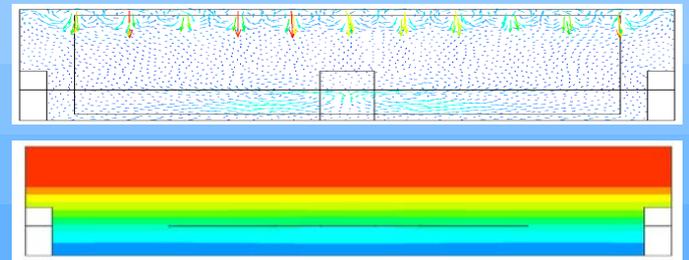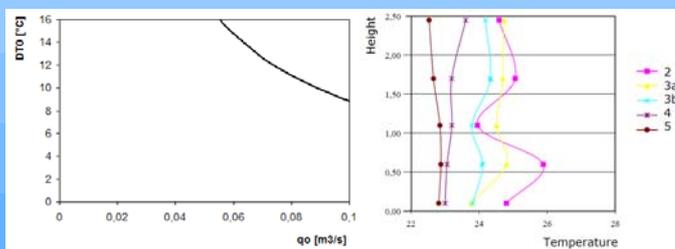

## CONCLUSIONS

The experiments show that the diffuse ceiling inlet system is working well in the case of cooling. There is no indication of any unstable flow situations, although cold air is supplied with a low momentum flow above warm air in the occupied zone.

The system is also working in a satisfactory way when it is used in the heating situation. Some low temperatures close to the cold surface in the experiments, and the indication of large vertical temperature gradients in the CFD predictions show that in this case areas with low temperatures may exist.

The smoke experiments show that a few heat sources generate sufficient mixing flow in the room to obtain thermal comfort and that the location of the return opening is of minor importance.