



**AALBORG UNIVERSITY**  
DENMARK

**Aalborg Universitet**

## **Dispersion of Contaminants in Indoor Climate**

Heiselberg, Per

*Publication date:*  
1992

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Heiselberg, P. (1992). *Dispersion of Contaminants in Indoor Climate*. Dept. of Building Technology and Structural Engineering. Indoor Environmental Technology Vol. R9254 No. 29

### **General rights**

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### **Take down policy**

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

---

**INSTITUTTET FOR BYGNINGSTEKNIK**  
DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITETSCENTER • AUC • AALBORG • DANMARK

---

INDOOR ENVIRONMENTAL TECHNOLOGY  
PAPER NO. 29

Presented at Lüftungsforschung für die Praxis, ETH, Zürich, May 1992

---

P. HEISELBERG  
DISPERSION OF CONTAMINANTS IN INDOOR CLIMATE  
MAY 1992

---

ISSN 0902-7513 R9254

The papers on INDOOR ENVIRONMENTAL TECHNOLOGY are issued for early dissemination of research results from the Indoor Environmental Technology Group at the University of Aalborg. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible reference should be given to the final publications (proceedings, journals, etc.) and not to the paper in this series.

---

**INSTITUTTET FOR BYGNINGSTEKNIK**  
DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING  
AALBORG UNIVERSITETSCENTER • AUC • AALBORG • DANMARK

---

**INDOOR ENVIRONMENTAL TECHNOLOGY**  
**PAPER NO. 29**

**Presented at Lüftungsforschung für die Praxis, ETH, Zürich, May 1992**

---

**P. HEISELBERG**  
**DISPERSION OF CONTAMINANTS IN INDOOR CLIMATE**  
**MAY 1992** **ISSN 0902-7513 R9254**

---



# Dispersion of Contaminants in Indoor Climate

Per Heiselberg

University of Aalborg  
Sohngaardsholmsvej 57  
DK-9000 Aalborg  
Denmark

In rooms ventilated by mixing ventilation, in order to remove contaminants from the occupied zone, the goal of the air distribution system is to achieve a low and even concentration distribution in the room.

The experiments showed that the contaminant distribution in a room always will depend on the location of the contamination source and in practice also on the supplied air flow rate and the contaminant density.

The results showed that it is important for the removal of contaminants in a room that the ventilation system is working in the same direction as the existing buoyancy forces.

## 1. Introduction

Within comfort ventilation a distinction can be made between two main principles, mixing ventilation and displacement ventilation, to removal of released contaminants in the indoor climate.

In rooms ventilated by mixing ventilation the goal of the air distribution system is to rarefy the contaminated air and to achieve a low and even concentration distribution in the whole room, the so-called complete mixing. On the other hand in rooms ventilated by displacement ventilation the goal of the air distribution system is to displace the contaminated air from the occupied zone and to achieve supply air quality here and exhaust air quality in the rest of the room.

In the following the results of a series of full-scale measurements will be presented and they show how the contaminant distribution in a full-scale test room ventilated by the mixing principle looks like under different flow conditions, and what it is important to be aware of if the goals of the air distribution system are to be achieved.

It is examined how the contaminant distribution is influenced by different air change rates in the room, by different locations of the contamination source and by different densities of the contaminant.

## 2. Experimental Set-Up

The experiments have taken place under isothermal steady state conditions as specified in [1] and [2].

## 2.1 The Test Room

The experiments have taken place in a full-scale test room located in a laboratory hall. A sketch of the geometry of the room is shown in figure 1. The specifications of the test room are  $(L \times W \times H) = (4.2 \text{ m} \times 3.6 \text{ m} \times 2.4 \text{ m})$ , see [10].

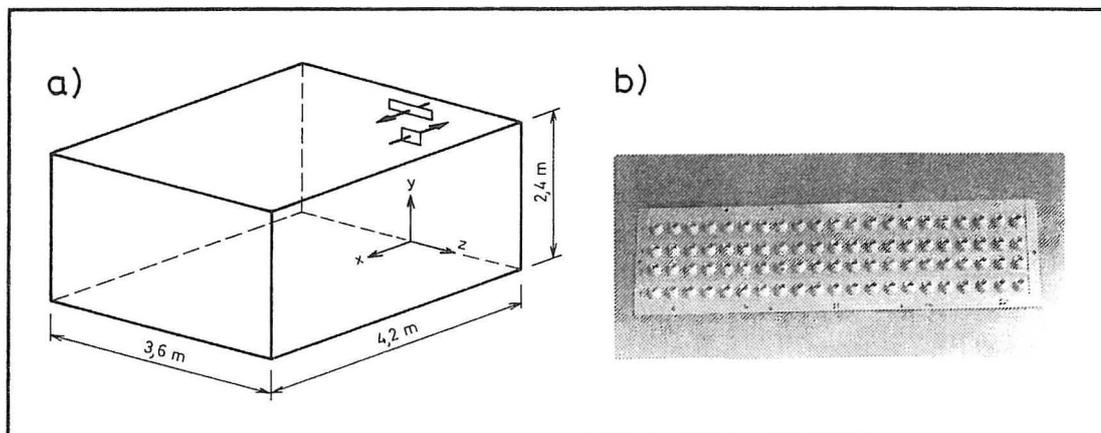


Figure 1. a) Sketch of the geometry of the full-scale test room. b) Close-up of the HESCO inlet device.

## 2.2 The Inlet and Outlet Devices

The inlet device is of the HESCO-type. The diffuser consists of 4 rows with 21 nozzles which can be adjusted to different directions. For these experiments the nozzles have been adjusted to an angle of  $40^\circ$  upwards, see figure 1 and [3]. The dimensions are  $(H \times W) = (0.17 \text{ m} \times 0.7 \text{ m})$ . The inlet is located in the middle of one of the end walls with the top of the inlet 2.2 m above the floor. The generated flow pattern is very typical of modern air terminal device design. The outlet is located below the inlet with the top of the outlet at a distance of 1.6 m above the floor. The dimensions are  $(H \times W) = (0.2 \text{ m} \times 0.3 \text{ m})$ .

## 2.4 The Contamination Source

The contamination source consists of a ping pong ball (diameter 30 mm) with 6 evenly distributed holes with a diameter of 1 mm each. The tracer gas  $\text{CO}_2$  has been used as a contaminant. It has been mixed with the carrier gases  $\text{N}_2$  or He in order to give a total contaminant flow rate of 0.025 l/s and different contaminant densities.

## 2.5 The Location of Measuring Points

The concentration profiles were measured in 10 points. The points were distributed along a vertical line placed in the centre plane of the test room 2.2 m from the supply opening. The calculation of concentration contours in the centre plane of the test room are based on measurements in 110 points. The points are concentrated around the contamination source where large gradients are expected, at the end wall to see how far the supply air jet penetrates into the room and at the boundary surfaces. The concentrations are measured with a Binos Infra-Red Analyser.

### 3. Measuring Results

The measuring results show how the contaminant distribution is influenced by different air change rates in the test room, by different locations of the contamination source and by different densities of the contaminant. The results show in which situations the air distribution system is capable of creating a low and even concentration distribution in the whole room.

#### 3.1 Profiles of Concentration

Vertical profiles of the concentration in the middle of the test room have been measured at different air change rates and locations of the contamination source. The profiles of concentration are presented as concentration ratios where the reference concentration is the concentration in the exhaust opening.

Figure 2 shows the profiles for three air change rates with the contamination source located in the middle of the room, location A, and a contaminant density of  $1.2 \text{ kg/m}^3$ . In the test case with an air change rate of  $n=1.5 \text{ h}^{-1}$  the air flow rate is approximately the minimum value required to ventilate an office room. The throw of the jet is about  $4/5$  of the room length and the maximum velocity in the occupied zone is below  $0.1 \text{ m/s}$ . The test case with an air change rate of  $n=3 \text{ h}^{-1}$  represents the basic case where the air flow rate is about the usual value in office rooms. The throw of the jet is approximately room length plus room height and the maximum velocity in the occupied zone is  $0.16 \text{ m/s}$  which is the maximum velocity that can be accepted in an office. In the test case with an air change rate of  $n=6 \text{ h}^{-1}$  the maximum velocity in the occupied zone is about  $0.33 \text{ m/s}$ . The velocity measurements can be seen in [4].

The results in figure 2 show in the upper part of the room a concentration distribution in the wall jet created by entrainment of the contaminated room air into the primary air. The concentration distribution is nearly the same for all three air change rates.

In the occupied zone the concentration distribution is dependent on the air change rate and it changes radically when the air change rate is changed from  $n=1.5 \text{ h}^{-1}$  to  $n=3 \text{ h}^{-1}$  due to a change in the flow structure in the room. At an air change rate of  $n=1.5 \text{ h}^{-1}$  the supply air jet only reaches the upper part of the occupied zone and the recirculating flow takes place here. In the lower part of the room there are small velocities and a slow exchange of air and therefore a high level of concentration, see also figure 5. At an air change rate of  $n=3 \text{ h}^{-1}$  the supply air jet reaches the floor in the room and there will be a recirculating flow with large velocities at floor level, see [4]. The contamination source is placed almost in the centre of the recirculating flow where the velocities and the exchange of air are very small. The level of concentration therefore becomes very high before the contaminant is entrained and discharged with the other air in the room. Model experiments in [5]) and full-scale experiments in [6] show a similar effect when the source is placed in an area with a low velocity.

With an increasing air change rate the contaminant distribution is approximating the distribution at high turbulent flow conditions in the room. This distribution is independent of the air change rate, see [7]. The maximum velocity in the occupied zone will, however, be above the acceptable comfort level for office rooms. Therefore the contaminant distribution in a room will depend on the supplied air flow rate in practice.

Figure 3 shows the profiles of concentration for four locations of the contamination source in the room at an air change rate of  $n=3 \text{ h}^{-1}$  and at a contaminant density

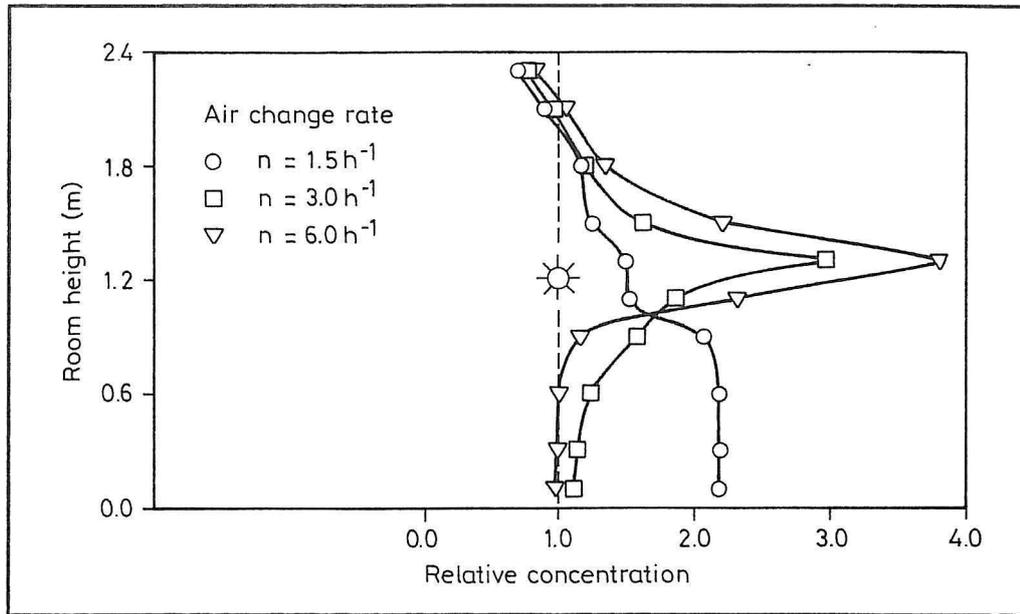


Figure 2. Relative concentration profiles in the middle of the test room for three different air change rates.

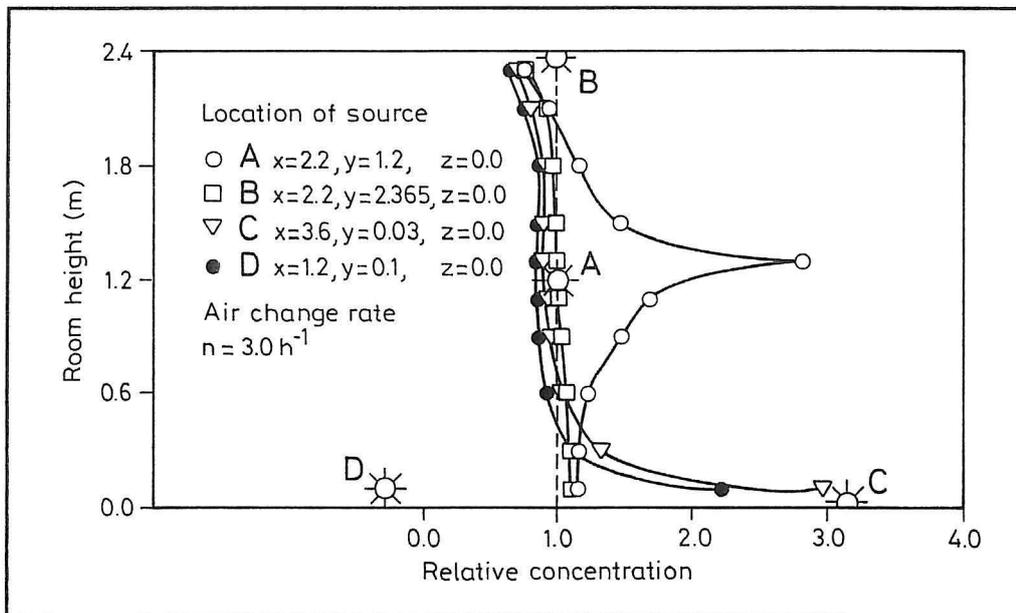


Figure 3. Relative concentration profiles in the middle of the test room for four different locations of the contamination source.

of  $1.2 \text{ kg/m}^3$ . Location A) is in the middle of the room as specified in [2]. Here the velocities are very low. Location B) is in the primary jet. Location C) and D) is in the occupied zone where the maximum velocity in the recirculating flow and a low velocity have been measured, respectively.

The profiles of concentration in the middle of the room depend on the location of the contamination source. A location in the middle of the room where the velocities are very small gives a high level of concentration just around the source because the exchange of air is slow. A location in the primary jet results in a very good mixing of the

contaminant and the supply air and gives a quick removal of the contaminant and a homogeneous contaminant distribution in the whole room. A location of the contamination source at floor level gives a uniform concentration in the upper part of the room and only high concentration in the immediate vicinity of the floor. Corresponding results are found in [5] and [7].

### 3.2 Contours of Concentration

Contours of concentration in the centre plane of the test room have been measured for three different contaminant densities with the contamination source located in location A) and at an air change rate of  $n=1.5 \text{ h}^{-1}$ . The three test cases with contaminant densities of  $s=0.8 \text{ kg/m}^3$ ,  $s=1.2 \text{ kg/m}^3$  and  $s=1.8 \text{ kg/m}^3$  represent a case with low density of the contamination source with a tendency of the contaminant to migrate to the ceiling region, a basic case with neutral density and a case with high density of the contamination source with a tendency of the contaminant to migrate to the floor region, respectively.

The results in the figures 4-6 show that the supply air jet reaches halfway down the opposite end wall and that the recirculating flow takes place in the upper part of the room above the level of the contamination source. The contours of concentration show considerable differences between the three test cases.

Contours of concentration at the high density case in figure 6 show clearly that the contaminant is streaming towards the floor region. Because the supply air jet is not able to flow through the whole room an even stratification of the contaminant arises in the lower part with a large contaminant gradient just below the contamination source and large concentrations near the floor.

Contours of concentration at the neutral density case in figure 5 show that the contaminant distributed to the upper part of the room is mixed with the recirculating room air. The contaminant distributed to the lower part of the room causes a high level

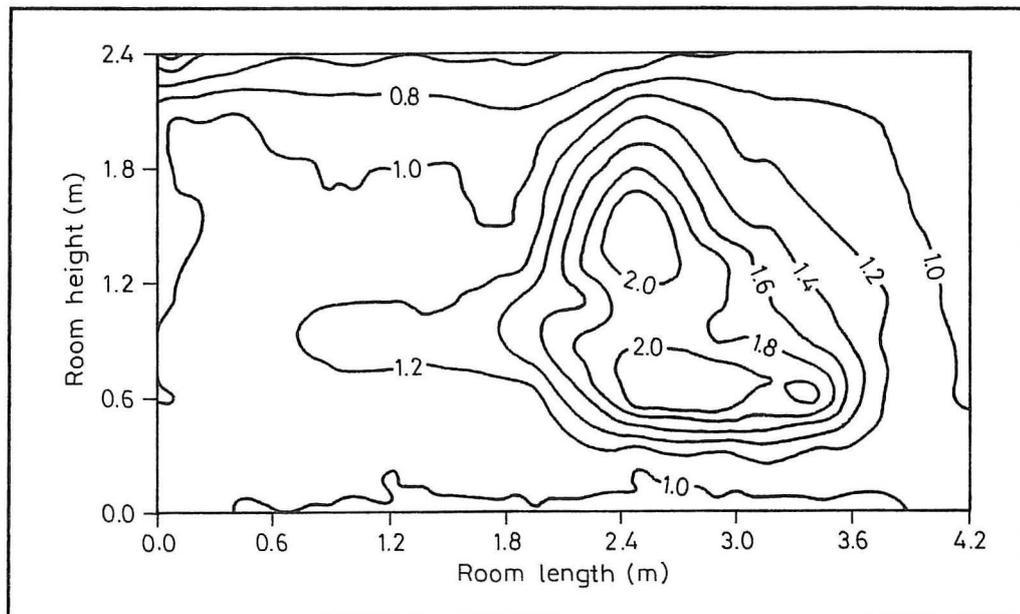


Figure 4. Contours of concentration in the centre plane of the test room. The contaminant density is  $0.8 \text{ kg/m}^3$ .

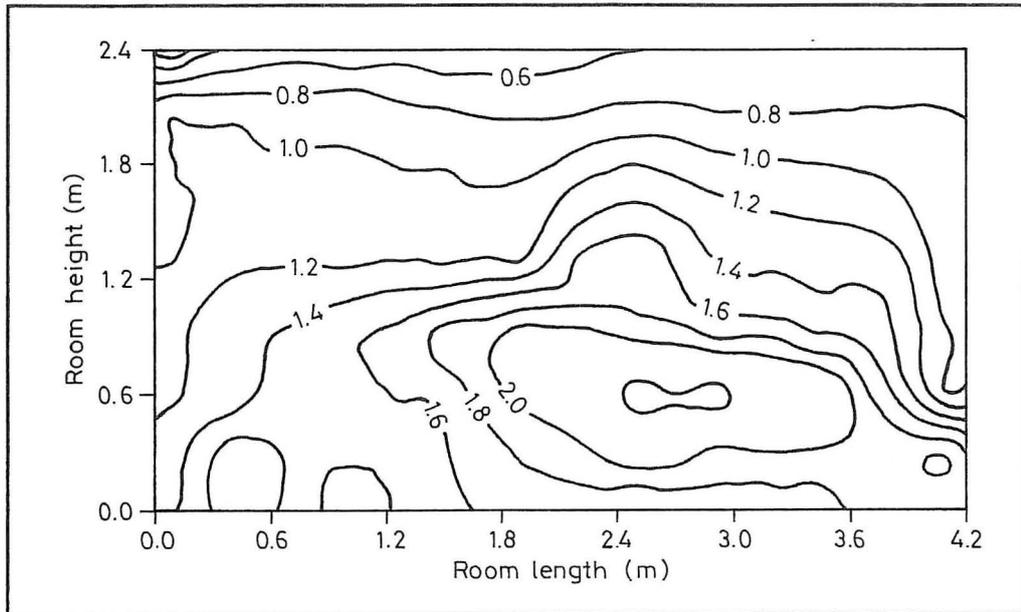


Figure 5. Contours of concentration in the centre plane of the test room. The contaminant density is  $1.2 \text{ kg/m}^3$ .

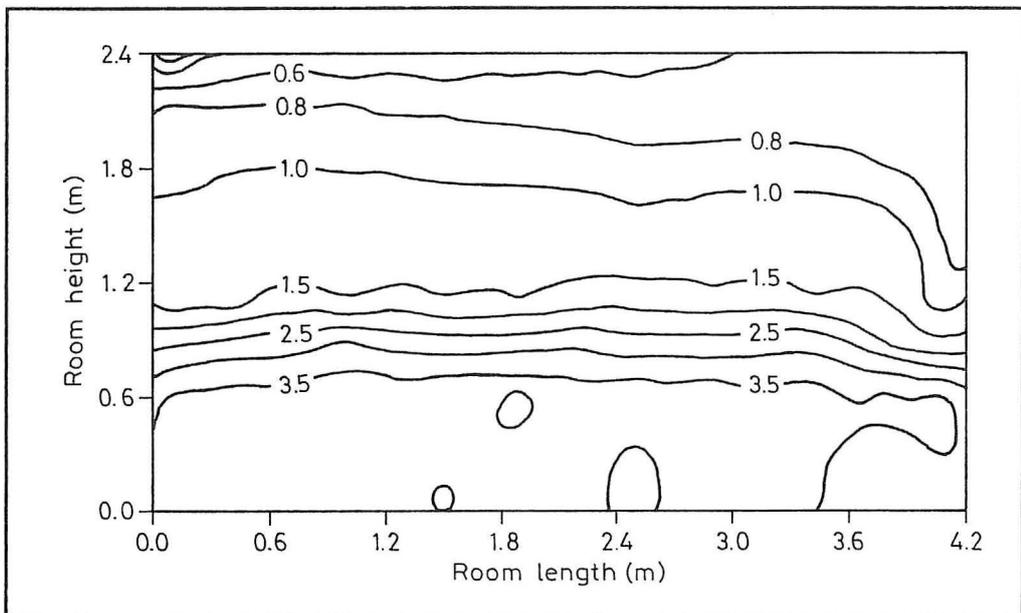


Figure 6. Contours of concentration in the centre plane of the test room. The contaminant density is  $1.8 \text{ kg/m}^3$ .

of concentration in large areas of the occupied zone because of the low velocities and slow exchange of air in this region of the room.

Contours of concentration at the low density case in figure 4 show high levels of concentration above the contamination source where the contaminant is flowing towards the ceiling and is here entrained by the supply air jet. There are also high levels of concentration below the contamination source.

The considerable differences found between the three test cases will be reduced with an increasing air change rate. The buoyancy effects will decrease and the

contaminant distribution will approximate the distribution at high turbulent flow conditions, see experiments in [6], [8] and [9].

#### 4. Conclusion

In rooms ventilated by mixing ventilation, in order to remove contaminants from the occupied zone, the goal of the air distribution system is to achieve an even concentration distribution in the room. This is not always possible, however, but the full-scale experiments have shown at large air change rates with high air velocities where the contamination sources are located that the differences will be relatively small. Heat sources located in the room will together with the fact that there will be persons walking about contribute to a better mixing in the room in practice.

The contours of concentration in the centre plane of the room showed at an air change rate of  $n=1.5 \text{ h}^{-1}$  considerable differences between the test cases with different contaminant densities. The results showed that it is important for the removal of contaminants in a room that the ventilation system is working in the same direction as the existing buoyancy forces. A contaminant with a high density will flow towards the floor region. With an exhaust placed near the floor the ventilation system will be able to remove the contaminant, regardless of the fact that the supply air jet is able to flow through the whole room, and a situation with high levels of concentration as in figure 6 will be prevented.

The experiments showed that the contaminant distribution in a room always will depend on the location of the contamination source and, in practice, also on the supplied air flow rate and the contaminant density. High turbulent flow conditions will occur in the room at large air change rates but the velocities in the occupied zone will then be above the acceptable level of comfort.

#### 5. References

- [1] Heikkinen, J. 1989. "Specification of Testcase B (Forced Convection, Isothermal)". Annex 20 working report R.I.1.13.
- [2] Skåret, E. 1989. "Specification of Testcase F (Forced Convection, Isothermal with Contaminants)". Annex 20 working report R.I.1.31.
- [3] Nielsen, P.V. 1988. "Selection of Air Terminal Device". Annex 20 working report R.I.1.2. University of Aalborg, ISSN 0902-7513-R8838.
- [4] Skovgaard, M., Hyldgaard, C.E. and Nielsen, P.V. 1990. "High and low Reynolds Number Measurements in a Room with an Impinging Isothermal Jet". Int. Conf. ROOMVENT '90, Oslo.
- [5] Oppl, L. 1969. "Luftströmung in gelüfteten Räumen". Öl- und Gasfeuerung, Nr. 9.
- [6] Heiselberg, P. and Nielsen, P.V. 1987. "The Contaminant Distribution in a Ventilated Room with Different Air Terminal Devices". Int. Conf. ROOMVENT '87, Stockholm.

- [7] Nielsen, P.V. 1981. "Contaminant Distribution in Industrial Areas with Forced Ventilation and Two-dimensional Flow". IIR-Joint Meeting, Commission E1, Essen.
- [8] Heiselberg, P. 1990. "Flow Conditions in Rooms with Mixing and Displacement Ventilation". (in Danish). Ph.D.-Thesis, University of Aalborg, ISSN 0902-7513-R9015.
- [9] Murakami, S., Tanaka, T. and Kato, S. 1983. "Numerical Simulation of Air Flow and Gas Diffusion in Room Model - Correspondance between Numerical Simulation and Model Experiments". 4th Int. Symp. on the Use of Computers for Environmental Engineering Related to Buildings, Tokyo.
- [10] Lemaire, A.D. 1989. "Testrooms, Identical Testrooms". Annex 20 working report R.I.1.3.



PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 1: C. E. Hyldgård: *Aerodynamic Control of Exhaust*. ISSN 0902-7513 R8712.

PAPER NO. 2: Per Heiselberg, Peter V. Nielsen: *The Contaminant Distribution in a Ventilated Room with Different Air Terminal Devices*. ISSN 0902-7513 R8713.

PAPER NO. 3: Peter V. Nielsen, L. Evensen, Peter Grabau, J. H. Thulesen-Dahl: *Air Distribution in Rooms with Ceiling-Mounted Obstacles and Three-Dimensional Flow*. ISSN 0902-7513 R8714.

PAPER NO. 4: Peter V. Nielsen, Åke T. A. Möller: *Measurements on Buoyant Wall Jet Flows in Air-Conditioned Rooms*. ISSN 0902-7513 R8715.

PAPER NO. 5: Peter V. Nielsen: *Numerical Prediction of Air Distribution in Rooms. Status and Potentials*. ISSN 0902-7513 R8823.

PAPER NO. 6: Peter V. Nielsen, Åke T. Möller: *Measurements on Buoyant Jet Flows from a Ceiling-Mounted Slot Diffuser*. ISSN 0902-7513 R8832.

PAPER NO. 7: Peter Kofoed, Peter V. Nielsen: *Thermal Plumes in Ventilated Rooms - An Experimental Research Work*. ISSN 0902-7513 R8833.

PAPER NO. 8: Peter V. Nielsen, Lars Hoff, Lars Germann Pedersen: *Displacement Ventilation by Different Types of Diffusers*. ISSN 0902-7513 R8834.

PAPER NO. 9: Per Heiselberg, Peter V. Nielsen: *Flow Conditions in a Mechanically Ventilated Room with a Convective Heat Source*. ISSN 0902-7513 R8835.

PAPER NO. 10: Peter V. Nielsen: *Displacement Ventilation in a Room with Low-Level Diffusers*. ISSN 0902-7513 R8836.

PAPER NO. 11: Peter V. Nielsen: *Airflow Simulation Techniques - Progress and Trends*. ISSN 0902-7513 R8926.

PAPER NO. 12: M. Skovgaard, C. E. Hyldgaard & P. V. Nielsen: *High and Low Reynolds Number Measurements in a Room with an Impinging Isothermal Jet*. ISSN 0902-7513 R9003

PAPER NO. 13: M. Skovgaard, P. V. Nielsen: *Numerical Prediction of Air Distribution in Rooms with Ventilation of the Mixing Type using the Standard K,  $\epsilon$ -Model*. ISSN 0902-7513 R9042.

PAPER NO. 14: P. Kofoed, P. V. Nielsen: *Thermal Plumes in Ventilated Rooms - Measurements in Stratified Surroundings and Analysis by Use of an Extrapolation Method*. ISSN 0902-7513 R9043.

PAPER NO. 15: P. Heiselberg, M. Sandberg: *Convection from a Slender Cylinder in a Ventilated Room*. ISSN 0902-7513 R9044.

## PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 17: H. Overby, M. Steen-Thøde: *Calculation of Vertical Temperature Gradients in Heated Rooms*. ISSN 0902-7513 R9046.

PAPER NO. 18: P. V. Nielsen, U. Madsen, D. Tveit: *Experiments on an Exhaust Hood for the Paint Industry*. ISSN 0902-7513 R9146.

PAPER NO. 19: L. Germann Pedersen, P. V. Nielsen: *Exhaust System Reinforced by Jet Flow*. ISSN 0902-7513 R9147.

PAPER NO. 20: P. V. Nielsen: *Models for the Prediction of Room Air Distribution*. ISSN 0902-7513 R9148.

PAPER NO. 21: M. Skovgaard, P. V. Nielsen: *Modelling Complex Inlet Geometries in CFD - Applied to Air Flow in Ventilated Rooms*. ISSN 0902-7513 R9149.

PAPER NO. 22: M. Skovgaard, P. V. Nielsen: *Numerical Investigation of Transitional Flow over a Backward Facing Step using a Low Reynolds Number  $k - \epsilon$  Model*. ISSN 0902-7513 R9150.

PAPER NO. 23: P. Kofoed, P. V. Nielsen: *Auftriebsströmungen verschiedener Wärmequellen - Einfluss der umgebenden Wände auf den geförderten Volumenstrom*. ISSN 0902-7513 R9151.

PAPER NO. 24: P. Heiselberg: *Concentration Distribution in a Ventilated Room under Isothermal Conditions*. ISSN 0902-7513 R9152.

PAPER NO. 25: P. V. Nielsen: *Air Distribution Systems - Room Air Movement and Ventilation Effectiveness*. ISSN 0902-7513 R9250.

PAPER NO. 26: P. V. Nielsen: *Description of Supply Openings in Numerical Models for Room Air Distribution* ISSN 0902-7513 R9251.

PAPER NO. 27: P. V. Nielsen: *Velocity Distribution in the Flow from a Wall-mounted Diffuser in Rooms with Displacement Ventilation*. ISSN 0902-7513 R9252.

PAPER NO. 28: T. V. Jacobsen & P. V. Nielsen: *Velocity and Temperature Distribution in Flow from an Inlet Device in Rooms with Displacement Ventilation*. ISSN 0902-7513 R9253.

PAPER NO. 29: P. Heiselberg: *Dispersion of Contaminants in Indoor Climate*. ISSN 0902-7513 R9254.

PAPER NO. 30: P. Heiselberg & N. C. Bergsøe: *Measurements of Contaminant Dispersion in Ventilated Rooms by a Passive Tracer Gas Technique*. ISSN 0902-7513 R9255.

PAPER NO. 31: K. S. Christensen: *Numerical Prediction of Airflow in a Room with Ceiling-Mounted Obstacles*. ISSN 0902-7513 R9256.

Department of Building Technology and Structural Engineering  
The University of Aalborg, Sohngaardsholmsvej 57. DK 9000 Aalborg  
Telephone: 45 98 15 85 22    Telefax: 45 98 14 82 43