



AALBORG UNIVERSITY
DENMARK

Aalborg Universitet

CFD Simulation of Air Velocity Distribution in Occupied Livestock Buildings

Svidt, Kjeld; Zhang, G.; Bjerg, B.

Publication date:
1998

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):
Svidt, K., Zhang, G., & Bjerg, B. (1998). *CFD Simulation of Air Velocity Distribution in Occupied Livestock Buildings*. Dept. of Building Technology and Structural Engineering. Indoor Environmentl Engineering Vol. R9831 No. 87

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

CFD Sim

CFD Simulation of Air Velocity Distribution in Occupied Livestock Buildings

K. Svidt, G. Zhang, B. Bjerg

Paper No 87

Indoor Environmental Engineering

In: Proceedings of ROOMVENT'98, Sixth International
Conference on Air Distribution in Rooms, Stockholm,
Sweden 1998, Vol. 2, pp. 491-496

The *Indoor Environmental Engineering* papers are issued for early dissemination of research results from the Indoor Environmental Engineering Group at the Department of Building Technology and Structural Engineering, Aalborg University. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible, reference should be given to the final publications (proceedings, journals, etc.) and not to the Indoor Environmental Engineering papers.

CFD Simulation of Air
Velocity Distribution in
Occupied Livestock
Buildings

K. Svidt, G. Zhang, B. Bjerg

CFD SIMULATION OF AIR VELOCITY DISTRIBUTION IN OCCUPIED LIVESTOCK BUILDINGS

K. Svidt¹, G. Zhang², B. Bjerg³

¹Aalborg University, Aalborg, DENMARK, ks@civil.auc.dk

²Research Centre Bygholm, Horsens, DENMARK, gqz6@sh.dk

³Royal Veterinary and Agricultural University, Copenhagen, DENMARK, bb@kvl.dk

ABSTRACT

In modern livestock buildings the design of the ventilation systems is important in order to obtain good air distribution. The use of Computational Fluid Dynamics for predicting the air flow and air quality makes it possible to include the effect of room geometry, equipment and occupants in the design of ventilation systems. However, it is not appropriate to include the detailed geometry of a large group of lying or standing animals affecting the air flow in the building. It is necessary to have relatively simple models of the animals, which are easier to implement in the computer models. In this study laboratory measurements in a ventilated test room with "pig simulators" are compared with CFD-simulations.

KEY WORDS

Airflow pattern, Air velocity, CFD, Mixing ventilation, Livestock buildings.

INTRODUCTION

In recent years the use of Computational Fluid Dynamics (CFD) for prediction of airflow in office buildings and industrial buildings has increased significantly due to the extension of powerful desktop workstations and easy to use CFD-codes. The CFD tool is also an interesting possibility to predict airflow and air quality in modern livestock buildings, since there is an increasing attention on working environment and animal welfare. A number of authors have investigated the use of CFD for the

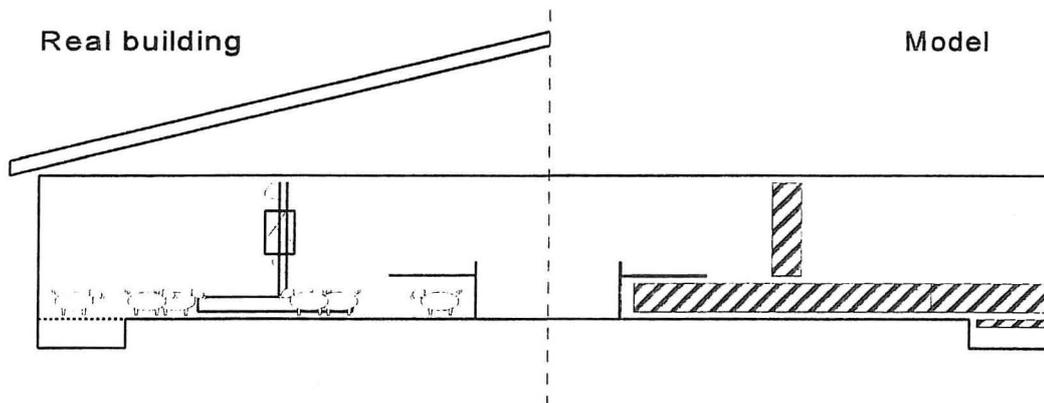


Figure 1 Groups of objects which are too complex to model in every detail can be modelled as volumes with certain characteristics.

prediction of air flow in livestock buildings, e.g. Harral et al (1997), Hoff et al (1992, 1995) and Svidt (1994).

For practical purposes it is not possible to model every detail of the building including all types of equipment and animals. To model the overall airflow pattern, a simpler model will often be adequate.

If the building in case has only a few internal walls or relatively large solid obstacles, it is obvious to model these objects in full detail. On the other hand, a less detailed model will easier to define in case of a large number of objects with a small extent compared to the entire flow domain. This will especially be the case for a group of animals which consists of a number of irregular objects placed in various positions or even moving around within a certain area or volume. Figure 1 shows an example of a building with animals, feeding equipment, pen partitions and a slatted floor as the major geometric objects affecting the air distribution. The right hand side of the figure illustrates that the model of simple geometries (pen partitions) is close to the real geometry, while the groups of more complex objects (animals, feeding equipment and slatted floor) are modelled as volumes with certain

characteristics. In the present study laboratory measurements in a ventilated test room with "pig simulators" are compared with CFD-simulations.

METHODS

Experiments are carried out in a full scale test room as shown in figure 2. The room dimensions are 3.00 x 8.50 x 5.00 metres. The inlet slot covers the full width of the room and its height is 19 mm. For the CFD boundary conditions, the effective inlet height h_{eff} is defined as:

$$h_{eff} = \frac{q}{W u_0} \quad (1)$$

where q : airflow rate [m^3/s]
 u_0 : inlet air velocity [m/s]
 W : with of the inlet [m]

The effective inlet height is 15 mm based on the measured inlet air velocity, 4.9 m/s and the measured air flow rate, 0.3675 m^3/s . To obtain a two-dimensional flow in the room, four guiding plates are mounted below the

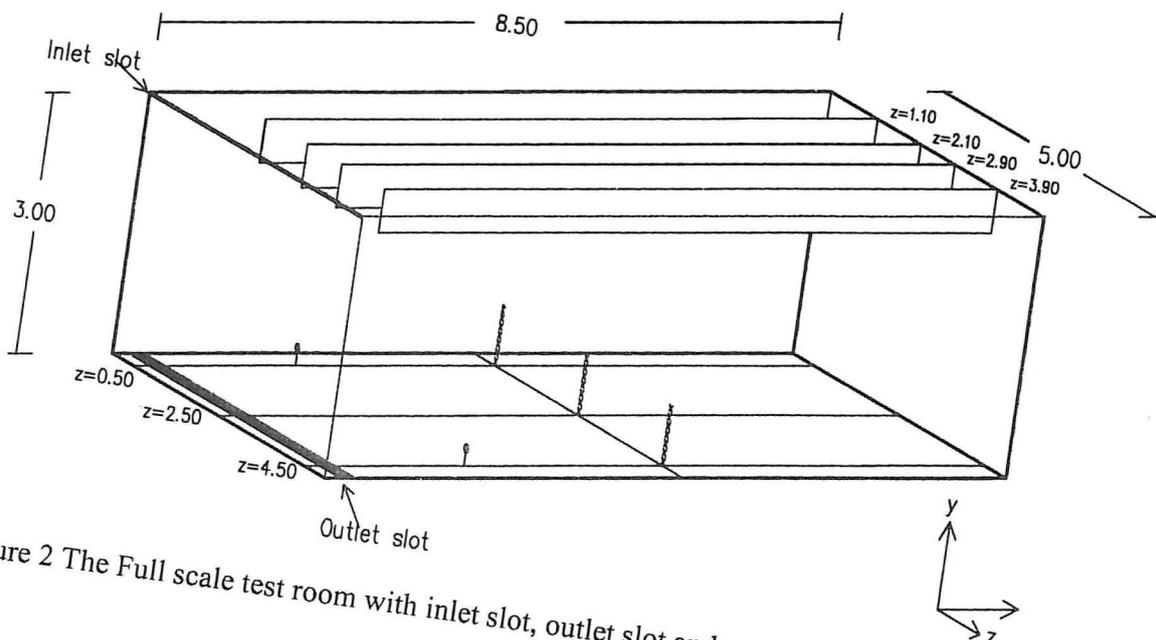


Figure 2 The Full scale test room with inlet slot, outlet slot and guiding plates.

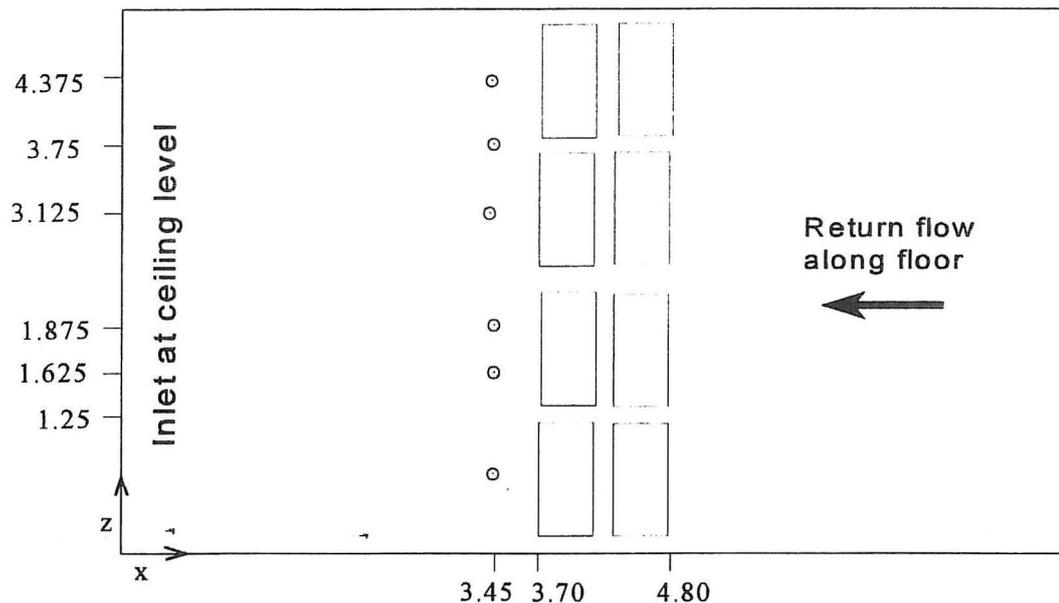


Figure 3 Plan view of the test room. Eight pig simulators are placed in the middle of the room. The position of the measurement columns is indicated downstream from the simulators.

ceiling as shown in figure 2. Air velocity and temperature was measured with a multi point measuring system (Zhang et. al. 1996). Seven sensors were mounted on each of three movable columns.

Eight pig simulators were placed on the floor as shown on the floor plan in figure 3. The cylinders are shaped as a half cylinder with the length 1.05 m and the diameter 0.50 m. Columns for velocity measurements are placed at $x = 3.45$ m which is 0.25 m downstream from the simulators. In the z -direction measurement positions are chosen to capture the velocity profiles behind the simulators as well as behind the gap between simulators.

The CFD simulations are carried out with commercial codes by use of the standard k, ϵ -model. The calculations are isothermal. A detailed three-dimensional model with approx. 200,000 cells as well as a simpler two-dimensional model with approx. 1,500 cells are investigated. In the two-dimensional model the pig simulators are described as a volume resistance causing a pressure drop as

used by Nielsen et al (1996, 1998):

$$\frac{\partial p}{\partial x} = \frac{f}{2} \rho u^2 \quad (2)$$

where $\partial p/\partial x$: Pressure drop [Pa/m]
 f : loss coefficient
 ρ : air density [kg/m^3]
 u : local air velocity [m/s]

RESULTS

The result of a three-dimensional CFD simulation is shown in figure 4 and 5. Figure 4 shows a section at $x = 1.625$ (see figure 3) and figure 5 shows a top view of the calculated flow 5 cm above the floor.

Figure 6 shows a comparison of the calculated and measured air velocities. The left hand side shows that the simulation predicts the position of the maximum velocity to be about 0.5 m above the floor which does not seem to be the case for the measurements. On the right hand side the air velocities

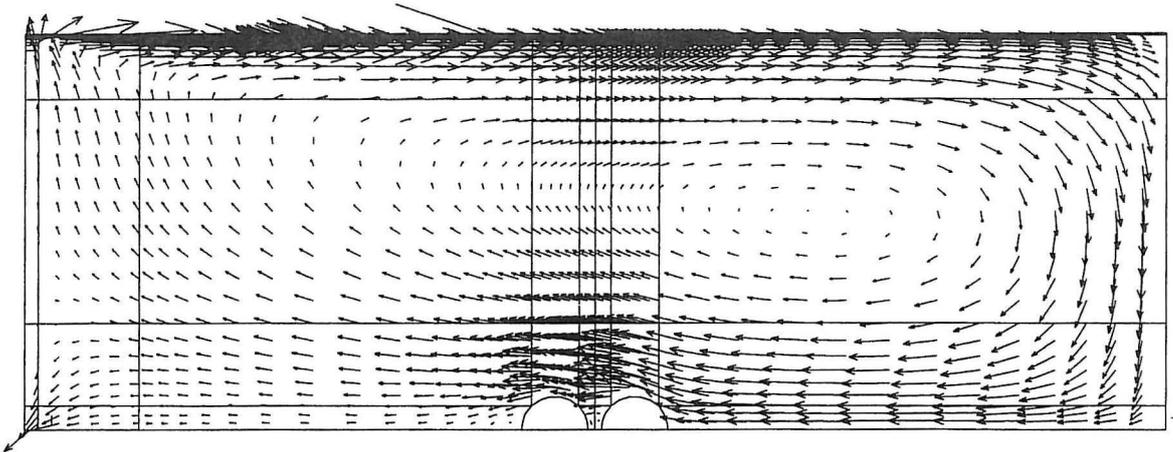


Figure 4 Section view of the calculated air flow with the three-dimensional model. This figure shows the flow field at $z = 1.625$ m (see figure 3).

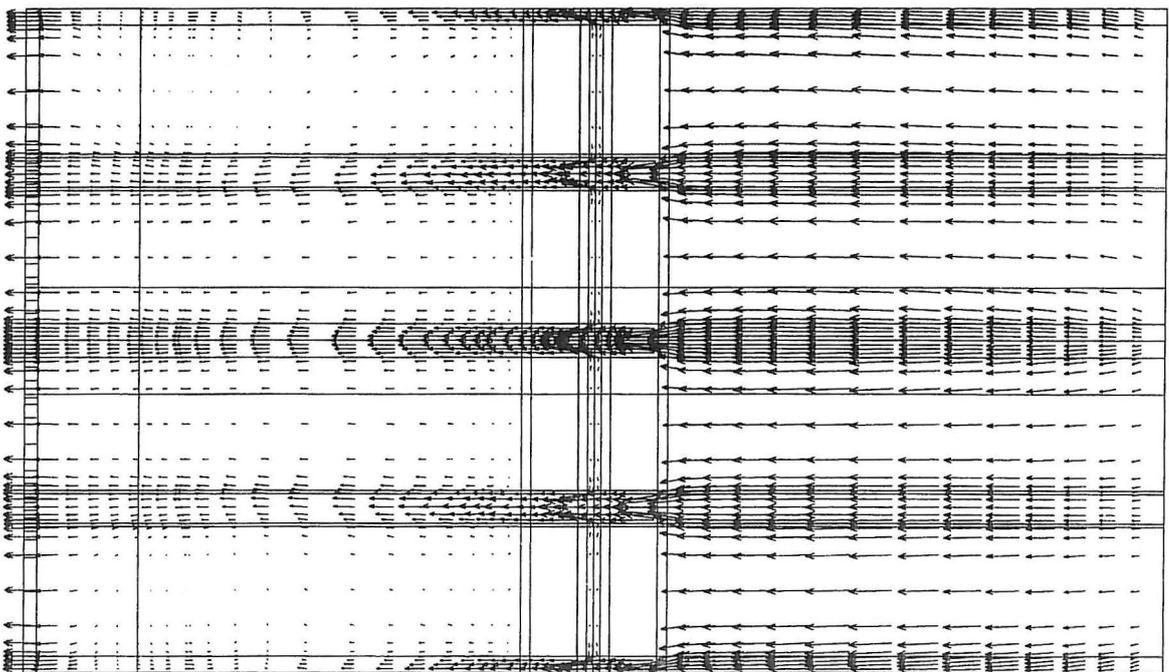


Figure 5 The calculated air flow 0.05 m above the floor.

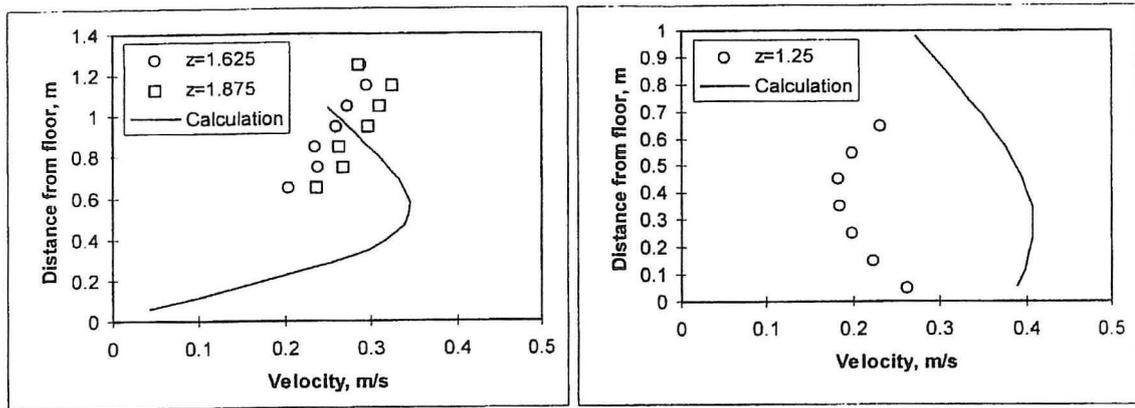


Figure 6 A comparison of the measured and calculated air velocities in the three-dimensional model. Behind a simulator (left) and behind the gap between simulators (right).

behind the gap between two simulators. Here the calculated velocity is significantly larger than the measured velocity.

In the two-dimensional calculations the cylindrical pig simulators are represented as a rectangular volume defined by a free area ratio and a pressure drop coefficient f . By the choice of coefficients the effect of the volume can be varied from no effect and up to the effect of a solid obstacle. Table 1 shows the combinations of model parameters studied, and the velocity profiles resulting from the different models are shown in figure 7. The free area ratio 0.16 has been defined as the total width of the gaps between the obstacles divided by the room width (see figure 3). The chosen range of loss coefficients f is based on experiences from Nielsen et al (1996,1998).

It is found that the models with the most solid representation of the volume have the best agreement with the present data. This is shown in figure 8 where the result of model 8 is compared with the air velocities measured downstream from the simulators at various z -positions.

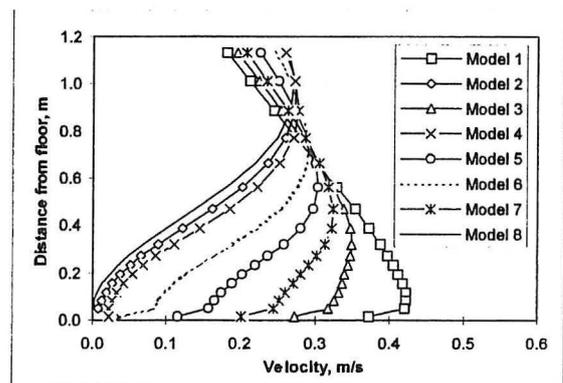


Figure 7 Velocity profiles resulting from various volume resistance models.

Table 1 Parameters of the models studied.

Model	Free area ratio	f
1	0.16	0.00
2	0.16	0.50
3	1.00	0.50
4	0.16	0.30
5	0.16	0.05
6	0.16	0.10
7	1.00	1.00
8	0.16	1.00

DISCUSSION

The internal geometry of a modern livestock building will normally be too complex to describe in a CFD-model. The equipment, floor construction and animals constitute elements of so many details that it is necessary to have a model that does not require the full description of all geometric details. This study has shown that it is possible to have a fair agreement between a simple model based on a volume resistance and the laboratory measurements for the specified case. However, no general recommendations for the choice of coefficients can be given on the basis of this single case. There is a need for further research to specify suitable coefficients for different types of equipment, construction details and animals.

ACKNOWLEDGEMENT

This research work has been supported financially by the Danish Agricultural and Veterinary Research Council.

REFERENCES

- Harral, B.B., Boon, C.R. (1997) Comparison of Predicted and Measured Air Flow Patterns in a Mechanically Ventilated Livestock Building without Animals. *Journal of Agricultural Engineering Research*, 66:221-228.
- Hoff, S.J., Janni, K.A., Jacobson, L.D. (1992) Three-Dimensional Bouyant Turbulent Flows in a Scaled Model Slot Ventilated Livestock Confinement Facility. *Transactions of the ASAE*, 35(2) 671-686.
- Hoff, S.J., Li, L., Tsao, L. (1995) Simulated and measured Effect of Rectangular Obstructions on Carbon Dioxide Gas Dispersion in a Scaled Swine Building. *Transactions of the ASAE*, 38(5) 1519-1532.
- Nielsen, J.R., Nielsen, P.V., Svidt, K. (1996) Obstacles in the Occupied Zone of a Room with Mixing Ventilation. *Proceedings of RoomVent'96, Fifth International Conference*
- Harral, B.B., Boon, C.R. (1997) Comparison of Predicted and Measured Air Flow Patterns in a Mechanically Ventilated Livestock Building without Animals. *Journal of Agricultural Engineering Research*, 66:221-228.
- Nielsen, J.R., Nielsen, P.V., Svidt, K. (1998) The influence of Furniture on Air Velocity in a Room - an Isothermal Case. *Proceedings of RoomVent'98, Sixth International Conference on Air Distribution in Rooms*, Stockholm, Sweden.
- Zhang, G, Strøm, J.S., Morsing, M. (1996) Computerized multi-point temperature and velocity measurement system. *Proceedings of RoomVent'96, Fifth International Conference on Air Distribution in Rooms*, Yokohama, Japan.
- Svidt, K. (1994) Investigation of Inlet Boundary Conditions for Numerical Prediction of Air Flow in Livestock Buildings. *Proceedings of RoomVent'94, Fourth International Conference on Air Distribution in Rooms*, Kraków, Poland.

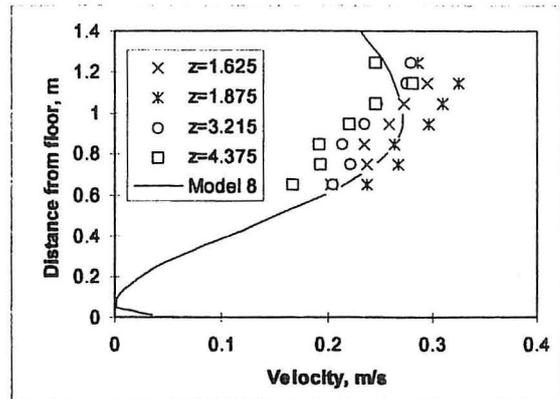


Figure 8 Velocity profile resulting from model 8 compared with measured air velocities at various positions behind the obstacles.

RECENT PAPERS ON INDOOR ENVIRONMENTAL ENGINEERING

PAPER NO. 79: P.V. Nielsen: *Design of Local Ventilation by Full-Scale and Scale Modelling Techniques*. ISSN 1395-7953 R9743.

PAPER NO. 80: P. Heiselberg, K. Svidt, H. Kragh: *Application of CFD in Investigation of Ventilation Strategies for Improvement of Working Environment in a Waste Incineration Plant*. ISSN 1395-7953 R9745.

PAPER NO. 81: P. Heiselberg, C. Topp: *Removal of Airborne Contaminants from a Surface Tank by a Push-Pull System*. ISSN 1395-7953 R9746.

PAPER NO. 82: P. Heiselberg: *Simplified Method for Room Air Distribution Design*. ISSN 1395-7953 R9747.

PAPER NO. 83: L. Davidson, P.V. Nielsen: *A Study of Laminar Backward-Facing Step Flow*. ISSN 1395-7953 R9802.

PAPER NO. 84: P.V. Nielsen: *Airflow in a World Exposition Pavilion Studied by Scale-Model Experiments and Computational Fluid Dynamics*. ISSN 1395-7953 R9825.

PAPER NO. 85: P.V. Nielsen: *Stratified Flow in a Room with Displacement Ventilation and Wall-Mounted Air Terminal Devices*. ISSN 1395-7953 R9826.

PAPER NO. 86: P.V. Nielsen: *The Selection of Turbulence Models for Prediction of Room Airflow*. ISSN 1395-7953 R9828.

PAPER NO. 87: K. Svidt, G. Zhang, B. Bjerg: *CFD Simulation of Air Velocity Distribution in Occupied Livestock Buildings*. ISSN 1395-7953 R9831.

PAPER NO. 88: P. V. Nielsen, T. Tryggvason: *Computational Fluid Dynamics and Building Energy Performance Simulation*. ISSN 1395-7953 R9832.

PAPER NO. 89: K. Svidt, B. Bjerg, S. Morsing, G. Zhang: *Modelling of Air Flow through a Slatted Floor by CFD*. ISSN 1395-7953 R9833.

PAPER NO. 90: J.R. Nielsen, P.V. Nielsen, K. Svidt: *The Influence of Furniture on Air Velocity in a Room - An Isothermal Case*. ISSN 1395-7953 R9843.

PAPER NO. 91: P. Lengweiler, J.S. Strøm, H. Takai, P. Ravn, P.V. Nielsen, A. Moser: *Dust Load on Surfaces in Animal Buildings: An Experimental Measuring Method*. ISSN 1395-7953 R9844.

PAPER NO. 92: P. Lengweiler, P.V. Nielsen, A. Moser, P. Heiselberg, H. Takai: *Deposition and Resuspension of Particles: Which Parameters are Important?* ISSN 1395-7953 R9845.

PAPER NO. 93: C. Topp, P.V. Nielsen, P. Heiselberg, L.E. Sparks, E.M. Howard, M. Mason: *Experiments on Evaporative Emissions in Ventilated Rooms*. ISSN 1395-7953 R9835.

PAPER NO. 94: L. Davidson, P.V. Nielsen: *A Study of Low-Reynolds Number Effects in Backward-Facing Step Flow using Large Eddy Simulations*. ISSN 1395-7953 R9834.

Complete list of papers: <http://iee.civil.auc.dk/i6/publ/iee.html>

CFD Simu

ISSN 1395-7953 R9831

Dept. of Building Technology and Structural Engineering

Aalborg University, September 1998

Sohngaardsholmsvej 57, DK-9000 Aalborg, Denmark

Phone: +45 9635 8080 Fax: +45 9814 8243

<http://iee.civil.auc.dk>