



AALBORG UNIVERSITY
DENMARK

Aalborg Universitet

Hybrid Three-Phase/Single-Phase Microgrid Architecture with Power Management Capabilities

Sun, Qiuye; Zhou, Jianguo; Guerrero, Josep M.; Zhang, Huaguang

Published in:
I E E E Transactions on Power Electronics

DOI (link to publication from Publisher):
[10.1109/TPEL.2014.2379925](https://doi.org/10.1109/TPEL.2014.2379925)

Publication date:
2015

Document Version
Early version, also known as pre-print

[Link to publication from Aalborg University](#)

Citation for published version (APA):
Sun, Q., Zhou, J., Guerrero, J. M., & Zhang, H. (2015). Hybrid Three-Phase/Single-Phase Microgrid Architecture with Power Management Capabilities. *I E E E Transactions on Power Electronics*, 30(10), 5964 - 5977 .
<https://doi.org/10.1109/TPEL.2014.2379925>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Hybrid Three-Phase/Single-Phase Microgrid Architecture with Power Management Capabilities

Qiuye Sun, *Member, IEEE*, Jianguo Zhou, Josep M. Guerrero, *Fellow, IEEE*, and Huaguang Zhang, *Senior Member, IEEE*

Corresponding Author: Jianguo Zhou, School of Information Science and Engineering, Northeastern University, Shenyang 110819, China. Phone: +86-24-83683907, Fax: +86-24-83689605, Email: JianguoZhou.NEU@gmail.com.

Abstract—With the fast proliferation of single-phase distributed generation (DG) units and loads integrated into residential microgrids, independent power sharing per phase and full use of the energy generated by DGs have become crucial. To address these issues, this paper proposes a hybrid microgrid architecture and its power management strategy. In this microgrid structure, a power sharing unit (PSU), composed of three single-phase back-to-back (SPBTB) converters, is proposed to be installed at the point of common coupling (PCC). The aim of the PSU is mainly to realize the power exchange and coordinated control of load power sharing among phases, as well as to allow fully utilization of the energy generated by DGs. Meanwhile, the method combining the modified adaptive backstepping-sliding mode control approach and droop control is also proposed to design the SPBTB system controllers. With the application of the proposed PSU and its power management strategy, the loads among different phases can be properly supplied and the energy can be fully utilized as well as obtaining better load sharing. Simulation and experimental results are provided to demonstrate the validity of the proposed hybrid microgrid structure and control.

Index terms—microgrid, power sharing, energy utilization, adaptive backstepping-sliding-mode control, droop control.

I. INTRODUCTION

With the high penetration of DGs, the concept of microgrids that can operate in either grid-connected or islanded modes is becoming more attractive [1]-[5]. A microgrid is a local controllable low-voltage distribution network consisting of a number of DGs, energy storage systems, and dispersed loads. DGs are often connected to the microgrid through power electronic interface converters, which are aimed at controlling the power injection while improving the power quality at the same time. Both the customers and power utilities can benefit from the microgrid concept, which can offer diversified energy options and high power quality and reliability [6]-[10]. Additionally, the use of low or zero emission generators in microgrids can increase the overall efficiency of energy utilization, dealing with environmental concerns, such as CO₂ emissions and reduction of dependence on conventional power generation [11], [12].

Accurate power management control among DGs is an important issue for the autonomous operation of microgrids. Typically, frequency and voltage droop control schemes are adopted to achieve power sharing among DGs without relying on communication [9], [10], [13]. Nevertheless, droop controlled microgrids are prone to have some stability and power sharing accuracy problems due to complex feeder impedances and high control gains [14]-[16]. To address these problems, stability-constrained and adaptive decentralized droop controllers have been proposed in [17]-[19]. In [20], the reactive power sharing accuracy was improved with the consideration of impedance voltage drop, the DG local load effects and the use of a virtual inductor loop. Methods based on virtual complex impedance loop and reactive power control error estimation were also proposed in [21] and [22], respectively. In order to mitigate the voltage and frequency deviations [23] produced by the conventional droop controllers, secondary control loops by using central PI compensators and decentralized networked control systems have been proposed [24]-[26]. The research works mentioned above, however, are mainly concentrated on DG control within a microgrid. Although much rarely seen, droop control applied to interlinked microgrids using back-to-back converters (BTB) can be found in [27]-[29], where, with the bidirectional control of the power flow, the specific amount of active and reactive power between utility and microgrid can be facilitated.

It is worth noting that the aforementioned research works were mostly confined to three-phase microgrid system and little work has been done and reported in the area of load power sharing and power flow control in single-phase microgrids, especially interlinked single-phase microgrids. Commonly, in a real microgrid, single-phase DG units are very common, and a growing number of single-phase DGs are being installed in microgrids [30]-[35]. Nevertheless, methods applied in three-phase systems cannot be directly applied in single-phase ones.

The operation and reactive power compensation of the single-phase micro-sources by using STATCOM were proposed and discussed in [30] and [31], respectively. In traction power system, single-phase back-to-back converters were utilized to achieve active power balancing, reactive power compensation, and harmonic mitigation [32]. Additionally, the active filtering strategy was also be researched for the single-phase high-frequency AC microgrid in [33]. Further, a power sharing approach for islanding single-phase microgrid was proposed by using virtual impedance at fundamental and selective harmonic frequencies, trading-off DG terminal voltage THD and harmonic current sharing [34]. However, all these works were mainly focused on power quality issues.

Regarding bidirectionality in terms of power flow, a modular multilevel cascade BTB system with particular focus on control, design and performances has been discussed by Akagi in [28]. This BTB system characterized by the use of multiple bidirectional isolated dc/dc converters was connected between two 6.6 kV feeders, which can realize directional power flow control between feeders. Other applications of rural microgrids connected to the grid by means of a back-to-back converter can be found in [27] and [39]. However, only three-phase centralized system was discussed in this BTB application.

For the best knowledge of the authors, no research works have been reported about the power sharing and power flow control among individual phases of three-phase microgrids. In order to achieve it, a power sharing unit (PSU) and its operation and power management strategy are proposed in this paper. At first, the structure and operation principle of the proposed PSU is presented in detail in Section II. Section III presents the design of the internal and external control loops of the PSU. Section IV provides simulation and experimental results to demonstrate the effectiveness of the proposed PSU and power management. Finally, Section V gives the conclusion.

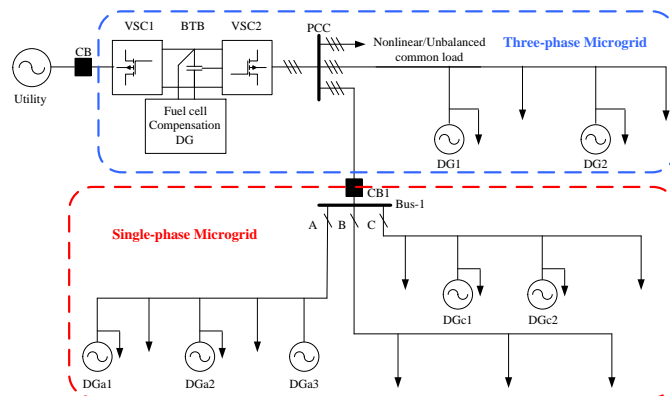


Fig. 1 Structure of the microgrid system under consideration.

II. STRUCTURE AND OPERATION PRINCIPLES OF THE PROPOSED POWER SHARING UNIT

Fig. 1 shows the microgrid system under consideration, in which both three-phase and single-phase microgrids areas are connected to the utility grid through a three-phase BTB converter. Note that phase-A and phase-C contains DG units and some local loads, while phase-B has no DGs but loads. In such a configuration, even if the power generated by these DGs is larger than the load power demand in the two phases, the loads in the other phase (phase-B) will not be supplied when the single-phase microgrid is disconnected from the utility grid (CB1 open).

In the microgrid system, two operation modes, grid-connected and islanded modes are considered. Particularly, it should be noted that the operation mode and control of the single-phase and three-phase microgrid areas are independent in islanded mode, when CB1 is open, as shown in Fig. 2.

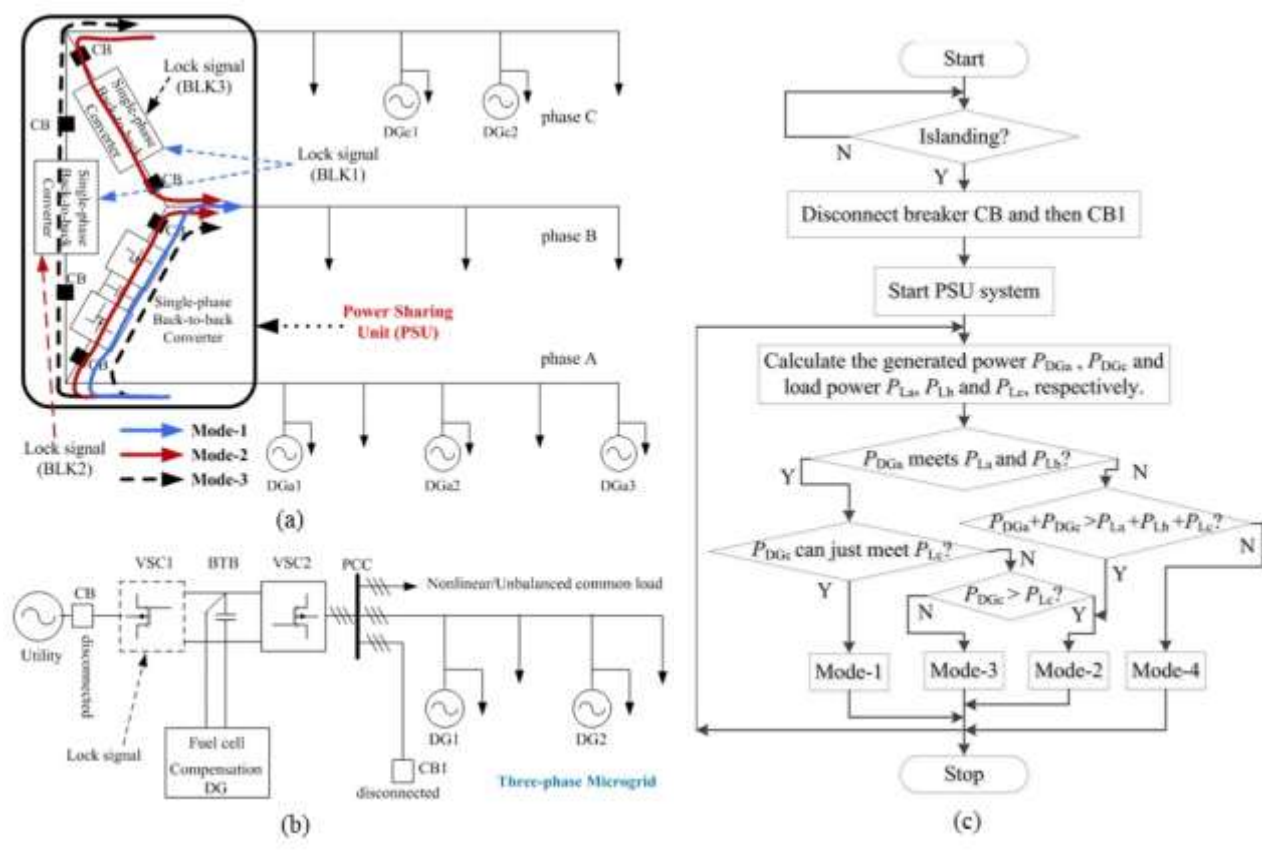


Fig. 2 Detailed schematic diagram of the microgrid: (a) single-phase and (b) three-phase parts; (c) flow-chart for different operating modes.

In grid-connected mode, the single-phase microgrid, although there is no DG installed in phase-B, the load power demand in phase-B can be supplied by the utility grid. Nevertheless, when the microgrid is disconnected from the utility grid (CB open), the three-phase and single-phase microgrid areas will operate in islanded mode. Considering that the PCC voltage can be unbalanced and distorted seriously at the same time, independent operation of the three-phase and

single-phase microgrids is preferred (CB1 open). In this case, the loads in phase-B will lose the power supply and may not operate normally unless they can be supplied by some other power source. On the other hand, the power generated by DGs in phase-A and phase-C can be adequate, but will be restricted by the load power demand. So that the renewable energy such as wind or solar will be wasted. Additionally, it should be noted that the installation of DG such as rooftop PV system is determined by customers, including the unbalance situation in which few DGs are interfaced to one phase while other phases may be connected to a number of DGs. It should be emphasized that such microgrids widely exist in practice, such as residential customers in remote rural areas, multiple neighboring communities, and business districts. By taking residential customers in remote rural areas as an example, they usually suffer from low power quality and low reliability of power supply, due to the long distances from main power stations, large grid impedances, and weak grid voltage. However, renewable energy resources such as wind energy and solar energy in these areas are often adequate, thus small DGs can be installed near to the point of consumption. However DGs cannot always be installed in some areas due to geographical factors. Consequently, sometimes it is necessary to develop an appropriate strategy to guarantee the power supply quality and availability of these areas where DGs are not installed or the capacity of DGs is small [27], [39].

Therefore, a power sharing unit (PSU), as shown in Fig. 2(a), installed at Bus-1 (see Fig. 1) is proposed to overcome this problem. The structure and operation modes principle are presented in Fig. 2(a), where the PSU, which is composed of three voltage-source-based single-phase back-to-back converters which are delta connected, enables the power generated by DGs to be transmitted from one phase to another, ensuring the loads supplied uninterruptedly. Although a star structure would save three converters, the reason why a delta connected structure rather than the star structure is considered in this paper mainly could be summarized as follows. (i) *Higher reliability*: the fault tolerance is higher since in case of star connection, the power exchange between two phases would not be achieved when dc-link faults are happened. This scenario can be avoided by using the delta connected structure even if the dc-link of one of the back-to-back converters fails. Power exchange between two phases may be realized through the other two back-to-back converters. (ii) *Smaller dc-link capacitance* is needed to achieve similar performances for the same amount of transferred power from one phase to the other two phases. (iii) *Hot-swap capability*: It is easier and more flexible to maintain the delta connected PSU compared to the star connected PSU. Within the delta connected PSU, only one back-to-back converter should be stopped and maintained with proper control and protection strategy when faults happens to the dc-link or VSC while the whole PSU equipment will be stopped for the star structure.

The PSU system depending on the power requirements in the microgrid can run in different modes: mode-1, load power demand in phase-B is supplied by DGs in phase-A; mode-2, load power demand in phase-B is supplied and shared

coordinately by DGs in phase-A and phase-C; mode-3, load power demand in phase-B and phase-C is supplied by DGs in phase-A. Specifically, in mode-1 shown in Fig. 2(a) with blue lines, loads in phase-B are shared only by DGs in phase-A through the SPBTB1 in the PSU since the power generated by DGs in phase-C can just meet load demand in its phase. In this case, SPBTB2 and SPBTB3 will be blocked with the corresponding signal BLK1 for the sake of safety and efficiency. When the power transmitted from phase-A cannot meet the power demand in phase-B and the power generated by DGs in phase-C is more than its phase load demand, the operation of the PSU will be changed from mode-1 to mode-2 shown in Fig. 2(a) with solid red lines. This mode can provide more reliable power supply and coordinated load power sharing realized by droop controllers for phase-B loads by DGs in phase-A and phase-C through SPBTB1 and SPBTB2 of the PSU. The SPBTB3 will be locked with the input signal BLK2. When power generated by DGs in phase-C is less than the power demand, the operation of the PSU will be changed to mode-3 shown in Fig. 2(a) with black dashed lines. In this mode, DGs in phase-A will not only share the load power of phase-B but also share the rest power requirement of phase-C. The SPBTB2 will be locked with the input signal BLK3 in this mode. The situation is similar to that of phase-B if there is no DG installed in phase-A or phase-C. Fig. 2(c) shows the flow-chart indicating the choices for showing the different operating modes.

Coordinated load power sharing control and power flow exchange among phases can be realized with the application of the proposed PSU in the microgrid, ensuring the loads supplied reliably, flexibly and uninterruptedly and achieving higher efficiency of energy utilization in islanded mode under the condition that the whole generated power of three phases can meet the whole load demand. Application of the PSU in such microgrids is helpful to enhance power supply reliability, flexibility for residential customers in remote rural areas, multiple neighboring communities, and business districts in practice. Additionally, it also allows improving efficiency of energy utilization and save investments of transmission and distribution. In the following, we mainly focus on modeling and nonlinear controller design of SPBTB of PSU for the power sharing.

III. MODELING AND CONTROL DESIGN OF SPBTB OF PSU

A. Modeling of SPBTB

The modeling of SPBTB system is based on the principal circuit analysis and voltage and current equations for storage elements known as state equation. The equivalent circuit of SPBTB is shown in Fig. 3.

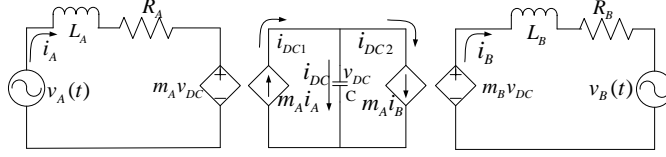


Fig. 3 The equivalent circuit of SPBTB.

Although d - q transformation and controller design in rotating coordinates are simple and powerful with respect to improving performance at the fundamental frequency, it is not directly applicable to single-phase power converters. Single-phase d - q transformation method [36] is adopted in this paper, and then the model of the SPBTB converter in the synchronous d - q reference frame is given as:

$$\begin{cases} \frac{di_{Ad}}{dt} = -\frac{R_A}{L_A} i_{Ad} + \omega_A i_{Aq} + \frac{1}{L_A} (v_{Ad} - v_{DC} m_{Ad}) \\ \frac{di_{Aq}}{dt} = -\frac{R_A}{L_A} i_{Aq} - \omega_A i_{Ad} + \frac{1}{L_A} (v_{Aq} - v_{DC} m_{Aq}) \\ \frac{dv_{DC}^2}{dt} = \frac{3}{C} (v_{Ad} i_{Ad} + v_{Aq} i_{Aq}) - \frac{2v_{DC}^2}{R_p C} - \frac{2P_{load}}{C} \end{cases} \quad (1)$$

$$\begin{cases} \frac{di_{Bd}}{dt} = -\frac{R_B}{L_B} i_{Bd} + \omega_B i_{Bq} + \frac{1}{L_B} (v_{DC} m_{Bd} - v_{Bd}) \\ \frac{di_{Bq}}{dt} = -\frac{R_B}{L_B} i_{Bq} - \omega_B i_{Bd} + \frac{1}{L_B} (v_{DC} m_{Bq} - v_{Bq}) \end{cases} \quad (2)$$

where m_{Ad} , m_{Aq} , m_{Bd} and m_{Bq} are the modulation index, R_p is converter loss resistor, ω_A and ω_B are angular frequencies of two microgrids, respectively. Obviously, the above mathematical model of SPBTB is nonlinear.

Taking uncertainties into account, we can write the system (1) as follows:

$$\dot{x} = \bar{f}(x) + \Delta f(x) + \sum_{i=1}^m g_i(x) u_i \quad (3)$$

where the calculation methods of $\bar{f}(x)$, $\Delta f(x)$, $g_i(x)$ and u_i are given in Appendix A. we choose the output variables as:

$$y = h(x) = \begin{bmatrix} v_{DC}^2 \\ L_f h_1(x) \\ i_{Ad} \end{bmatrix} \quad (4)$$

According to the derivation rule of Lee derivative and the constructed new control inputs:

$$\begin{bmatrix} \bar{u}_d \\ \bar{u}_q \end{bmatrix} = \begin{bmatrix} L_{g_1} L_{\bar{f}} h_1(x) u_d + L_{g_2} L_{\bar{f}} h_1(x) u_q \\ L_{g_1} h_2(x) u_d + L_{g_2} h_2(x) u_q \end{bmatrix} \quad (5)$$

The dynamic model of the system (1) in the new coordinate can be written as follows:

$$\begin{cases} \dot{y}_1 = f_1(y_1) + G_1 y_2 + \phi_1^T(y_1)\theta \\ \dot{y}_2 = f_2(y_1, y_2) + G_2 \bar{u}_d + \phi_2^T(y_1, y_2)\theta \end{cases} \quad (6)$$

$$\dot{y}_3 = f_3(y_3) + G_3 \bar{u}_q + \phi_3^T(y_3)\theta \quad (7)$$

where the new system (6) and (7) are the decoupled subsystems which are strict feedback form, respectively.

Using the similar approach, the dynamic model of system (2) in the new coordinate can also be obtained:

$$\begin{cases} \dot{y}_4 = L_f h_4(x) + L_{g4} h_4(x) u_{d1} \\ \dot{y}_5 = L_f h_5(x) + L_{g5} h_5(x) u_{q1} \end{cases} \quad (8)$$

The calculation methods of all terms in (4) to (8) are given in Appendix B.

B. Design of nonlinear controller of SPBTB

The control of the VSC-based SPBTB in the PSU is the key problem. Presently, the PI controllers and proportional multiresonant controllers are usually applied to the inverter-based microgrid as well as droop control method. But recently, adaptive backstepping method is applied to the power electronic system [37], [38], which allows the designer to incorporate most system nonlinearities and uncertainties in the design of the controller. The modified backstepping control method has been utilized to design the controller of BTB VSC system which is applied in HVDC, wind generation system, and hybrid power system such as transmission transformer (partial) bypass. On the other hand, sliding mode control is an effective robust control method due to the invariance for the disturbance and uncertain parameters. A novel modified adaptive backstepping-sliding mode control approach is therefore applied to design the nonlinear controller of PSU. This approach not only can overcome the system nonlinearities and uncertainties but also improve the performance of robustness.

In the SPBTB of the PSU system, one converter controls the dc-link voltage and supports its reactive power and the other one controls the active and reactive powers. The overall structure of the control system of the SPBTB in the PSU system is shown in Fig. 4 where the control system mainly includes DC link voltage controller, modified adaptive backstepping controller and droop controller, which are described in detail in the following.

The controller design steps are given in the following. Firstly, the controller design of VSC1 is conducted.

Step 1) For the subsystem (6), the tracking error is defined by

$$z_1 = y_1 - y_{1ref} \quad (9)$$

Then, the dynamics is given by

$$\dot{z}_1 = \dot{y}_1 - \dot{y}_{1ref} = f_1(y_1) + G_1 y_2 + \phi_1^T(y_1)\theta - \dot{y}_{1ref} \quad (10)$$

To start backstepping, y_2 is chosen as the virtual control input variable, and we define another tracking error $z_2 = y_2 - \alpha_2$.

The virtual stabilizing function is chosen as

$$\alpha_2 = \frac{1}{G_1} [-f_1(y_1) - \phi_1^T(y_1)\hat{\theta} - c_1 z_1 + \dot{y}_{1ref}] \quad (11)$$

The parameter estimation error is defined as $\tilde{\theta} = \theta - \hat{\theta}$. Combining the definition of z_2 , equation (10) can be written as

$$\dot{z}_1 = -c_1 z_1 + G_1 z_2 + \phi_1^T(y_1)\tilde{\theta}. \quad (12)$$

Step 2) The sliding surface is defined as $s = d_1 z_1 + z_2$, and the Lyapunov function is selected as

$$V_1 = \frac{1}{2} z_1^2 + \frac{1}{2} s^2 + \frac{1}{2} \tilde{\theta}^T \Gamma^{-1} \tilde{\theta} \quad (13)$$

Then, the derivative of z_2 and the selected Lyapunov function is obtained as follows:

$$\begin{aligned} \dot{z}_2 &= f_2(y_1, y_2) + G_2 \bar{u}_d + \phi_2^T(y_1, y_2)\theta - \frac{d\alpha_2}{dy_1} (f_1(y_1) + G_1 y_2 \\ &+ \phi_1^T(y_1)\theta) - \frac{d\alpha_2}{d\hat{\theta}} \dot{\hat{\theta}} \end{aligned} \quad (14)$$

$$\begin{aligned} \dot{V}_1 &= z_1 \dot{z}_1 + s \dot{s} - \tilde{\theta}^T \Gamma^{-1} \dot{\hat{\theta}} \\ &= -c_1 z_1^2 + G_1 z_1 z_2 + z_1 \phi_1^T(y_1)\tilde{\theta} - \tilde{\theta}^T \Gamma^{-1} \dot{\hat{\theta}} + s[-d_1 c_1 z_1 + d_1 G_1 z_2 + d_1 \phi_1^T(y_1)\tilde{\theta} + f_2(y_1, y_2) + G_2 \bar{u}_d + \\ &\phi_2^T(y_1, y_2)\theta - \frac{d\alpha_2}{dy_1} (f_1(y_1) + G_1 y_2 + \phi_1^T(y_1)\theta) - \frac{d\alpha_2}{d\hat{\theta}} \dot{\hat{\theta}}] \end{aligned} \quad (15)$$

The feedback control law and the parameter adaptation law can be designed as follows:

$$\begin{aligned} \bar{u}_d &= \frac{1}{G_2} [d_1 c_1 z_1 - d_1 G_1 z_2 - f_2(y_1, y_2) - \phi_2^T(y_1, y_2)\hat{\theta} + \frac{d\alpha_2}{dy_1} \\ &(f_1(y_1) + G_1 y_2 + \phi_1^T(y_1)\hat{\theta}) + \frac{d\alpha_2}{d\hat{\theta}} \dot{\hat{\theta}} - \gamma s - G_1 z_1 z_2 / s] \end{aligned} \quad (16)$$

$$\dot{\hat{\theta}}^r = [z_1 \phi_1^T(y_1) + s(d_1 \phi_1^T(y_1) + \phi_2^T(y_1, y_2)) - \frac{d\alpha_2}{dy_1} \phi_1^T(y_1)] \Gamma \quad (17)$$

Combing (15) (16) and (17), the derivative of Lyapunov function becomes

$$\dot{V}_1 = -c_1 z_1^2 - \gamma s^2. \quad (18)$$

With the suitable choices of $c_1 > 0$ and $\gamma > 0$, the requirement of $\dot{V}_1 \leq 0$ can be met.

For the subsystem (7), the tracking error is defined as

$$z_3 = y_3 - y_{3ref} \quad (19)$$

then, the dynamics can be obtained:

$$\dot{z}_3 = \dot{y}_3 - \dot{y}_{3ref} = f_3(y_3) + G_3 \bar{u}_q + \phi_3^T(y_3)\theta - \dot{y}_{3ref}. \quad (20)$$

We consider a new Lyapunov function as

$$V_2 = \frac{1}{2} z_3^2 \quad (21)$$

then the derivative of (21) is

$$\begin{aligned} \dot{V}_2 &= z_3 \dot{z}_3 \\ &= z_3 (f_3(y_3) + G_3 \bar{u}_q + \phi_3^T(y_3)\theta - \dot{y}_{3ref}). \\ &= z_3 (f_3(y_3) + G_3 \bar{u}_q - \dot{y}_{3ref}) \end{aligned} \quad (22)$$

The control law is therefore chosen as

$$\bar{u}_q = \frac{1}{G_3} [-f_3(y_3) + \dot{y}_{3ref} - c_3 z_3]. \quad (23)$$

Substituting (23) into (22), the requirement $\dot{V}_2 = -c_3 z_3^2 \leq 0$ can be met with the suitable choice of $c_3 > 0$.

In the following, the design of the controller of VSC2 that controls the active and reactive power sharing between two ac systems will be discussed in detail. Specifically, the inner-loop controller will be designed with the aforementioned modified adaptive backstepping-sliding mode control method.

The controller design of subsystem (8) is as follows.

The tracking errors are defined by

$$\begin{cases} z_4 = y_4 - y_{4ref} \\ z_5 = y_5 - y_{5ref} \end{cases} \quad (24)$$

and taking the time derivative of (24) yields

$$\begin{cases} \dot{z}_4 = \dot{y}_4 - \dot{y}_{4ref} = L_f h_4(x) + L_{g4} h_4(x) u_{d1} - \dot{y}_{4ref} \\ \dot{z}_5 = \dot{y}_5 - \dot{y}_{5ref} = L_f h_5(x) + L_{g5} h_5(x) u_{q1} - \dot{y}_{5ref} \end{cases} \quad (25)$$

The Lyapunov function is given by

$$V = \frac{1}{2}z_4^2 + \frac{1}{2}z_5^2 \quad (26)$$

the derivative of the Lyapunov function is

$$\begin{aligned} \dot{V} &= z_4\dot{z}_4 + z_5\dot{z}_5 \\ &= z_4(L_f h_4(x) + L_{g_4} h_4(x)u_{d1} - \dot{y}_{4ref}) + z_5(L_f h_5(x) + L_{g_5} h_5(x)u_{q1} - \dot{y}_{5ref}) \end{aligned} \quad (27)$$

If we choose the feedback control laws as

$$\begin{aligned} u_{d1} &= \frac{1}{L_{g_4} h_4(x)} [-L_f h_4(x) + \dot{y}_{4ref} - c_4 z_4] \\ u_{q1} &= \frac{1}{L_{g_5} h_5(x)} [-L_f h_5(x) + \dot{y}_{5ref} - c_5 z_5] \end{aligned} \quad (28)$$

and with suitable choices of $c_4, c_5 > 0$, the derivative of the Lyapunov function can be given as

$$\dot{V} = -c_4 z_4^2 - c_5 z_5^2 \leq 0. \quad (29)$$

Since \dot{V} is negative-definite, the states z_4 and z_5 can converge to zero, and the tracking requirements can be met.

C. Power management via droop control

To achieve coordinated load active and reactive power sharing among phases through the SPBTB-based PSU system, droop control method given in (30) is implemented to design the VSC outer-loop controller.

$$\begin{aligned} \omega &= \omega_0 - m \cdot (P_0 - P) \\ E &= E_0 - n \cdot (Q_0 - Q) \end{aligned} \quad (30)$$

where m is the frequency droop coefficient, n is the voltage droop coefficient, ω_0 is the nominal frequency, E_0 is the rated phase voltage magnitude, P_0 and Q_0 are the active and reactive power rated capacity of the SPBTB converter. The droop coefficients m and n are taken proportional to rated power of SPBTBs for power sharing among them.

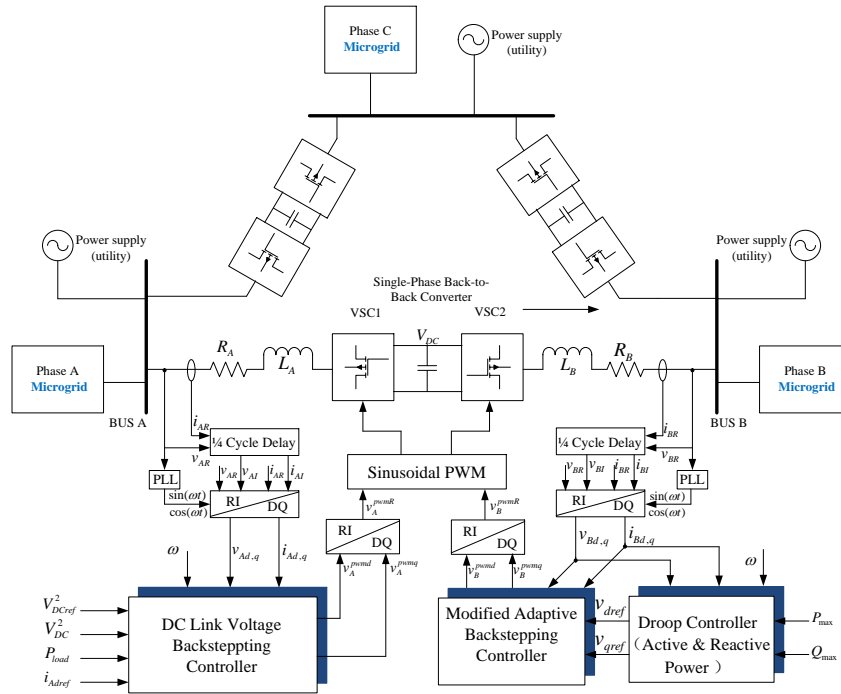


Fig. 4 Block diagram of the global control system.

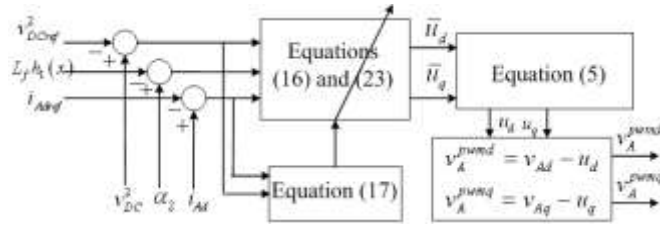


Fig. 5 Block diagram of the DC-link voltage control system of VSC1.

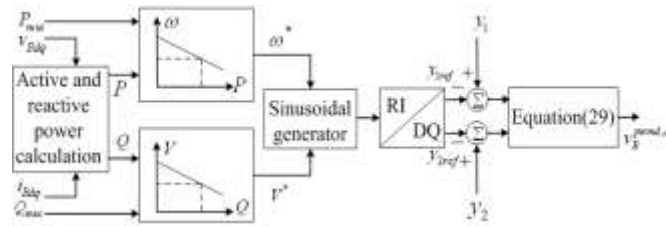


Fig. 6 The detailed block diagram of the active and reactive power control system of VSC2.

The block diagrams of the control system of the SPBTB converter are shown in Fig. 4. Specifically, the DC link voltage controller of VSC1 is shown in Fig. 5. The controllers of VSC2 including droop controller are shown in Fig. 6. The controllers of VSC1 and VSC2 are mainly to maintain the dc link voltage and to control the active and reactive power, respectively.

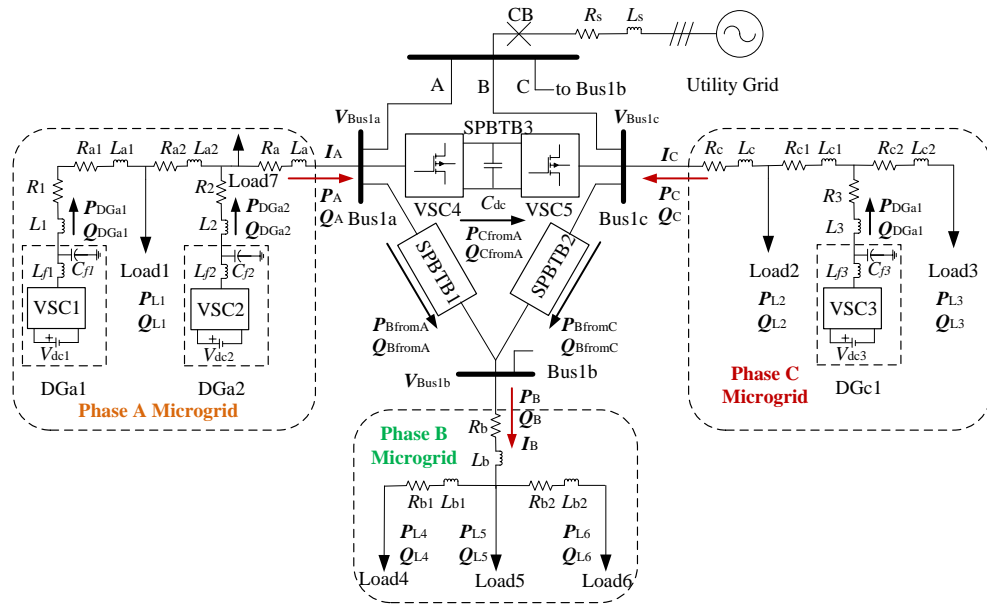


Fig. 7 The test single-phase microgrid with SPBTB.

TABLE I
TEST SYSTEM AND CONTROLLER PARAMETERS

System Quantities	Values
Utility grid	
Frequency	50Hz
Source voltage	380V rms (L-L)
Feeder impedance	$R_s=1\Omega, L_s=0.5\text{mH}$
DGs and SPBTB VSCs	
DC voltage	$V_{dc1}=V_{dc2}=V_{dc3}=400\text{V}$
Filter inductances and capacitances	$L_{f1}=L_{f2}=L_{f3}=1.35\text{mH}$ $C_{f1}=C_{f2}=C_{f3}=100\mu\text{F}$
Coupling impedance	$R_1=R_2=R_3=1\Omega, L_1=L_2=L_3=0.25\text{mH}$
Rated capacity	$P_{RDGA1}=14\text{kW}, Q_{RDGA1}=6\text{kVar}$ $P_{RDGA2}=21\text{kW}, Q_{RDGA2}=9\text{kVar}$ $P_{RDGC1}=3\text{kW}, Q_{RDGC1}=1.3\text{kVar}$
Back-to-back efficiency	87.43%
Microgrid line impedance	$R_a=R_b=R_c=0.5\Omega,$ $L_a=L_b=L_c=0.25\text{mH}$ $R_{a1}=R_{a2}=R_{b1}=R_{b2}=R_{c1}=R_{c2}=0.5\Omega$ $L_{a1}=L_{a2}=L_{b1}=L_{b2}=L_{c1}=L_{c2}=0.25\text{mH}$
Loads	
	$P_{L1}=5\text{kW}, Q_{L1}=1\text{kVar}$ $P_{L2}=2\text{kW}, Q_{L2}=1\text{kVar}$ $P_{L3}=3\text{kW}, Q_{L3}=1\text{kVar}$ $P_{L4}=9.5\text{kW}, Q_{L4}=3.12\text{kVar}$ $P_{L5}=5\text{kW}, Q_{L5}=2\text{kVar}$ $P_{L6}=4.5\text{kW}, Q_{L6}=1.12\text{kVar}$ $P_{L7}=4\text{kW}, Q_{L7}=0.5\text{kVar}$
Controllers of SPBTB VSCs	
	$m_1=6 \cdot 10^{-5}, n_1=1 \cdot 10^{-3}$ $m_2=9 \cdot 10^{-5}, n_2=1.5 \cdot 10^{-3}$ $m_3=6 \cdot 10^{-5}, n_3=1 \cdot 10^{-3}$ $c_1=2, c_2=2, c_3=3, d_1=0.4, \Gamma=0.5$

IV. SIMULATION RESULTS

To verify the effectiveness of the proposed strategies, simulation studies are carried out in MATLAB/SIMULINK (version 7.6). The single-phase microgrid test system with the proposed PSU is shown in Fig. 7 where two DGs are considered in phase-A of the microgrid, one DG in phase-C of the microgrid and no DGs in phase-B. Some key simulation

parameters are listed in Table I. During the simulation, the microgrid is operating in the islanded mode, and various operating conditions with different load demands are considered.

The simulation considered in this paper includes four cases:

- 1) power flow from phase-A to phase-B;
- 2) power flow from phases A and C to phase-B;
- 3) power flow from phase-A to phase-C;
- 4) voltage and frequency change in phase-A of the microgrid.

Simulation studies are discussed for these four cases as follows.

A. *Power flow from phase-A to phase-B*

In reality, one probable scenario would be that power generated by DGs in phase-C can only meet the power demand of its phase while power generated by DGs in phase-A may be adequate enough to meet the load power demand of phase-B as well as that of phase-A. Under this circumstance, therefore, the load in phase-B can be supplied (or shared) by DGs in phase-A through the proposed PSU in islanded mode, resulting in reliable, uninterruptible power supply and higher efficiency of renewable energy utilization. Due to the reasons mentioned above, power supply from phase-A to phase-B of the microgrid would be considered in this case.

Fig. 8 shows the active and reactive load power of both phase-A and phase-B shared by DGa1 and DGa2 and the power transmitted from phase-A to phase-B. Initially, the active and reactive load power demand of phase-B (P_B , Q_B) is 9.5kw and 3.12kvar, respectively, while that of phase-A (P_{L1} , Q_{L1}) is 5kw and 1kvar, respectively. As shown in Fig 8(a) and Fig. 8(b), a part of power generated by DGa1 and DGa2 has been transmitted from phase-A to phase-B, ensuring their normal operation in islanded mode. That is to say, DGa1 and DGa2 not only supply the power demand of phase-A but also supply the power demand of phase-B. At 0.6s, the load power of phase-B is doubled, arriving at 19kW and 6.24kvar, and at 1.3s, the load power of phase-A is changed to 9kW and 1.5kvar shown in Fig. 8 (a) and Fig. 8 (b). It can be seen that the DGs can pick up the balance load demand and share it proportionally as desired through the PSU. It can also be seen that if the load power changed greatly, the slightly active power oscillation shown in Fig. 8(a) may occur, but it can be eliminated quickly after several cycles. On the other hand, the load active and reactive power of phase-B (P_B , Q_B) can remain almost constant while load power changed in phase-A. Fig. 9 shows the capacitor voltage of SPBTB1. The dc voltage reference is 400V, and it can be seen that the voltage can keep at the reference value and that it has good robustness when the loads changed. With the application of PSU, the loads in phase-B can be supplied by DGs in other phases in the islanded mode.

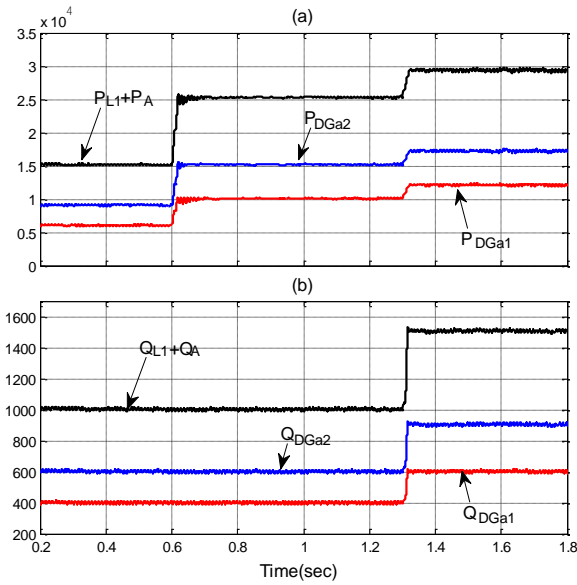


Fig. 8 Active and reactive power. (a) DG active power sharing (W). (b) DG reactive power sharing (var).

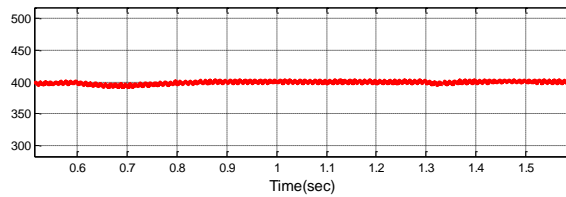


Fig. 9 Capacitor voltage of SPBTB1 (V).

B. Power flow from phase-A and phase-C to phase-B

In this case, the condition that the power demand of phase-B is supplied by DGs in both phase-A and phase-B of the microgrids through the PSU (SPBTB1 and SPBTB2) is considered, which means that in phase-A and phase-C, DGa1, DGa2 and DGc1 not only share the power demand of Load1, Load2 and Load3, but also share the load power of phase-B due to the adequate generation capacity of DGs. Under this consideration, the load power of phase-A (P_{L1} , Q_{L1}) and phase-C ($P_{L2}+P_{L3}$, $Q_{L2}+Q_{L3}$) are always remaining 5kW, 1kvar and 5kW, 2kvar, respectively, while the load power of phase-B changes from 9.5kW and 3.12kvar to 19kW and 6.24kvar at 1 s.

Fig. 10 and Fig. 11 show the active and reactive power sharing among DGs and power sharing between phase-A and phase-C of the microgrid, respectively. As shown in Fig. 11, at 1 s, the load power of phase-B (P_B , Q_B) is doubled, arriving at 19kw and 6.24kvar, and it can be seen that phase-A and phase-C of the single-phase microgrid can pick up the balance load demand quickly and share it proportionally as desired through SPBTB1 and SPBTB2 of the PSU system. The active and reactive power sharing (P_{BfromA} , P_{BfromC} , Q_{BfromA} , and Q_{BfromC}) is shown in Fig. 11(a) and Fig. 11(b), respectively. On the other hand, as shown in Fig. 10(a-d), it can be seen that regardless of the power changing of phase-B, the DGs (DGa1,

DGa2, and DGc1) in phase-A and phase-C can track the power changing accurately and share it proportionally (P_{DGa1} , P_{DGa2} , P_{DGc1} , Q_{DGa1} , Q_{DGa2} , and Q_{DGc1}) and that the load power (P_{L1} , Q_{L1} , $P_{L2}+P_{L3}$, and $Q_{L2}+Q_{L3}$) of phase-A and phase-C remain almost undisturbed. We can see that using the PSU system, the loads in the phase where there is no DG installed can be shared by DGs in the other phases coordinately, resulting in normal operation of the load and enhanced reliability and flexibility of power supply in islanded mode. Additionally, higher efficiency of renewable energy utilization can be achieved with the application of the proposed PSU.

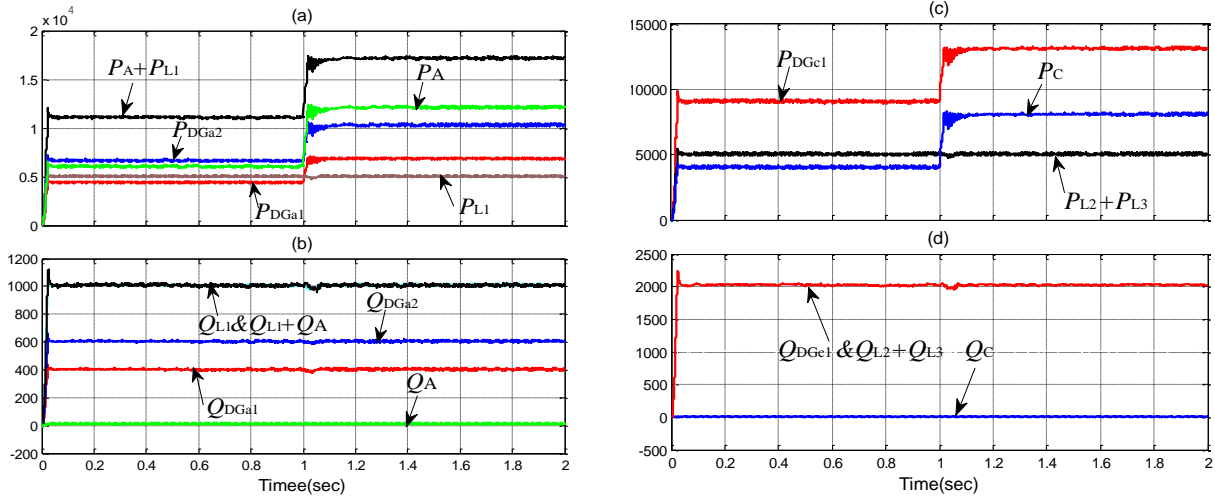


Fig. 10 Active and reactive power sharing among DGs. (a and c) active power sharing among DGa1, DGa2 and DGc1 (W). (b and d) reactive power sharing among DGa1, DGa2 and DGc1 (var).

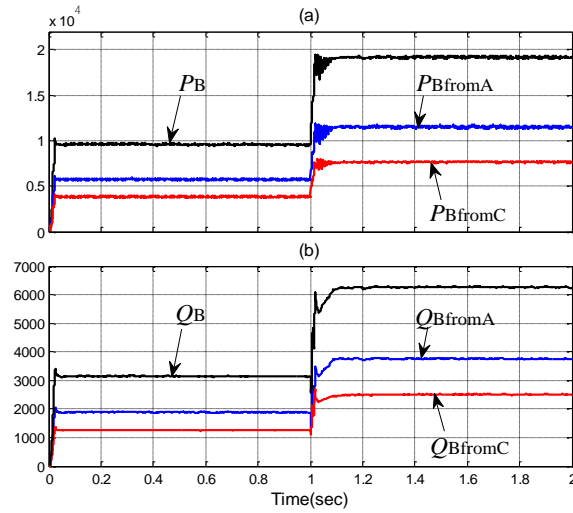


Fig. 11 Phase-B load power sharing between phase-A and phase-C of the microgrids. (a) Active power sharing (W). (b) Reactive power sharing (var).

C. Power flow from phase-A to phase-C

In this case, we assume that the power requirement of the load in phase-C is more than the power generated by the DGc1, while in phase-A, the power requirement is less than the power generated by DGa1 and DGa2, so the rest load power

requirement in phase C microgrid can be supplied by phase-A of the microgrid through the PSU (SPBTB3). That is to say, the load power of phase-C is shared not only by DGc1 (phase-C) but also by DGa1 and DGa2 (phase-A).

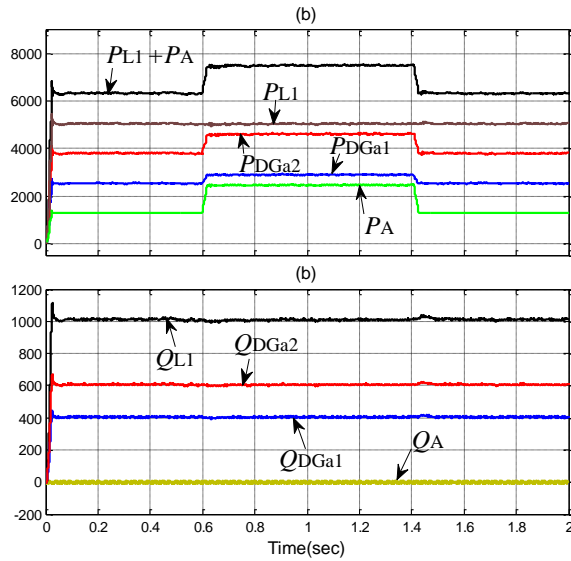


Fig. 12 Active and reactive power sharing between DGa1 and DGa2. (a) Active power sharing (W). (b) Reactive power sharing (var).

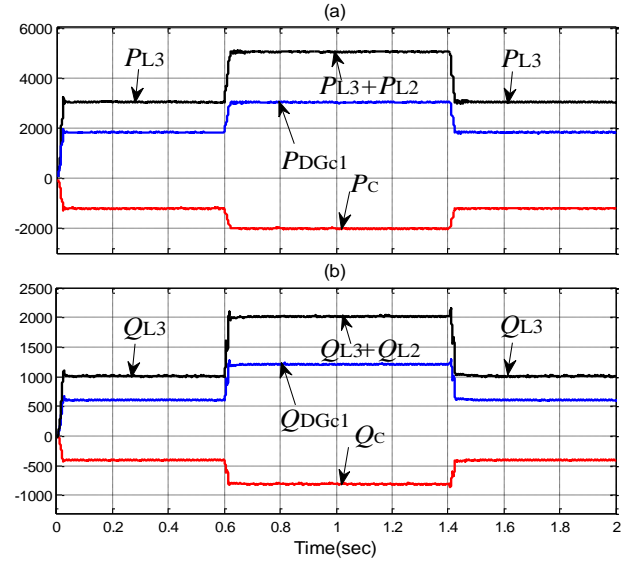


Fig. 13 Phase-C load power sharing between SPBTB3 and DGc1. (a) Active power sharing (W). (b) Reactive power sharing (var).

Fig. 12 and Fig. 13 show the active and reactive power among DGa1, DGa2 and DGc1. It can be seen that DGc1 can only generate the active and reactive power of 2kw and 1kvar, which is not adequate enough to balance the load demand, so the rest power demand of the load is supplied by phase-A through the SPBTB3 of the PSU (P_C , Q_C) (note that the power (P_C , Q_C) is less than zero indicates that the power energy is transmitted from phase-A to phase-C). At 0.6 s, the load of phase-C is doubled (Load2 is connected into the system) and at 1.4 s, it is changed back to the nominal value (Load2 is disconnected from the system). It can be seen that DGa1 and DGa2 (or SPBTB3) can pick up the balance load demand as desired (P_{DGa1} , P_{DGa2} , Q_{DGa1} , and Q_{DGa2}). It can also be seen that the active and reactive power (P_{L1} , Q_{L1}) of phase-A can remain almost constant regardless of the load power changing of phase-C.

D. Voltage and frequency change in phase-A of the microgrid

It is known that one outstanding advantage is that due to the isolation provided by back-to-back converter connection, the voltage and frequency fluctuation in one phase will not impact on another one. Voltage and frequency fluctuations occurred in phase-A of the single-phase microgrid at different periods of time is therefore considered in this case. The system response for voltage and frequency fluctuations is shown in Fig. 14 and Fig.15, respectively.

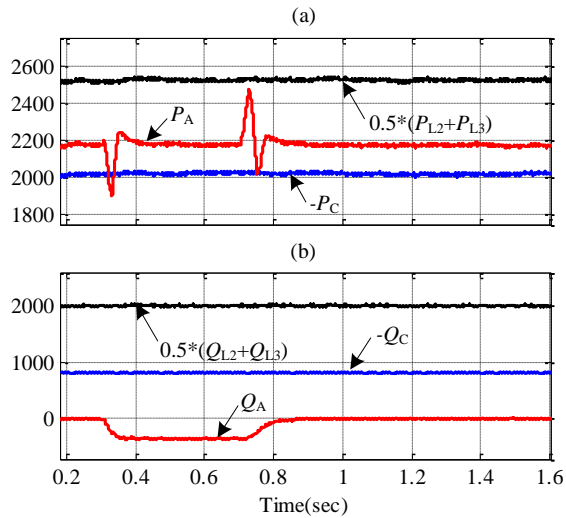


Fig. 14 Active and reactive power response during voltage fluctuation. (a) active power response (W) and (b) reactive power response (var).

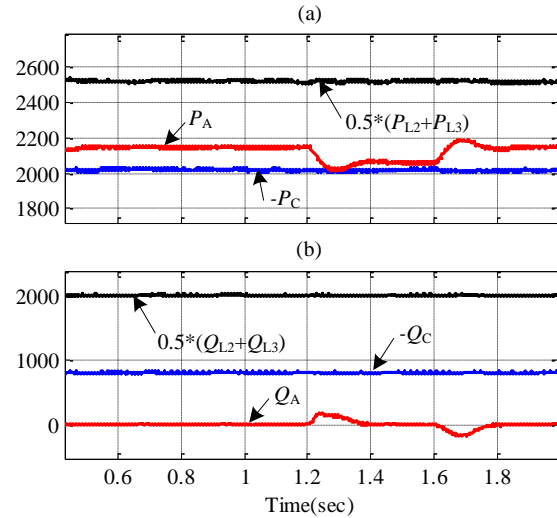


Fig. 15 Active and reactive power response during frequency fluctuation. (a) Active power response (W). (b) Reactive power response (var).

As shown in Fig. 14, a 50% voltage sag at V_{Bus1a} (shown in Fig. 7) in phase-A of the microgrid occurs at 0.3 s and is removed after 0.4 s. It can be seen that the load power ($P_{L2}+P_{L3}$, $Q_{L2}+Q_{L3}$) of phase-C and the injected power (P_C , Q_C) to phase-C have not been impacted by the voltage sag occurred in phase-A, remaining almost undisturbed. As shown in Fig. 15, the frequency of phase-A dropped by 0.5% at 1.2 s, and at 1.6 s, it comes back to its normal value. It can be seen that while the injected power (P_A , Q_A) from phase-A to the PSU (SPBTB3) fluctuate, the load power ($P_{L2}+P_{L3}$, $Q_{L2}+Q_{L3}$) of phase-C and the injected power (P_C , Q_C) from SPBTB3 to phase-C remain almost undisturbed.

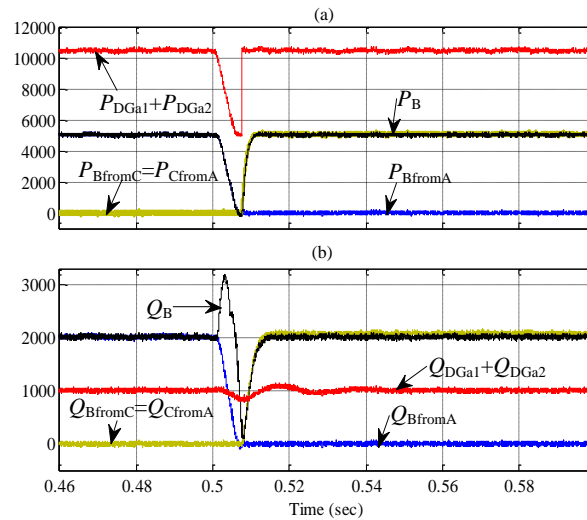


Fig. 16 Active and reactive power response when SPBTB1 fails. (a) Active power response (W) and (b) Reactive power response (var).

E. Fault within one back-to-back converter

In order to verify the reliability of the PSU system, the scenario of an internal fault within one back-to-back converter, which produced its automatic disconnection, has been simulated. In that case the load demand in phase-B is only supplied by the DGs connected in phase-A. Fig. 16 shows the system response when a fault occurs in SPBTB1. As shown in Fig. 16, the active and reactive power (P_{BfromA} , Q_{BfromA}) transferred through SPBTB1 drops quickly to zero due to this fault at 0.5s. To maintain the power supplied to loads in phase-B, SPBTB2 and SPBTB2 are then transferring the demanded power ($P_{BfromC}=P_{CfromA}$, $Q_{BfromC}=Q_{CfromA}$) to phase-B at the same time. It can be seen that the loads in phase-B can be pretty well supplied by DGs in phase-A through the PSU system, in spite of the internal fault and subsequent disconnection of one of the back-to-back converters (in this case SPBTB1). Therefore, power supply with high availability and reliability can be guaranteed by using the proposed PSU system.

V. EXPERIMENTAL RESULTS

To verify the effectiveness of the developed PSU-based microgrid and the proposed control strategy, experiments are also conducted on a scaled laboratory setup. The experimental test microgrid is composed of three identical single-phase H-bridge inverters, a PSU system composed of three single-phase back-to-back converters that are delta connected, loads and the dc link voltages of these inverters. The dc link voltages are provided by PV array, battery bank and small wind turbine generators (WTG) through dc-dc/ac-dc converters, respectively. The PV array is located on the top of the building, the wind turbine generators are installed in the vicinity of the building and the batteries are installed in the lab. Two of these inverters to interface battery bank and small WTG are installed in phase-A, the other one to interface PV array is installed in phase-C and there is no inverter installed in phase-B of the microgrid. Adjustable loads are connected to each phase. The laboratory setup implemented is shown in Fig. 16, and the experimental system parameters are given in Appendix C.

In this Section, two experiments with different operating conditions are conducted.

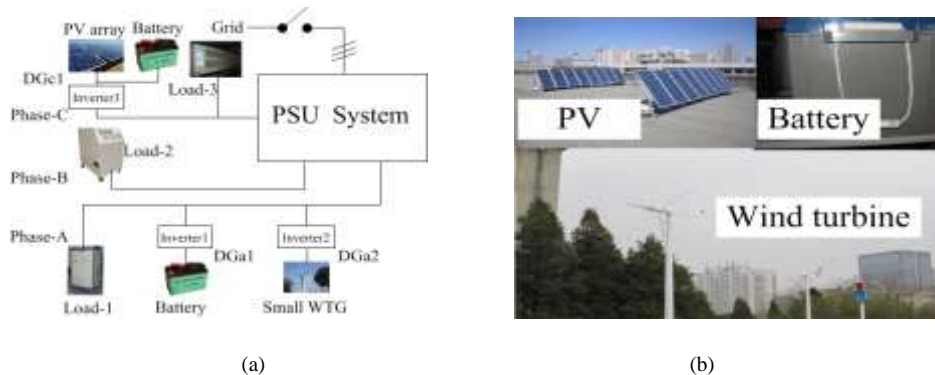


Fig. 16 Experimental verification. (a) Schematic diagram of hardware. (b) Laboratory setup.

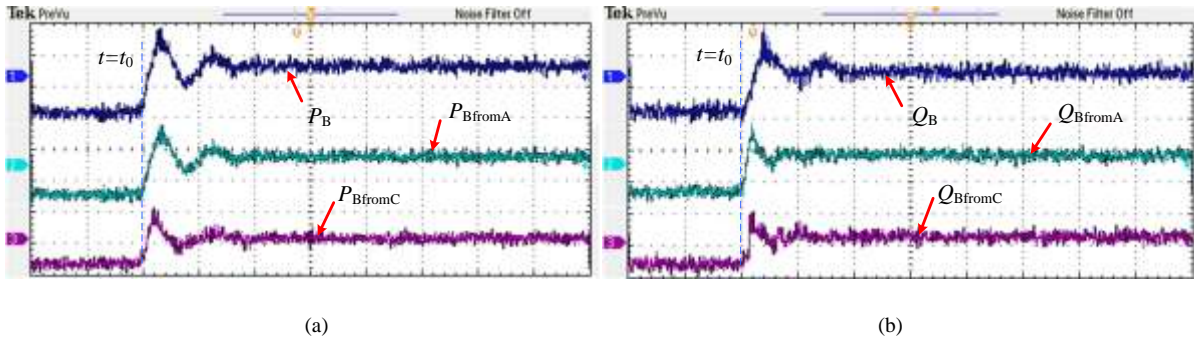


Fig. 17 Transient response of SPBTB1 and SPBTB2 with a step change of 5 kW and 2 kvar of load-3 in phase-B: (a) active power (W) and (b) reactive power (var).

Firstly, the load power demand of phase-B is shared by DGs in both phase-A and phase-C through SPBTB1 and SPBTB2 of the PSU system, proportionally. The ratio of the droop gains of SPBTB1 and SPBTB2 is 2:3.

Fig. 17 shows the fundamental output active and reactive power (P_{BfromA} , P_{BfromC} , Q_{BfromA} , and Q_{BfromC}) response of SPBTB1 and SPBTB2, respectively, as well as the load power in phase-B of the microgrid. At $t=t_0$ s, a step change of 2.5 kW active power and 1 kVar reactive power of load-2 in phase-B was excited (initially 2.5 kW and 1 kVar). From the experimental results presented in Fig. 17, it can be seen that the load in phase-B can be supplied by DGs in phase-A and phase-C of the microgrids through back-to-back converters of the PSU system, proportionally. That is to say, in the islanded mode, if the power generated by DGs is less than the power demand in this phase while the power generated by DGs is more than the load power demand in other phases, the rest power demand can be supplied by DGs in other phases through the PSU system. By doing so, the loads in phase-B microgrid can be supplied uninterruptedly and flexibly when the microgrid runs in islanded mode. With the application of the PSU, the coordinated load active and reactive power sharing can be realized among phases, and the energy generated by DGs also can be fully utilized.

In the following, the power supply from phase-A to phase-C through the PSU system is conducted with the consideration of one probable scenario that DGc1 cannot supply load-3 in phase-C normally due to the weather conditions in islanded mode while DGA1 and DGA2 may have enough power to supply load-3 in phase-C as well as load-1 in phase-A. Because that unlike small WTG, PV-based DG cannot generate power at night. The active and reactive power response of DGc1 is shown in Fig. 18, where the power flow from phase-A to phase-C is also presented. As shown in Fig. 18, in order to maintain the normal operation of load-3, DGA1 and DGA2 will share the rest power demand of load-3 through the PSU system quickly when DGc1 cannot meet the power demand of load-3. Although the active and reactive power generated by DGc1 has reduced, the operation of load-3 remains undisturbed due to the application of the PSU.

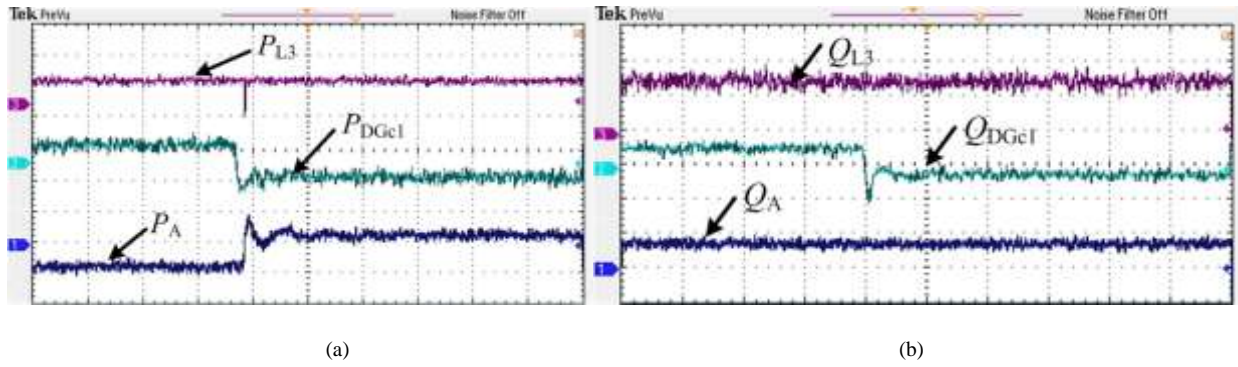


Fig. 18 Transient response of DGs and load-3: (a) active power (W) and reactive power (var).

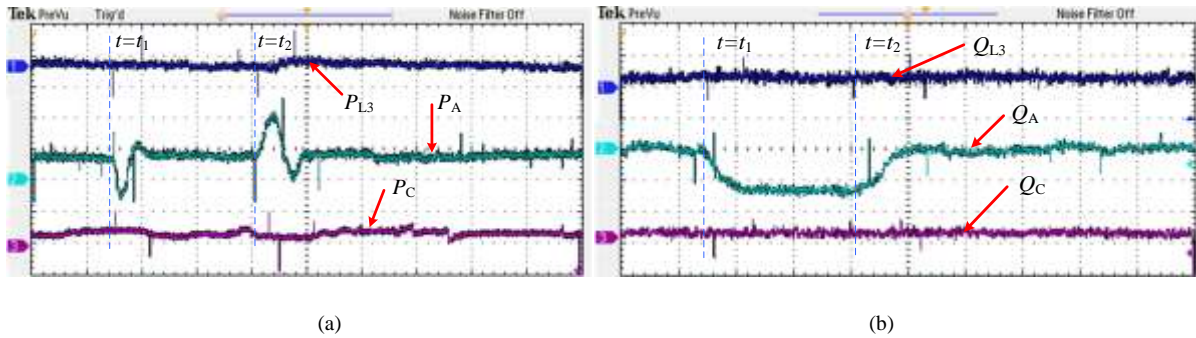


Fig. 19 Transient response during a voltage sag: (a) active power (W) and (b) reactive power (var).

To investigate the power response during the voltage sag, the experiment is also conducted. In this test, a part of load power demand of phase-C is shared by DGs in phase-A through the PSU system. During the test, at $t=t_1$ s, a 20% voltage sag at the input terminal of the PSU in phase-A occurred and at $t=t_2$ s, the voltage sag is removed. The active and reactive load power (P_{L3} , Q_{L3}) of phase-C, the input power (P_A , Q_A) of the PSU and the injected power (P_C , Q_C) to phase-C during this voltage sag are presented in Fig. 19. As it can be seen, the load power of phase-C and the injected power to phase-C remain almost undisturbed during the voltage sag. This is the advantage of the application of back-to-back converters which provide the isolation between phases thereby ensuring the normal operation of the system.

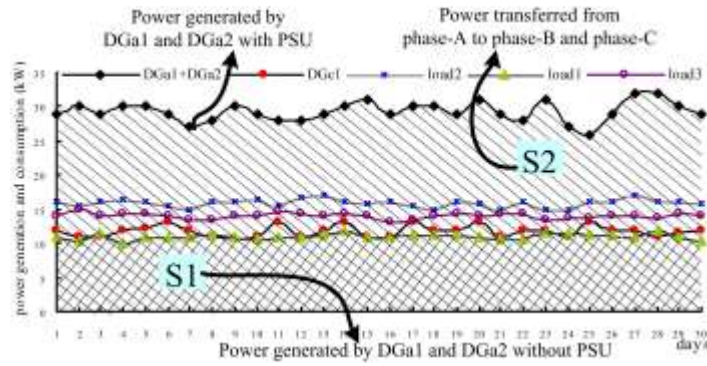


Fig. 20 Power generation and consumption.

In order to observe the efficiency of the application of PSU system, daily power generation of DGs and power consumption of loads have been obtained for 30 days continuously, which is shown in Fig. 20. From the results, it can be seen that if there is no PSU implemented in the microgrid, DGa1 and DGa2 can only supply the load in phase-A and the power generation (S1 shown in Fig. 20) is constrained by load-1 even the weather condition is good enough to supply the load in phase-B and phase-C. So in this condition, without power supply, load-2 in phase-B cannot operate normally in islanded mode. The abundant primary energy will be wasted. However, with the application of the proposed PSU, the abundant primary energy will be conducive to generate more electricity by DGa1 and DGa2 to supply load-2 in phase-B as well as part power of load-1 in phase-C through PSU in the islanded mode, achieving higher efficiency of the renewable energy utilization.

VI. CONCLUSION

In this paper, the operation and energy management control strategy is proposed for the PSU-based hybrid microgrid in the islanded mode. The PSU composed of three SPBTB converters that are delta connected is installed at the PCC bus. The aim of the PSU is mainly to realize the coordinated control of load power sharing among different phases. The structure, principle and operation of the proposed PSU installed in the hybrid microgrid are discussed in detail firstly. Then the design of the PSU nonlinear controllers is also presented by using the droop control method and the modified adaptive backstepping-sliding mode control approach, which can achieve the coordinated power sharing and enhance robustness. With the application of the proposed PSU, it is not only the coordinated load power sharing and power flow control among phases that can be realized but also the load that can be supplied uninterruptedly. Besides, the efficiency of energy utilization can be greatly increased and the voltage and frequency isolation can be provided by the PSU. Finally, the simulation and experimental results demonstrate the validity of the proposed application of PSU in the hybrid microgrid

and its energy management control scheme. The proposed delta-connected back-to-back conversion system provides high reliability, fault tolerance, reduced dc-link capacitance, and hot-swap features. Furthermore, the proposed approach can be installed in existing grids feed by DGs from third parties, and does not require the change of commercial DGs to customized ones.

APPENDIX A

The calculation methods of all the terms in Eq. (3) are given as follows:

$$u_i = \begin{bmatrix} u_1 \\ u_2 \\ u_3 \end{bmatrix} = \begin{bmatrix} v_{Ad} - v_{DC}m_{Ad} \\ v_{Aq} - v_{DC}m_{Aq} \\ 0 \end{bmatrix}, g_1(x) = \begin{bmatrix} \frac{1}{L_A} & 0 & 0 \end{bmatrix}, g_2(x) = \begin{bmatrix} 0 & \frac{1}{L_A} & 0 \end{bmatrix}, g_3(x) = [0 \ 0 \ 0], \beta = \frac{1}{R_p} = \beta_n + \Delta\beta,$$

$$\Delta f(x) = \begin{bmatrix} -\frac{R_A}{L_A}i_{Ad} + \omega_A i_{Aq} \\ -\frac{R_A}{L_A}i_{Aq} - \omega_A i_{Ad} \\ \frac{3}{C}(v_{Ad}i_{Ad} + v_{Aq}i_{Aq}) - \frac{2\beta_n v_{DC}^2}{C} - \frac{2P_{load}}{C} \end{bmatrix}, \Delta f(x) = \begin{bmatrix} 0 & 0 & -\frac{2\Delta\beta v_{DC}^2}{C} \end{bmatrix}^T$$

where L_A is the inductance, $\Delta\beta$ is the uncertainty, $g_1(x)$, $g_2(x)$, $g_3(x)$, $\bar{f}(x)$ and $\Delta f(x)$ are continuously differentiable functions.

APPENDIX B

The calculation methods of all the terms in Eq. (4) to Eq. (8) are given as follows, and the symbol “L” represents the Lee derivative.

$$L_{\bar{f}}h_1(x) = \frac{3}{C}(v_{Ad}i_{Ad} + v_{Aq}i_{Aq}) - \frac{2\beta_n v_{DC}^2}{C} - \frac{2P_{load}}{C}, L_{g_2}h_2(x) = 0, L_{g_3}h_3(x) = -\frac{2\Delta\beta v_{DC}^2}{C}, L_{g_1}h_4(x) = L_{g_2}h_4(x) = 0, L_{g_1}L_{\bar{f}}h_1(x) = \frac{4\beta_n v_{DC}^2}{C^2} \Delta\beta,$$

$$L_{\bar{f}}^2h_1(x) = \frac{3(v_{Ad}f_1(x) + v_{Aq}f_2(x))}{C} - \frac{2\beta_n}{C}\bar{f}_3(x), L_{g_1}L_{\bar{f}}h_1(x) = \frac{3v_{Ad}}{L_A C}, L_{g_2}L_{\bar{f}}h_1(x) = \frac{3v_{Aq}}{L_A C}, L_{\bar{f}}h_2(x) = -\frac{R_A}{L_A}i_{Ad} + \omega_A i_{Aq}, L_{g_1}h_2(x) = \frac{1}{L_A},$$

$$L_{g_2}h_2(x) = 0, f_1(y_1) = 0, G_1 = 1, \phi_1^T(y_1) = -\frac{2v_{DC}^2}{C}, f_2(y_1, y_2) = L_{\bar{f}}^2h_1(x), G_2 = 1, \phi_2^T(y_1, y_2) = \frac{4\beta_n v_{DC}^2}{C}, f_3(y_3) = L_{\bar{f}}h_2(x),$$

$$G_3 = 1, \phi_3^T(y_3) = 0, L_{\bar{f}}h_4(x) = -\frac{R_B}{L_B}i_{Bd} + R_B\omega_B i_{Bq}, L_{\bar{f}}h_5(x) = -\frac{R_B}{L_B}i_{Bq} - R_B\omega_B i_{Bd}, L_{g_4}h_4(x) = L_{g_5}h_5(x) = \frac{R_B}{L_B}.$$

APPENDIX C

TABLE II
EXPERIMENTAL TEST SYSTEM PARAMETERS

System Quantities			Values
DGs			
DC voltage			$V_{dc1}=V_{dc2}=V_{dc3}=400V$
Rated power (DGa1-small WTG)			$P_{DGa1-rated}=5kW$
Rated power (DGa2-Battery bank)			$P_{DGa2-rated}=3kW$
Rated power (DGa1-PV array)			$P_{DGc1-rated}=2kW$
Loads	Load1	Rated voltage	220V rms (L-N)
		Rated frequency	50 Hz
		Load power	2-3 kW, 1-2 kVar
	Load2	Rated voltage	220V rms (L-N)
		Rated frequency	50 Hz
		Load power	2.5-5 kW, 1-2 kVar
	Load3	Rated voltage	220V rms (L-N)
		Rated frequency	50 Hz
		Load power	1 kW, 1 kVar
PSU system			
Droop controllers			$m_1=6 \cdot 10^{-5}, n_1=1 \cdot 10^{-3},$ $m_2=9 \cdot 10^{-5}, n_2=1.5 \cdot 10^{-3},$ $m_3=6 \cdot 10^{-5}, n_3=1 \cdot 10^{-3}$
Rated power			4 kVA
DC-link voltage			$V_{dc}=400 V$
Interlinked inductance			$L_A, L_B=4 mH,$ $R_A, R_B=330 m\Omega$

REFERENCES

- [1] G. Pepermans, J. Driesen, D. haeseldonckx, R. Belmans, W. D'haeseleer, "Distributed generation: definition, benefits and issues," *Energy Policy*, vol. 33, no. 6, pp. 787-798, Apr. 2005.
- [2] Hua, M.; Hu, H.; Xing, Y.; Guerrero, J. M.; , "Multilayer Control for Inverters in Parallel Operation Without Intercommunications," *Power Electronics, IEEE Transactions on*, vol.27, no.8, pp.3651-3663, Aug. 2012
- [3] C. A. Platero, C. Nicolet, J. A. Sanchez, and B. Kawkabani, "Increasing wind power penetration in autonomous power systems through no-flow operation of pelton turbines," *Renewable Energy*, vol. 68, pp. 515-523, Aug. 2014.
- [4] X. Guan, Z. Xu, and Q. S. Jia, "Energy-efficient buildings facilitated by microgrid," *IEEE Trans. Smart Grid.*, vol. 1, no.3, pp. 243-252, Dec. 2010.
- [5] C. Chen, S. Duan, T. Cai, B. Liu, and G. Hu, "Smart energy management system for optimal microgrid economic operation," *IET Renew. Power Gen.*, vol. 5, no. 3, pp. 258-267, May 2011.
- [6] Anand, S.; Fernandes, B. G.; Guerrero, J. M.; , "Distributed Control to Ensure Proportional Load Sharing and Improve Voltage Regulation in Low-Voltage DC Microgrids," *Power Electronics, IEEE Transactions on*, vol.28, no.4, pp.1900-1913, April 2013
- [7] D. Ahmadi, and J. Wang, "Online selective harmonic compensation and power generation with distributed energy resources," *IEEE Trans. Power Electron.*, vol. 29, no. 7, pp. 3738-3747, Jul. 2014.
- [8] J. M. Guerrero, P. C. Loh, T. Lee, and M. Chandorkar, "Advance control architectures for intelligent microgrids-Part II: power quality, energy storage, and AC/DC microgrids," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1263-1270, Apr. 2013.

- [9] F. Shahnia, R. Majumder, A. Ghosh, G. Ledwic, and F. Zare, "Load sharing and power quality enhanced operation of a distributed microgrid," *IET Renew. Power Gen.*, vol. 3, no. 2, pp. 109-119, Jun. 2009.
- [10] I. Y. Chung, W. Liu, D. A. Cartes, E. G. Collins, and S. I. Moon, "Control methods of inverter-interfaced distributed generators in a microgrid system," *IEEE Trans. Ind. Appl.*, vol. 46, no. 3, pp. 1078-1088, May/Jun. 2010.
- [11] A. T. Gullberg, D. Ohlhorst, and M. Schreurs, "Towards a low carbon energy future-renewable energy cooperation between Germany and Norway," *Renewable Energy*, vol. 68, pp. 216-222, Aug. 2014.
- [12] Rowe, C.N.; Summers, T.J.; Betz, R.E.; Cornforth, D.J.; Moore, T.G.; , "Arctan Power-Frequency Droop for Improved Microgrid Stability," *Power Electronics*, *IEEE Transactions on*, vol.28, no.8, pp. 3747-3759, Aug. 2013.
- [13] J. C. Vasquez, J. M. Guerrero, A. Luna, P. Rodríguez, and R. Teodorescu, "Adaptive droop control applied to voltage-source inverters operating in grid-connected and islanded modes," *IEEE Trans. Ind. Electron.*, vol. 56, no. 10, pp. 4088-4096, Oct. 2009.
- [14] N. Pogaku, M. Prodanovic, and T. C. Green, "Modeling, analysis and testing of autonomous operation of an inverter-based microgrid," *IEEE Trans. Power Electron.*, vol. 22, no. 2, pp. 613-625, Mar. 2007.
- [15] Q.-C. Zhong, "Robust droop controller for accurate proportional load sharing among inverters operated in parallel," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1281-1290, Apr. 2013.
- [16] Shao Zhang; Shuai Jiang; Xi Lu; Baoming Ge; Fang Zheng Peng; "Resonance Issues and Damping Techniques for Grid-Connected Inverters With Long Transmission Cable," *Power Electronics*, *IEEE Transactions on*, vol.29, no.1, pp. 110-120, Jan. 2014
- [17] E. Barklund, N. Pogaku, M. Prodanovic, C. Hernandez-Aramburo, and T. C. Green, "Energy management in autonomous microgrid using stability-constrained droop control of inverters," *IEEE Trans. Power Electron.*, vol. 23, no. 5, pp. 2346-2352, Sep. 2008.
- [18] Y. A.-R. I. Mohamed and E. F. El-Saadany, "Adaptive decentralized droop controller to preserve power sharing stability of paralleled inverters in distributed generation microgrids," *IEEE Trans. Power Electron.*, vol. 23, no. 6, pp. 2806-2816, Nov. 2008.
- [19] Bao, C.; Ruan, X.; Wang, X.; Li, W.; Pan, D.; Weng, K.; "Step-by-Step Controller Design for LCL-Type Grid-Connected Inverter with Capacitor-Current-Feedback Active-Damping," *Power Electronics*, *IEEE Transactions on*, vol.29, no.3, pp. 1239-1253, March 2014
- [20] Y. W. Li and C. N. Kao , "An accurate power control strategy for power-electronics-interfaced distributed generation units operating in a low-voltage multibus microgrid," *IEEE Trans. Power Electron.*, vol. 24, no. 12, pp. 2977-2988, Dec. 2009.
- [21] W. Yao, M. Chen, J. Matas, J. M. Guerrero, and Z.-M. Qian, "Design and analysis of the droop control method for parallel inverters considering the impact of the complex impedance on the power sharing," *IEEE Trans. Ind. Electron.*, vol. 58, no. 2, pp. 576-588, Feb. 2011.
- [22] J. He and Y. W. Li, "An enhanced microgrid load demand sharing strategy," *IEEE Trans. Power Electron.*, vol. 27, no. 9, pp. 3984-3995, Sep. 2012.
- [23] K. S. Parlak, M. Ozdemir, and M. Timur Aydemir, "Active and reactive power sharing and frequency restoration in a distributed power system consisting of two UPS units," *Electrical Power and Energy Systems*, vol. 31, no. 5, pp. 220-226, Jun. 2009.
- [24] J. M. Guerrero, M. Chandorkar, T. Lee, and P. C. Loh, "Advance control architectures for intelligent microgrids-Part I: decentralized and hierarchical control," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1254-1262, Apr. 2013.
- [25] J. Vasquez, J. M. Guerrero, M. Savaghebi, J. Eloy-Garcia, and R. Teodorescu, "Modeling, analysis, and design of stationary reference frame droop controlled parallel three-phase voltage source inverters," *IEEE Trans. Ind. Electron.*, vol.60, no. 4, pp. 1271-1280, Apr. 2013.
- [26] Q. Shafiee, J. Guerrero, and J. C. Vasquez, "Distributed secondary control for islanded microgrids - a novel approach," *IEEE Trans. Power Electron.*, vol. 29, no. 2, pp. 1018-1031, Feb. 2014.

- [27] R. Majumder, A. Ghosh, G. Ledwich, and F. Zare, "Power management and power flow control with back-to-back converters in a utility connected microgrid," *IEEE Trans. Power Syst.*, vol. 25, no. 2, pp. 821-834, May. 2010.
- [28] H. Akagi and R. Kitada, "Control and design of a modular multilevel cascade BTB system using bidirectional isolated DC/DC converters," *IEEE Trans. Power Electron.*, vol. 26, no. 9, pp. 2457-2464, Sep. 2011.
- [29] Xiaonan Lu; Guerrero, J.M.; Kai Sun; Vasquez, J.C.; Teodorescu, R.; Lipei Huang, "Hierarchical Control of Parallel AC-DC Converter Interfaces for Hybrid Microgrids," *Smart Grid*, IEEE Transactions on , vol.5, no.2, pp.683,692, March 2014
- [30] R. Majumder, A. Ghosh, G. Ledwich, and F. Zare, "Operation and control of single phase micro-sources in a utility connected grid," in *Proc. IEEE Power & Energy Society General Meeting*, 2009, pp. 1-7.
- [31] R. Majumder, "Reactive power compensation in single phase operation of microgrid," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1403-1416, Apr. 2013.
- [32] Z. Shu, S. Xie, and Q. Li, "Single-phase back-to-back converter for active power balancing, reactive power compensation, and harmonic filtering in traction power system," *IEEE Trans. Power Electron.*, vol. 26, no. 2, pp. 334-343, Feb. 2011.
- [33] S. Chakraborty and M. G. Simoes, "Experimental evaluation of active filtering in a single-phase high-frequency AC microgrid," *IEEE Trans. Energy Convers.*, vol. 24, no. 3, pp. 673-682, Sep. 2009.
- [34] J. He, Y. W. Li, J. M. Guerrero, F. Blaabjerg, and J. C. Vasquez, "An islanding microgrid power sharing approach using enhanced virtual impedance control scheme," *IEEE Trans. Power Electron.*, vol. 28, no. 11, pp. 5272-5282, Nov. 2013.
- [35] B. B. Johnson, S. V. Dhople, A. O. Hamadeh, and P. T. Krein, "Synchronization of parallel single-phase inverters with virtual oscillator control," *IEEE Trans. Power Electron.*, vol. 29, no. 11, pp. 6124-6138, Nov. 2014.
- [36] P. Rodriguez, A. Luna, I. Candela, R. Mujal, R. Teodorescu, and F. Blaabjerg, "Multiresonant frequency-locked loop for grid synchronization of power converters under distorted grid conditions," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 127-138, Jan. 2011.
- [37] B. Parkhideh and S. Bhattacharya, "Vector-controlled voltage-source-converter-based transmission under grid disturbances," *IEEE Trans. Power Electron.*, vol. 28, no. 2, pp. 661-672, Feb. 2013.
- [38] A. Allag, M. Y. Hammoudi, S. M. Mimoune, M. Y. Ayad, M. Becherif, and A. Miraoui, "Tracking control via adaptive backstepping approach for a three phase PWM AC-DC converter," in *Proc. IEEE Int. Symp. Ind. Electron.*, 2007, pp. 371-376.
- [39] J. Niiranen, R. Komsı, M. Routimo, T. Lähdeaho, and S. Antila, "Experiences from a back-to-back converter fed village microgrid," *Innovative Smart Grid Technologies Conference Europe (ISGT Europe)*, 2010 *IEEE PES* , vol. 1, no. 5, pp. 11-13, Oct. 2010.