



Aalborg Universitet

AALBORG UNIVERSITY
DENMARK

Fault Management in DC Microgrids

A Review of Challenges, Countermeasures, and Future Research Trends

Ali, Zulfiqar ; Terriche, Yacine; Nhat Hoang, Le Quang ; Abbas, Syed Zagam ; Alrayah Hassan, Mustafa ; Sadiq, Muhammad ; Su, chun Lien; Guerrero, Josep M.

Published in:
IEEE Access

DOI (link to publication from Publisher):
[10.1109/ACCESS.2021.3112383](https://doi.org/10.1109/ACCESS.2021.3112383)

Publication date:
2021

Document Version
Accepted author manuscript, peer reviewed version

[Link to publication from Aalborg University](#)

Citation for published version (APA):
Ali, Z., Terriche, Y., Nhat Hoang, L. Q., Abbas, S. Z., Alrayah Hassan, M., Sadiq, M., Su, C. L., & Guerrero, J. M. (2021). Fault Management in DC Microgrids: A Review of Challenges, Countermeasures, and Future Research Trends. *IEEE Access*, 9, 128032-128054. Advance online publication. <https://doi.org/10.1109/ACCESS.2021.3112383>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Fault Management in DC Microgrids: A Review of Challenges, Countermeasures, and Future Research Trends

Zulfiqar Ali¹, Yacine Terriche², Le Quang Nhat Hoang³, Syed Zagam Abbas⁴, Mustafa Alrayah Hassan¹, (Senior Member, IEEE), Muhammad Sadiq¹(Graduate Student Member, IEEE), Chun-Lien Su¹, (Senior Member, IEEE), Josep M. Guerrero²(Fellow, IEEE)

¹Department of Electrical Engineering, National Kaohsiung University of Science and Technology, Kaohsiung City, 807618, Taiwan

²Center for Research on Microgrids, Department of Energy Technology, Aalborg University, 9220, Denmark

³Department of Microelectronics Engineering, National Kaohsiung University of Science and Technology, Kaohsiung City, 81157, Taiwan

⁴Department of Electrical Power Engineering, Mirpur University of Science and Technology (MUST), Mirpur, 10250, AJK, Pakistan

Corresponding author: Chun-Lien Su (e-mail: cls@nkust.edu.tw).

This work was funded in part by the Ministry of Science and Technology of Taiwan under Grant MOST 107-2221-E-992-073-MY3.

ABSTRACT The significant benefits of DC microgrids have instigated extensive efforts to be an alternative network as compared to conventional AC power networks. Although their deployment is ever-growing, multiple challenges still occurred for the protection of DC microgrids to efficiently design, control, and operate the system for the islanded mode and grid-tied mode. Therefore, there are extensive research activities underway to tackle these issues. The challenge arises from the sudden exponential increase in DC fault current, which must be extinguished in the absence of the naturally occurring zero crossings, potentially leading to sustained arcs. This paper presents cut-age and state-of-the-art issues concerning the fault management of DC microgrids. It provides an account of research in areas related to fault management of DC microgrids, including fault detection, location, identification, isolation, and reconfiguration. In each area, a comprehensive review has been carried out to identify the fault management of DC microgrids. Finally, future trends and challenges regarding fault management in DC microgrids are also discussed.

INDEX TERMS Artificial intelligence, Machine learning technique, DC microgrid, DC shipboard power system, Fault detection, Fault isolation, Fault protection, Fault reconfiguration, Fault location, Signal processing.

I. INTRODUCTION

The abysmal condition of climate change and the extraordinary carbon emission deadline set by the European Union (EU) is planned to minimized carbon emission to about 80% to 90% by 2050 using renewable energy and smart power utilization [1]. In order to enhance future energy sustainability and lower the dependence on the usage of fossil fuels recent research focused on replacing the traditional resources with renewable energy sources (RES) and efficient power management by deploying microgrids. Microgrids (MGs) are localized/decentralized grouping of distributed energy resources (DERs) constituted of one or a combination of units connected to nearby consumers. These units consist of generators; and renewable resources (e.g., wind turbine, PV, tidal power, fuel cells, combined heat and power (CHP), biogas plants, hydropower units, geothermal heat, and biomass energy) that can operate in two operating modes autonomously (standalone mode) or in grid-connected mode

[2]. Although, these MGs are commonly categorized into AC, DC, and hybrid (AC-DC) systems; yet the AC-DC MGs are considered to be a promising topology for future grids integration [3], [4]. Besides this, by 2030 approximately 27% usage of renewable energy will result in the evolution of green energy utilization [5]. A DC MG can't solely improve the potency of the DC network by reducing the quantity of power electronic converters (PEC) from DC-based DERs and energy storage systems (ESSs). However, it additionally gives effective transmission capability and power quality compared to AC MGs [6]. In addition, the structure of a DC microgrid is configured so that it does not require synchronization and control of reactive power [7]–[9]. The real-time implementation of DC MGs is getting more attraction because of multiple benefits over AC microgrids like less power conversion stages and the capability of transmitting more DC power through a given cable. Independency of synchronization methods, not only struggle

from frequency drifts [10], but also less conversion stage makes the DC systems have less line loss [11], [12] and support with less interfacing power electronics equipment [13] to simplify the system control complexity and unnecessary power conversion stages. Therefore, DC MGs are usually recommended for a distribution system impaired by PEC. Furthermore, a DC MG is preferable as compared to the AC MG due to system reliability, uninterruptable power supply system, better system stability, and better efficiency due to the disappearance of reactive power.

Fig. 1 presents a schematic perspective of DC MGs systems [14]. The DC bus is used as the primary support, which allocates the power supply to the utilities as well as to the households. Other energy resources such as photovoltaics, fuel cells, batteries, wind turbines (WTs), etc., are connected to DC MG for enhancing the delivered power. A buck and boost power converters have been utilized in this system to step up or step down the DC voltage to achieve an appropriate level.

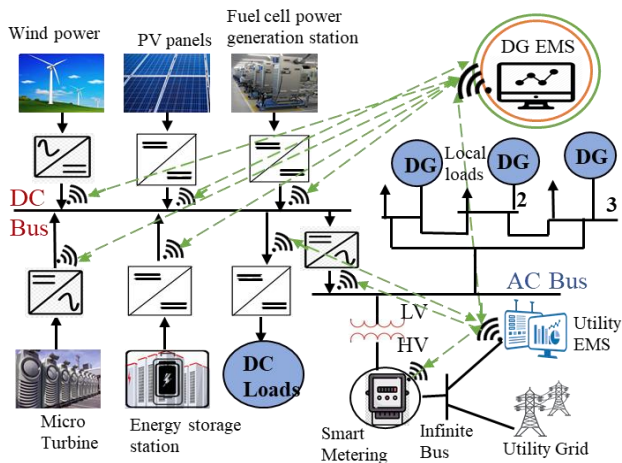


FIGURE 1. A generic structure of DC microgrids

In order to handle any faulty condition in the DC power system, the protection of DC MGs can be categorized into three phases: fault detection, fault isolation, and fault reconfiguration. Fig. 2 depicts the existing and emerging methods for fault management (FM). Fault management of DC MGs is essential to understand the system behavior to support the grid stability and fast recovery under various fault conditions such as rapidly rising fault current, arcing, and no natural occurrence of zero-crossing [15], [16]. In order to deal with the challenges for FM of DC MGs, some procedures such as installing protection devices, appropriate grounding, fast fault detection strategies, fault identification method, and proper direct current circuit breakers (DC CBs) are required.

The DC power systems are already utilized in different applications such as telecom data centers and vehicular power systems [17],[18]. The amplification of RES with more enhanced renewable energy storage systems (RESs), electric

vehicles and electrical load, acquires power have contributed to the development of the concept of DC MG implementation in residential and commercial applications as well. As a result, developing the DC grid architectures, as well as essential power electronics and protection devices became the recent focus of researchers. In spite of the fact of their plentiful advantages (such as curtail/minimized power conversion steps, minimum losses, economic, higher energy potency and so forth [19]), the development of economically effective and reliable protection techniques for DC systems with bi-directional power flow is still an important factor for DC MGs implementations. Resultantly, the protection standards and guidelines that can be acceptable to commercial and industrial applications have still not been designated [20]. Some practical standards are developed and designed respectively for the DC power systems and low voltage (LV) DC distribution systems such as European standards ETSI EN 300 132-3-1 [21], IEEE Standards-946 [22], for telecommunication data center and the auxiliary DC power systems. However, these standards have not accepted the long-term high magnitude fault current and the substantial changing rate of fault currents in DC power systems for fault detection and isolation.

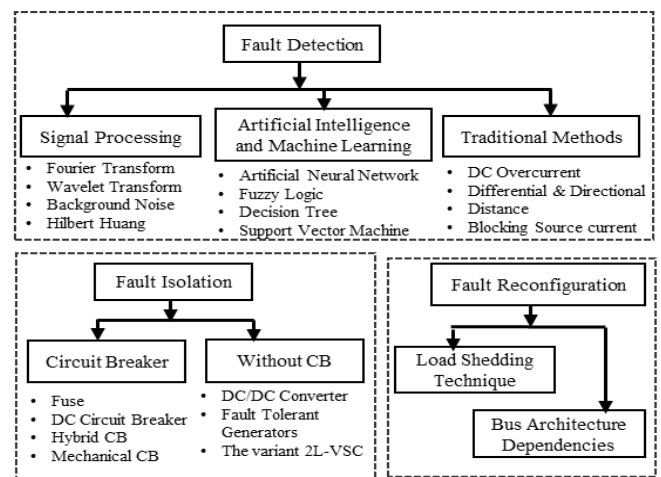


FIGURE 2. A framework of fault management in DC Microgrid systems

The main purpose of DC MG protection is to respond to the faults in two operation modes. When the operating mode is grid-connected and the fault occurrence is on the grid side, so the protection of DC MGs must identify the fault, switch the operation mode to islanded and continue power supply to the associated loads. During the system's fault, protection of DC MGs is quite important by detecting, isolating, and reconfiguring the fault [23]. In [11], the protection of DC MGs is accounted with a focus on the influence of the chosen protection devices and grounding technique on LVDC microgrid systems. This method shows that it's doable to use out the available devices to shield such a system. The issues may arise with high impedance ground faults which may be

tough to detect. The high impedance ground fault detection is the main problem for DC MGs protection [24]; for this purpose, the power converter fault current with the DC link capacitor voltage is used to ensure reliable operation [25]. In [26], the zone base DC MGs consist of intelligent electronic devices (IEDs), mainly capable of detecting fault current in a DC bus-segment to avoid system shutdown by isolating the faulty segment. The arc model for fault protection in LVDC MGs is also presented in [27]. In this study, the model is developed from the observed current patterns and arc voltage, allowing the arc voltage to be analyzed in terms of its stability, resistance, and extinguishing conditions to simplify the series fault issue in DC MG.

The protection of DC MGs utilizes various types of overcurrent relay and circuit breakers (CB); the overcurrent relay can produce a current peak of twice the nominal converter's capacity, which according to some researches reaches within milliseconds [28]. The DC capacitor is also able to discharge as a result of any fault detected in the microgrid as depicted by previous literature [29]. Hence, the DC MGs can protect the circuit by detecting the fault before reaching the current limit [12]. Though, to limit the short circuit fault interruption time, DC systems use different protective devices such as Solid-State Circuit Breaker (SSCB), Hybrid Circuit Breaker (HCB), fuse and semiconductor switches such as Insulated Gate Bipolar Transistor (IGBT) and Insulated Gate Commutated Thyristors (IGCT), which can meet the strict time limits. For a reliable operation of DC systems, fast detection and isolation of fault is crucial [28],[30].

The major challenges for fault protection of DC MGs can be elaborated as:

- Challenge due to the system blackout and grounding
- Difficulties in detecting and pointing out the fault location in case of lack of frequency and phase information
- Unintentional islanding and meager-adequate standard in the DC MG protection
- Protection integration issues due to various modes of operation and the disruptive nature of RES
- Increase number-of voltage source convertors (VSCs) and circuit breakers
- Arcing and fault clearing time
- Signal processing and communication delay as well as circuit breaker tripping
- Absence of natural zero crossing
- Power quality issues and cybersecurity of network communication

In order to address the above-mentioned challenges of DC MGs, effective solutions like proper grounding [31], fast and efficient fault detection strategies [32], fault classification

[33], current limiting and ease of fault location [34], and a proper DCCB are essential [35]. Grounding in DC MGs is related to various system considerations such as design purpose, grid reliability under normal circumstances, minimize leakage current [24], ground fault identification [24], and maximize the equipment safety under fault conditions [36]. Given that, a novel current grounding method has to be introduced which could emphasize the fault detection capability of the DC system [24]. Based on the current features pertaining to the DC faults, an appropriate and reliable method is the need of the hour to maintain stability and to restrain any damage to equipment. The coordination between protective relays is stringent, in light of a sudden change in DC fault current [31],[32]. For the protection of DC MGs, five main classes of fault detection methods including overcurrent, current derivative, differential current based unit protection, and distance estimation-based methods have been proposed [27]. The fault protection of DC MGs is presented in [25], [26]. In response to a sudden change in DC fault, this study discusses the model-based fault detection, isolation and, controller reconfiguration in detail. For fault detection and isolation, it discusses various model-based schemes to generate the residuals that are robust to unknown disturbance, noise, model uncertainties and various statistical techniques of testing of rapid change in fault current.

Recently, DC fault protection adopts machine learning principles (ML) and Digital Signal Processing (DSP) techniques for event recognition in DC power systems [33], [35]. The wavelet transforms (WT) and short-time Fourier transform (STFT) are amongst-the commonly utilized DSP techniques for frequency as well as time-domain analysis. The STFT systems are limited by the time-frequency resolution. Short windows are used to detect low frequencies while high frequencies are hardly managed in time with a long data window [33]. As opposed to that, the time-frequency resolution breaking down is one of the salient features of WT, which makes it a viable choice to detect DC faults. Fault classification and event recognition are widely used based on the principles applied by WT [33]–[35].

However, WT is susceptible to disturbances and noise production in the DC network. The ML models, among which support vector machines (SVM), Artificial Neural Networks (ANN), decision-tree (D-Tree), and Deep Neural Networks (DNN) are extensively suggested by literature for fault detection in DC power systems [36]–[38]. ML offers the most efficient detection of the DC failures to date, which is unharmed by any other DC network disturbances. Recent literature has also supported the use of various ML principles mentioned above [39]. Another evidence also presented the utilization of ANNs in the DC power system failures [40], [41]. The above-mentioned fault detection methods have resulted in longer detection times and complex ANN configurations.

The fault isolation is accomplished by creating the appropriate DC CB to bring the DC MG to a stable operating

mode. Fault isolation mainly includes circuit breaker-based methods and converter based methods by concerning the short-circuit current features. The DC CB must have these main key characteristics like a quick response, high reliability, and low conduction loss [28],[42]. According to the requirement such as long lifetime, economic, and reliability, DC CBs must be selected from the available protective devices. The fault reconfiguration in DC MGs comes after the faults being detected and isolated to recover the resiliency of the system. Fault reconfiguration can respond and detect the occurrence of short-circuit to ensure the safe, satisfactory, and reliable operation of DC power systems. Load shedding methods are efficient in fault reconfiguration after system failure [43], and DC bus reliabilities make them the best option to adopt [44],[45].

The aim of this paper is to provide a comprehensive review of fault management in DC MGs, including cutting-edge prospects and future challenges. In recent years, with the fast increase in the global demand for energy, DC and hybrid MGs are attracting much attention. The authors in [46]–[49]; have summarized the protection challenges and issues in DC MGs, while the authors in [50],[51] have addressed the challenges of DC fault protection and reconfiguration issues. Moreover, the structure and operational protection challenges of DC and Hybrid MGs are conducted in [52]–[55]. Although, these papers addressed the protection issues and challenges, including fault detection, fault location, identification, DC protection devices, and fault reconfiguration techniques; yet some concerns, like localization, reconfiguration/recovery, identification, and design of fault protection techniques in the DC MGs include the DC bus voltage instability during dynamic load fluctuation, have not been adequately addressed. According to the aforementioned literature, this review presents some specific future challenges associated with fault management operation in DC MGs that are not highlighted properly, which are moderately essential from the protection strand. A legitimate future direction cannot be inferred from the opaque analysis. Thus, this review paper broadly spotlights to execute the future challenges, improve fault protection methods, and present a transparent direction for fault management. Consequently, this analysis could be valuable, particularly for researchers, academicians, and engineers in this field.

The basic premise of this review is to analyze and present the detailed fault management techniques for DC MGs by examining works-related to intelligent fault detection methods (signal processing and ML), fault classification, location, fault isolation, fault recovery, and fault integration control strategies. In each protection technique, the technical difficulties with existing issues are highlighted. In addition, fault detection and reconfiguration of the DC MGs are also addressed. The existence of advanced strategies based on signal processing and ML methods opens a new and emerging field of research opportunities. However, unless otherwise, a fault refers to the short-circuit that is applied on any pole to pole (P-P), pole to the ground (P-G), and the fault on DC bus

segment are analyzed. The sudden onset of fault current exhibits the most challenging behavior, and appropriate protection approach must be able to address the scenario to minimize system damage, to continue to operate effectively without disabling the whole system. To investigate and identify the various fault occurrence in DC MGs, simulation studies were conducted with MATLAB/Simulink software to analyze the system performance by detecting and isolating the fault in terms of potential challenges and solutions.

The organization of this paper is as follows. Section II describes the characteristics and the types of DC faults. Section III presents the fault detection and classification categories. Fault isolation and reconfiguration are reviewed in Section IV. Section V describes the research challenges with future directions for these issues. Finally, the conclusion is drawn in Section VI.

II. FAULTS IN DC MICROGRIDS

Understanding and analyzing short circuit fault currents is an essential part of formulating an appropriate fault protection strategy. In addition, the fault current response of the DC power system needs to be analyzed, the coordination relay. High fault current damages the parts of DC MGs such as power converters; therefore, the power converter may lose voltage and current control, as they require a high power rating which increases the cost, and cascades tripping into other protection zones [56].

In DC MGs, short circuit faults occur in two different ways, pole to pole (P-P) (line to line) and pole to the ground (P-G) (line to ground). In the P-G fault, one or both conductors are connected to the ground. Therefore, the P-G fault is either a low or high impedance fault (HIF). The conductors are directly connected to the P-P fault. Therefore, P-P faults are low impedance faults that are more detectable and dangerous [28], [57], [58]. On the other hand, according to the current fault response time, DC MG divides the faults into two different groups: static/steady-state part and transient part. Table I summarizes the main characteristics of the defect in the DC MGs. The cable discharge of DC-link capacitors and power converters injects the transient current, and the DER injects the current into the steady-state [11]. However, a DC fault, depending on the fault location, can be a bus defect or a feeder defect. This defect is crucial for the entire DC system, in particular, the power converter and ESS. Faults in VSCs and energy storage devices can cause a P- P short-circuit fault and this is a terminal defect that usually can't be cleaned quickly. In these cases, the replacement of devices is being done, and using a fuse may be the right choice [59].

Recent literature presented the typical response of a DC fault in detail [12]. Reverse diodes are exposed as a result of the self-blockade of the IGBTs as a way to protect the whole network. The high-fault resources are played by the capacitors that are filter-charged. For instance, the typical fault profile can be overviewed from Fig. 3, irrespective of the fault or short circuit location on the DC cable.

TABLE I
MAIN FEATURES OF FAULTS IN DC MGS

Faults in DC Microgrid	Key Features
Pole-to-Pole Fault	Impedance is low, and this fault is detectable
Pole-to-Ground fault	Impedance is high, not critical compared to pole-to-pole fault
Transient fault parts	The cable discharge and DC link capacitors of the power converters inject the transient current. After switching the converters during fault occurs, the energy store in the inductance of the cable will discharge. The transient fault part has three states i.e. a) Fast-state, b) Medium state c) Slow front transient
Steady-state fault parts	Need to calculate current of each phase and DER injects the steady-state current

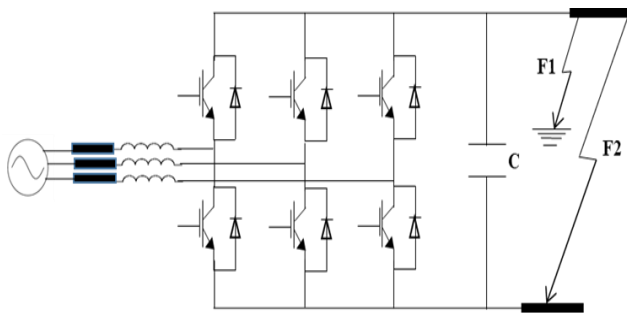


FIGURE 3. A faulted DC network equivalent circuit

A systematic review and analysis is presented based on the optimal protection strategy [60], where two separate phases define the natural responses of the whole circuit. These analyses define fault characteristics and help with protection strategies and also propose protection strategies that prevent damage. The capacitor discharge stage, a grid-side current stage and, a diode freewheel stage define the P-P fault in most of the DC MGS. The initial time t_0 of the fault, the capacitor discharges in a matter of milliseconds until the voltage drops to zero. At t_1 to t_2 the freewheel diodes charge when the cable inductances start flowing the current. The diode is vulnerable to damage at that point in time because of the high current flow rate through the semiconductor. The DC and AC current levels equalize after a certain time when the current magnitude drops down. After the freewheeling diode time period, the AC side feeds the network to the fault point. In [61], the P-G fault has been examined in detail. The typical P-G fault doesn't rely on freewheeling diodes. However, the rest of the features remain the same. Furthermore, DC MGS naturally have the absence of zero crossings, so AC CB cannot be applied for DC MGS protection.

Under this portion, the steady-state and transient features of DC MGS during the incidence of P-P and P-G fault are analyzed according to simulations results. These fault features are important for fault detection, disruption, and protection. The P-P fault, i.e., F2 on the terminals of the DC systems, as

shown in Fig. 3, can be treated as supplementary load along with low resistance, which relies on the fault impedance, location, and type of fault, DC network having PECs exhibits distinct fault response. The steady-state and transient fault current paths in DC systems during a P-P fault are described in Fig. 3. The DC line current tendency (I_{DC}) and DC voltage (V_{dc}) during the P-P fault are presented in Fig. 4. Initially, after the occurrence of fault at 0.5 secs, capacitors start the discharge causing a sudden drop in V_{dc} as depicted in Fig.4. The discharge of the DC-link capacitor results in a transient current having high amplitude and less rise time. The discharging of the capacitor causes a rapid rise in I_{dc} that can be seen in Fig. 4. The current from the input source rise quickly and flows through the IGBT paths.

The P-G fault, i.e., F1 on the DC network, is highlighted in Fig. 3. A similar response shows by the PECs to that of F2. The time of P-G fault V_{dc} drop and the freewheeling diodes become forward bias, and the input from the AC grid feed the short-circuit fault along IGBTs. However, if the P-G fault component through grid-connected VSC is high compared to current flowing in the negative pole of DC system into the negative pole terminal of VSC, the direction of current change and the VSC current starts to flow along the negative line of VSC into the negative DC pole. As a result, the input source contributes to the P-G fault, as illustrated in Fig. 3. In the case of the IGBT activation for the self-protection method, the fault current path of RES through the VSC negative terminal is cut off, while; the fault is fed by the AC input source through the freewheeling diode of the power converter. The DC P-G fault current (I_{dc}) and DC P-G voltage (V_{dc}) trends are depicted in Fig. 4, where it is clearly seen that the waveforms of P-G voltage and P-G current follow the same path during the fault.

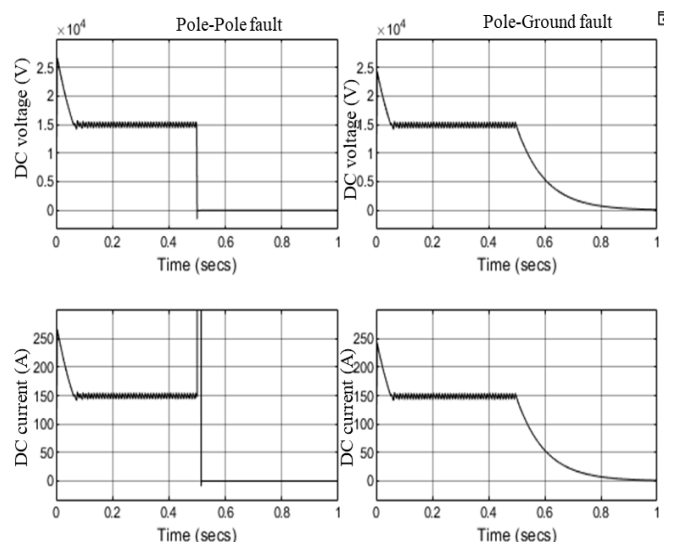


FIGURE 4. A DC bus voltage V_{dc} and current I_{dc} trends during P-P and P-G fault in the DC network

III. FAULT DETECTION AND CLASSIFICATION

The fault management of DC MG systems is essential to ensure the nominal operation and supports the main grid's stability with fast recovery performance. As mentioned earlier, the FM of DC MG comprises fault detection, identification, location, isolation, and reconfiguration. The detection and the classification of faults are the main part of the FM in DC MGs systems. However, in the conventional DC power systems, the radial configuration [62] and fault protection of DC systems are designed based on unidirectional power flow. Whereas, integration of Distribution Generation System (DGs) in DC system makes fault protection more challenging. DG rises fault current level causes the power flow direction of the DC power system to increase and change. Therefore, it can affect the coordination of defense devices. In addition, many of the challenges associated with the protection of DC systems are low impedance, large DC capacitors, high transient current and voltage.[63].

The CB is one of the fault current interrupters, which interrupts AC fault using naturally occurring zero crossings. As the natural zero-crossing method is inapplicable in DC systems, the application of conventional CB will not be possible. Therefore, the DC systems require a faster and intelligent fault protection technique with an appropriate grounding design [47]. DC MGs fault detection has been discussed in the literature. This review has also managed to include the fault detection and classification (FDC) in DC MGs systems based on employed techniques, like general safety/protection methods (i.e., distance safety operations based on fault calculation from the point of measurement of the defect site [64], direction and differential method [65]). Also, signal processing-based methods [23], artificial intelligence and machine learning-based methods [66], and model-based methods. Table II highlights various fault detection and classification based on signal processing principles.

A. SIGNAL PROCESSING BASED METHODS

Transmission lines and distribution systems, including DC MGs utilize the DSP. System parameters deviate from normal value during a faulty condition in the DC power system which in turn alters the output accordingly. The signal processing technique is based on analyzing the output signals and does not involve an explicit input-output model of the target system, and the output features correlate with the system faults [76]. The typical signal analysis methods include the fast Fourier transform (FFT), spectrum estimation, and the WT are described in [77]. The key features like fault detection are mainly extracted from the analysis of three signal processing-based methods (frequency domain, time domain, and combine time-frequency domain) [78].

Signals are being transformed from a time domain to an entirely novel domain based on the field transform techniques that offer a clearer picture of the data features. STFT is one of the commonly discussed techniques for the classification and

detection of DC MG failures [79]. The STFT is instigated to reduce the limitations of Fourier transform on the confined interval of signal, S-transform [80], [81], wavelet transforms [82],[83], and Hilbert-Huang transforms (HHT) [84],[85]. The various signal processing based fault detection and classification methods are given in Fig. 5.

TABLE II
FAULT DETECTION AND PROTECTION TECHNIQUES BASED ON SIGNAL-PROCESSING

Methods	Key feature and contributions
The Discrete Wavelet Transform (DWT) method was implemented to detect any surges in DC current signal [67]	During the surge, DWT is applied to detect the feature vector from the DC current signal and send it to the neural network. Later it encourages, whether the feature belongs to fault current surge in reason of short-circuit occurring across the DC link capacitor. It determines the irregularity of the signal approaching the fault detection in DC systems
Combine discrete WT and transform (DT) [68]	It is used to detect the fault in Microgrids. The fault classification is carried out by including WT-based features.
Wavelet transform (WT) and S-transform based methods [69]	Used for fault detection in grid-tied DG systems. It is used to study voltage stability at the Point of Common Coupling (PCC) with a nonlinear load connected during islanded operation modes
DWT and Extreme learning machine (ELM) based method [70]	Mostly utilized in the classification and fault localization. It can be utilized for fault management in both grid-tied and standalone modes of operation.
The classification of fault in MGs based on WT and ML Techniques [71]	Filters out the best fault localization features in transient signaling utilize the particle swarm optimization (PSO) algorithms. To identify the best wavelet function combination PSO is used instead of using only one wavelet function for fault classification to protect the DC MGs.
The Windowed Wavelet Transform (WWT) methods for fault detection and classification [72]	The fault detection method includes bagged D-Tree in which input features obtained from the signal processing techniques are utilized and is selected by correlation analysis
DWT based ANN [73]	The DWT based ANN is the most reliable and high effective technique used for the detection and location of the fault in DC MGs
The WT based ANN techniques for fault detection and location in DC-MGs [74]	It restricts time limits for the interruption of fault imposed due to the fast-rising of fault currents in DC MGs, and the absence of frequency and phasor information. The WT-based ANN technique is the best approach for the detection and isolation of fault without shutting down the whole system.
Hilbert-Huang transform (HHT) and deep learning-based technique for detection process in a sensor of DC MGs [75]	It used the Krill Herd Optimization (KHO) algorithm., HHT and deep learning for detecting cyber-attacks in DC MGs and detecting the attacks in DG units and its sensors.

1) WAVELET TRANSFORM BASED METHODS

WT is one of the most promising techniques in signal processing that can be applied in the detection of fault. The time frame is adjusted by the WT as per the frequency [86]. It

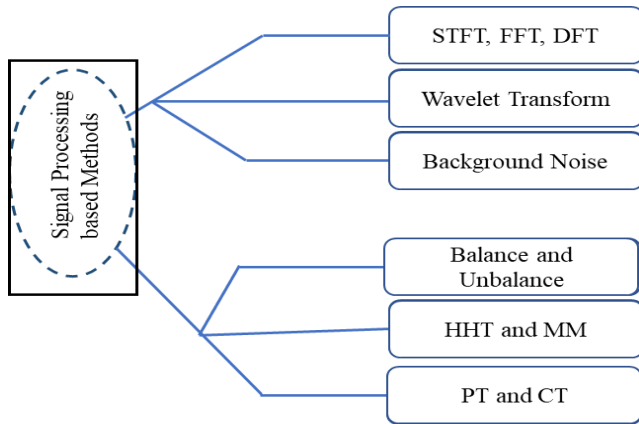


FIGURE 5. Signal processing based fault detection and classification

analyzes the transient behavior in the current or voltage signal related to the failure in frequency and time domains. WT has the feature to decompose the signals in its frequency components, having a different resolution level, later used for fault detection in DC MGs. Just as the other transform-based protection techniques like STFT, S-transform, and HHT, distance protection based on the WT-based transmission line [87] relies on a single decomposition level that consists of high frequencies for faults localization and bi-level phase estimation, those high frequencies are again utilized for fault estimation. Furthermore, fault in DC MGs is detected by using the WT-based signal processing strategy presented in [88] and traveling wave-based single-ended fault location [89].

The FFT and WT are investigated and presented to extract the signal's faulty feature, in which the disturbing signal is given as input to the ANNs model for the fault analysis depend on the significant time period [90]. WT is used to decompose the signal and parameterize the frequency and time-dependent localized signal. The parameterized features of the low frequency single are called "approximations," as well as a signal having high frequency content is called "details" [91],[92]. A researcher worked on the applications of WT, such as compression of the image, filtering and noise reduction as per DSP principles [93]. A WT-based system for monitoring power quality has been suggested to identify the transient fault in MGs is presented in [94]. Another researcher worked on the features that extract the component that is dependent on time and frequency for the transient signals to deteriorate the signal component is discussed in [95].

Fault detection revolves hugely around WT principles as well as the localization of the faults. A recent study, however, preferred wavelet packet transform (WPF) over the DWT for the accuracy of the information. [96]. The filters (such as low and high pass) are common to WPT and DWT for fault detection. The low phasor component is decomposed every time by the low and high pass filters, which are specific to DWT, while both components are equally regressed in WPT, which renders it more reliable in terms of accuracy. Concurrently, a researcher introduced the WT technique, also known as un-decimated WT, for fault localization [97] and

supported WT over the conventional DWT and WPT in case of real-time failure detection pertaining to its specific feature of lower-noise issues.

2) FAST FOURIER TRANSFORM BASED METHODS

Another recent advance in fault detection and localization is the Fast Fourier Transform (FFT). In [98], Fast Recursive Discrete Fourier Transform (FRDFT) is proposed by a researcher for failure detection. The algorithm in FRDFT helps with relay adjustment pertaining to the connected grid as well as the islanded mode in addition to the directional approach. The authors in [99] Communication-assisted fault location is also suggested by authors for classification and detection in DC microgrids. RDFT has also been used for the extraction of features alongside sequence analyzer. A faulty MG is detected by measuring the sequence and phasor and then using them as an FL-based input as per this method. In [100], MG protection from failures is also proposed by DFT techniques. Features that are extracted using DFT are presented by not limited to phase angulation, amplitude, frequency, and signals. At each end of the feeder, these salient factors are used as input for computational differential features. Although differential protection is considered reliable, data mining models are also incorporated in the events of the faulty microgrid.

3) SHORT TIME FOURIER TRANSFORM BASED METHODS

To effectively investigate and understand the application of STFT in consequence of fault detection in DC MGs due to fewer impacts of line inductance affect the sudden rising fault current. Therefore, a DC bus and a power converter are considered as the by-product of input signal decomposition when counted as frequency components. To obtain the frequency feature vector, the STFT is then utilized [101]. The STFT method is suggested for P-P fault detection and multiterminal DC MGs networks rather than FFT. Apart from line-to-line fault detection, selective operation validation frequency profiles to make stable operation and fault identification in DC system based on STFT presented in [102]. The STFT can be implemented for transient and fault signal analysis of the DC power system [102],[103]. The STFT has a limitation in resolution because of its fixed window size. In [104], the STFT and the DWT were integrated for early diagnosis of the fault because the STFT and WT suffer from certain limitations under non-stationary conditions. The STFT can overcome the limitation of Fourier transform on the limited time interval of the signal, and the feature like amplitude frequency obtained by STFT is used for fault detection. The STFT based protection of high voltage (HVDC) against pole-to-pole faults is suggested in [102]. The system monitored and decomposed the DC current into frequency components. The Standard deviation (SD) of the side portion acquired from the amplitude-frequency features is utilized for fault detection.

4) S-TRANSFORM BASED METHODS

Gabor transforms, and WT is another form of S-transform which is considered as an extension to the STFT [105]. S-transform is quite similar to the STFT in terms of providing the frequency range of signals. Islanding detection based on S-transform is presented by a researcher [105]. Energy spectral information is obtained by converting the negative sequence voltage and current. Load changes are frequent but less noticeable in the DC MGs as DG trips produce insignificant changes when studied cumulatively, which in turn determine the threshold. Another researcher proposed techniques for MG protection in both modes [106]. Another reason to prefer S-transform is its ability to provide frequencies that are high in the spectrum and work independently of any parameters towards fault indication. Additionally, a simplified S-transform reduces the computational burden of this method, which makes online calculations a lot easier. For reliable system operation, the DC grid requires high speed and robust fault detection techniques. With this regard, fault detection based on S-transform with adaptive adjustment is suggested in [107]. The improved S-transform is based on frequency-domain and detects the fault within 0.3 ms because the fault current speed is too high.

5) BACKGROUND NOISE BASED METHODS

The interconnected switching operations of DC systems have harmonic sources. It generates a certain amount of high-frequency noise by interacting electronic convertors with the cable insulation capacitances and stray inductances; repetitive switching transients occur in the system. During the occurrence of a fault in DC MGs, high-frequency noise in the repetitive transient switching prevents a good reading of the system impedance at high frequencies. For this purpose, as mentioned earlier, signal processing methods have been suggested for DC power system failures localization and detection such as the traveling waves-based fault detection methods, WT, etc. which measure the incident and reflected waves time difference. Prony-based fault recognition and algorithm based on the background noise of fault detector converter are two of the techniques discussed in [108]. Although the methods provide better results for the detection and location of the fault, and still require investigation for accuracy and hence are in the initial developmental phase. The background noise contains information related to the location of the fault.

6) HILBERT-HUANG TRANSFORM BASED METHODS

HHT is a powerful technique designed specifically for time-frequency representation implemented to any non-stationary information [109]. The implementation of this technique for AC MGs is discussed in [110] and compared to S-transform, where the HHT techniques process the differential currents and counted as a fault detection factor with its differential energy calculations. Fault detection thresholds are set after analyzing of data by considering the fault conditions are spilled into HIF, islanded mode, and the grid-connected mode. After a relative assessment, it is concluded that HHT is as effective as S-transform. In [111] HHT technique is

implemented for multiterminal high voltage DC system distance protection, high-frequency features are detected using the transform in transient state. The distance from CB to FL is the voltage input and output. The instantaneous amplitude-frequency is features of the signal component are provided by the HHT, which is used for distance estimation after average. Real-time testing is also implemented using the algorithm to detect a 10% failure. The signal noise is presented without any communication channels, which should be considered when testing in real-time. Furthermore, the application of the HHT technique in power systems for fault detection is studied in [112]. In this study, the HHT technique is suggested to analyze the signals to understand the dynamics of the process and extract the effective feature for fault detection, which are diagnosed by projecting the transient signal into a time-frequency domain. The islanding detection based on the HHT technique and extreme learning machines (ELM) in order to detect an islanding condition in a distribution system with DGs is suggested in [113]. Besides, the HHT technique is also implemented for studying fault detection, including the distributed system network (DSN) and MGs. [114] Another author combined ML with HHT to identify MG failures. The empirical mode decomposition (EMD) is adapted to compute intrinsic mode function (IMF) by measuring phase current at various locations. As a result, these features are used in the HHT process such as the inclusion in the ML model for error detection and classification. In [115], the author presented protection techniques for MGs using HHT techniques.

7) MATHEMATICAL MORPHOLOGY BASED METHODS

The mathematical morphology (MM) is a non-linear DSP technique such that it transforms signal shape to a geometrical structure. The MM provides several applicable tools that extract the desirable signal characteristics under the analysis of the appropriate structuring element (SE). SMEs are the standards for all MM modifications with signal length and shapes based on their use. MM contains two basic variables, namely, dilation and erosion, which are the basis for other modifications [116]. By combining these two modifications, some filters from the other are available for feature extraction from both single and wide markers. Unlike Fourier transform and WT, MM is fully operational in the time zone, and its power consumption plans are enhanced in [117] [118]. Filters designed for MM are used to detect unhealthy/faulty conditions, including HIFs, especially in AC-based systems with size and dimensions [118]. However, DC-based systems have only signal amplitude that provides an appropriate platform to use MM filters to address the time zone factor from deviations from normal current or electrical power signals.

The protection of DC MGs and AC MGs based on HIF detection techniques are examined in [119], [120]. In [119], HIF detection techniques in distribution systems are published based on the DWT of the current signal. However, it is not reliable in different system conditions, for example, within the grid-tied mode, the utility controls the voltage and frequency stability; however, these parameters escape the limits upon

islanding, which may result in irreparable damage to the DC MGs. In [120], the heuristic methods concerning with ANNs for HIF detection are proposed. The MM technique utilizes the opening and closing operators, which are non-complex and quickly applicable to high-frequency non-periodic signals. Therefore, a reliable and accurate signal element extraction technique without any distortion is obtained by implementing the MM technique. The erosion filters based on the MM technique are implemented for stand-alone mode detection of DC MGs within a short-period of time are presented in [121]. In DC power systems, the occurrence of the transient situation is caused by the resistor, capacitor, and inductor circuits (RCL) and switching-devices, which are instantly detected by the MM technique [122]. Moreover, the extraction of LIF and HIF detection is the quality of having a superior by implementing MM technique, deploying a regional-maxima based fault detection consequently upgrade the fault detection level of efficacy. Therefore, MM methods were applied for the detection of both HIF and LIF in DC MGs [123]. This study overviews a MM filters-based fault detection feature before damaging the freewheeling diodes of the PEC during the fault without requiring any communication links.

B. ADVANCE STRATEGIES FOR FAULT DETECTION AND PROTECTION OF DC MGS

Advance strategies for the protection of DC MGs mainly include AI and ML-based approaches. The protection and transient stability of DC MGs remains a complex issue [124], [58]. When a fault occurs in the system, it creates a massive current that could affect the entire system operation, and it could shut down the whole system. The possibility of locating faults quickly and isolating faulty sections from the healthy sections of the system would allow the rest of the DC MGs to maintain normal operation mode. For this purpose, the implementation of advanced techniques like AI and ML-based fault detection, location, fault classification, and fault reconfiguration is quite important to restore the transient stability of DC systems. The ANN has already been employed in AC MGs and have proven to be accurate, fast and robust in operation [125]. The capability to demonstrate the accurate performance of this network to protect the system is of utmost importance. The fault detection schemes offer robust responses when integrated with the soft criteria using differential AI and ML models as compared to a high threshold for measuring the uncertainties. Fault detection in power systems have been incorporated using SVM, DNN, K-nearest neighbor, D-Tree and ANN [126] [68], [36], [37], [127]. Intelligent and robust failure localization, which is unaffected by noise and disturbances in the DC power systems, is offered by an ML algorithm with better generalization capability and high computational speed. D-tree, SVM, ANN, and ML are also proposed for fault detection by a few researchers [39]. Fault detection according to its types using ANN is presented in [40], [128]. Longer detection times and complex ANN structures result as these schemes utilize sampled current measurements for the classification and training of failure events. The above-said methods are

used to get a faster solution and fewer errors to find the solution of complex multi-objective nonlinear systems. Fig. 6 depicts the existing and emerging fault detection techniques such as ML and AI as well as classification and localization.

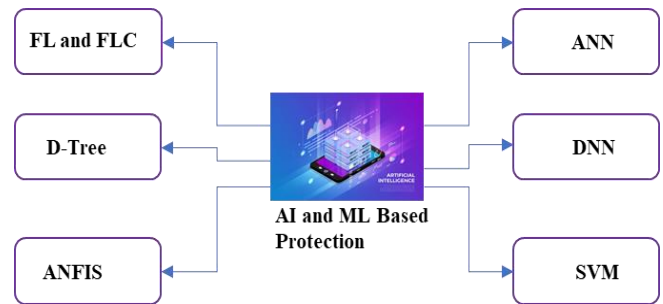


FIGURE 6. Fault detection, location, and classification techniques based on artificial intelligence and machine learning

The developing protection techniques and designing control for DC power systems extensively used AI principles [129]. In this study, AI and its application based protection tools describe the control of power systems based on motion control using fuzzy logic and neural network application. The protection of the LVDC system utilizes AL and ML algorithms. Among them, the promising technique demonstrated for detecting and locating the faults in DC MGs is illustrated in [130]. In this study, ANN is applied to obtain the fault classification and location in the MVDC shipboard power systems (SPS). They are using the transient detail in current and voltage signals by integrating a notable amount of data from directly sampled fault features, which can detect and locates the DC fault current compellingly. However, a significant amount of time is required for collecting the data and training the algorithm. To accomplish the smooth operation, the practical implementation with statistical-modeling has to be highly consistent, which required highly accurate collected data to protect the system. In this case, incorrect sampling and signal noise may increase the chance of malfunction under normal conditions [131]. The detection and the classification of fault in MVDC SPS based on ANN are discussed in [36]. Furthermore, the protection of a transmission line based on ANN is presented in [132]. In this study, an ANN-based fault discriminator is described for the protection of the transmission line.

1) FUZZY LOGIC BASED TECHNIQUES

A novel fault detection method using fuzzy logic is proposed for LVDC microgrids [133]. A fuzzy logic system makes the best and most appropriate decision based on several specific rules and conditions for any state of the DC grid. The fuzzy system aims to provide a fast fault detection in microgrids, regardless of the fault's type and current magnitude as well as power supply's feeding capacity, by instantaneous current monitoring that makes faulted section isolated and the remaining healthy section stay in normal operating mode.

The advantage of the fuzzy logic-based fault detection, identification, and classification is its knowledge representation using the simple statement "IF-Then" relation

[134]. The power system's operation in a transient period cannot be described by explicit artificial knowledge; because of many unknown parameters involved and affected the system. Integrating the neural network into the fuzzy logic system makes it possible to learn from the prior obtained data sets. For the identification of fault type in the digital relaying system, the fuzzy set approach is suggested in [135], [136]; and utilized for the identification of fault nature to protect systems. Fig. 7 depicts the existing fuzzy logic systems [137].

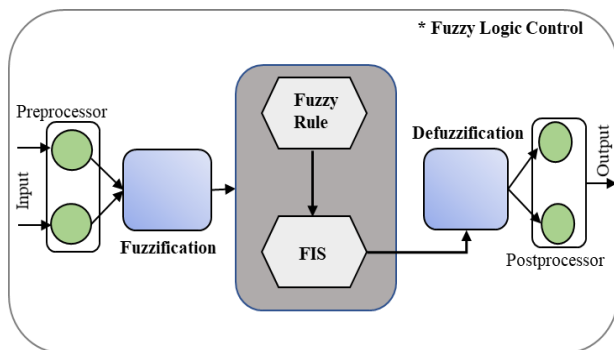


FIGURE 7. Fault classification based on fuzzy logic [137]

The fault detection and classification based on the fuzzy logic model is used for the protection of the transmission line [138]. In this study, the fuzzy controller's architecture is developed with the help of the relational neural network (RNN). Furthermore, the fuzzy controller consists of three elements: fuzzification, inference, and defuzzification. However, the classification of transmission system faults using transmission neural network (TNN) schemes has also been achieved in real-time, so it is more favorable for implementation in the actual power system to monitor the fault occurrence and take the necessary action to protect the MGs.

The intelligent fuzzy logic techniques, smart fault detection, and isolation in DC MGs by adopting the concept of fuzzy inference system (FIS) and fuzzy rules are presented in [133]. In this study, the investigation involves the fault detection algorithm in specific conditions, in which the common bus is divided into different segments and monitor each segment continuously. The slave controller measures the currents, speed, and accuracy of the master controller's fault detection depends on its ability to analyze the data and the detection algorithm.

The simulations study is presented for the protection of the DC MGs model consist of energy sources, loads (linear and non-linear), and ESS. The configuration consists of a single bus model. The DC supply input voltage is 250V, and the length of the DC bus cable is 0.5 Km with ground resistance 0.5 Ω. To suppress overshoots voltage caused by the cable inductance, the snubber circuits are connected with the IGBTs. The conditions of simulations are similar to differential-based fault protection. Thus, the P-G fault occurs at 0.8ms. The fuzzy logic-based DC MGs protection algorithm is defined based on logical operators i.e. AND, OR. The obtained results

specify that, the fuzzy logic-based controller takes only 20 microseconds for fault detection and send the trip signal to fault isolation parts, which indicates that fuzzy logic is more intelligent and effective as compared to the current differential approach. The smart performance and high potency are the main benefits of fuzzy logic-based protection. The fuzzy logic approach smartly monitored the current and variation in the current value and then trip the system for a few moments after the occurrence of fault. This occur when the currents and their rate of change on the source and load side suddenly increase high and initiate deviation in comparison to differential method. The fuzzy based protection technique speedily observed the variation in current which is above the limit value, and detect the fault very rapidly.

The input and output current of the bus segment considering the fast switching CBs and intelligent controller during the P-G fault are depicted in Fig. 8. It shows that the variation in input and output currents are similar in both differential and fuzzy based DC MGs protection. But, the ML based fuzzy logic controller intelligently/quickly predicted the increasing fault current value before reaching the limit and send the trip signal to the fault isolation parts within 20 microseconds. Utilization of fuzzy logic-based DC protection approach have capability of less damage to DC MGs devices and lesser fault current peak value.

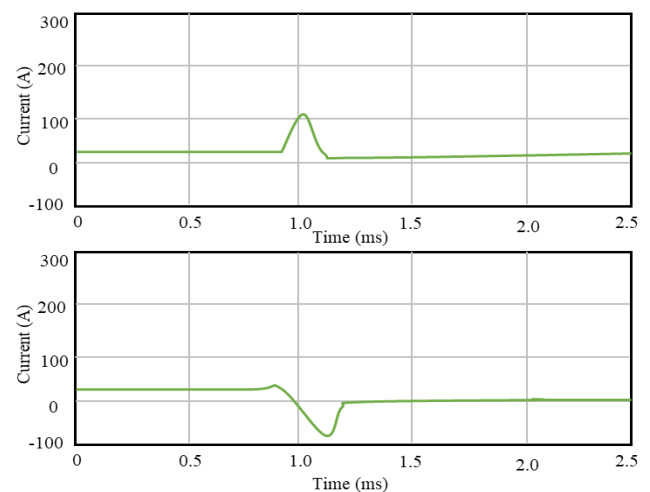


FIGURE 8. The source side and load side current during P-G fault with fuzzy logic-based DC MGs protection

The load voltage and freewheeling diode path current in fuzzy logic controller-based DC MGs protection are demonstrated in Fig. 9. It precisely shows that the fuzzy logic technique is capable of restoring and maintain the DC bus voltage for normal operating mode by intelligently detecting the fault and isolating the faulty portion within a short time interval in comparison to the current differential-based method. Through quick detection and interruption of rapidly increasing fault current, the fuzzy logic-based DC systems protection gives diode freewheeling smaller current compared

to the differential mode protection, which means that fuzzy logic-based method is more feasible because of semiconductors diode usage and cost of protection is very low. The voltage stress across the IGBT switch is also present in Fig. 9. It is reducing high voltage stress across the diode switch after fault isolation is the main benefit of fuzzy logic-based DC MGs protection. it also minimizes the costs in addition to allowing the utilization of semiconductor switches having less insulation voltage.

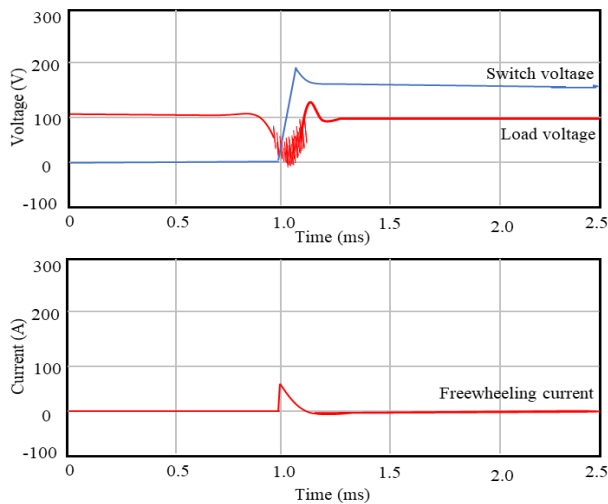


FIGURE 9. The switch voltage, load voltage and fault current in diode freewheeling path in Fuzzy logic-based DC MGs protection

2) DEEP NEURAL NETWORK

The traditional protection system is not more efficient for the detection and protection of faults in DC MGs. So, to improve the power efficiency, reliability, and system stability during operation and to maintain the energy demands, intelligent fault classification using DNN is investigated in [139]. DC MGs are protected using the DNN which is a type of deep learning (DL). Additionally, it is derived from the ML algorithm [140]. The high-level fault features are extracted using the DNN model [141].

Various challenges like system blackout, signal processing, and delays, CB tripping are dealt with fast and intelligent failure localization, isolation, and classification techniques proposed for the protection of DC MGs [139]. DNN is used to protect the systems using advanced fault detection and classification tasks as described in the study. Desired protection tasks are performed by the currents retrieved at the faulty relaying points. MGs use the AI approach for fault localization and detection [142]. Another author proposed combining DNN with DWT for classification and detection of the failures as well as identification [37]. DNN based fault detection in microgrid systems is depicted in Fig. 10.

DWT-based fault detection is suitable to filter out the desirable data [71], [68]. Data mining, SVM, K-nearest neighbor, and Naïve Bayes are the front-line choices for MGs

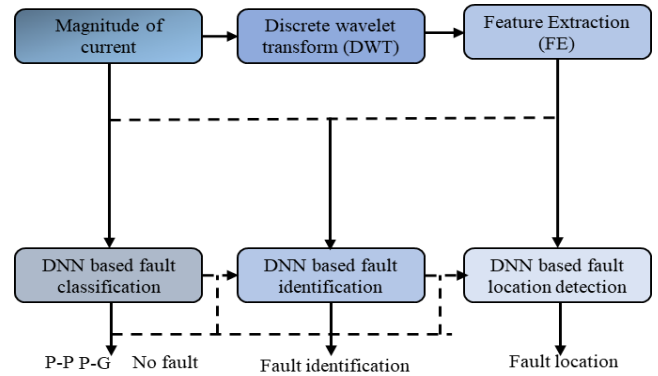


FIGURE 10. DNN based fault detection in microgrid systems

protection based on the ML model to develop possible solutions. High computation burdens, however, result in relays' delays which vouches for a need to develop an intelligent relaying system for the microgrid. An author proposed an intelligent differential protection algorithm to help protect MGs [143] which also provides classification and localization of the fault in power systems. By considering possible operating conditions, this technique takes both ends of the faulty line's current data in a microgrid for localization and classification of the failure. DNN based algorithm is developed by assuming the measurement of current, which shows the MG system conditions. Fault detection and fault type classification are two subtypes of fault identification systems [144]. Sub-problems are handled by neurons in the DNN. Current measured is used as input into the algorithm which is measured first at any relay end. Fault identification is assigned by that information to the DNN. Fault type information is provided in case of failure detection then the neurons in DNN give out detailed fault type information. Output details measure the later protective MGs. The main structure of DNN and the techniques employed to construct DNN are:

- Deep feedforward neural network (DFNN)
- Convolutional neural network (CNN)
- Configuration of DNN

In DNN based fault detection and identification model, initially, the current signal can be obtained from the measuring device; after that, it is processed through the DSP tool for faulty feature extraction of the signal. Later, the DSP signal is given as input to the DNN model for fault detection. Using this technique, the DNN based fault detection in DC MGs can be executed and further continue to achieve the following steps:

- The type of fault in DC MGs
- Pole at which fault appear
- The location at which fault occurs

Thus, to figure out the above mention task, a standalone DNN model is required to handle each problem. The flow chart of DNN based fault detection system for DC MGs is illustrated in Fig. 11. At the time of fault incidence, the first DNN model use for fault detection based on extracted feature input to DNN. After fault detection, a second DNN model is needed for fault classification; to check whether it is an unbalanced/ balance fault. Furthermore, at the same time, another DNN model is used for fault location identification. When the first DNN identifies that the fault is unbalanced, then the third DNN model is implemented for the identification of phase fault. Suppose the first model identifies the fault as balance, whether it is a P-P or P-G fault. The DNN model-based fault detection in DC MGs is very fast and provides a better result, especially for real-time problems. Finally, the information obtained can be utilized for control operation and decision-making process, e.g., isolation and recovery of fault in DC MGs.

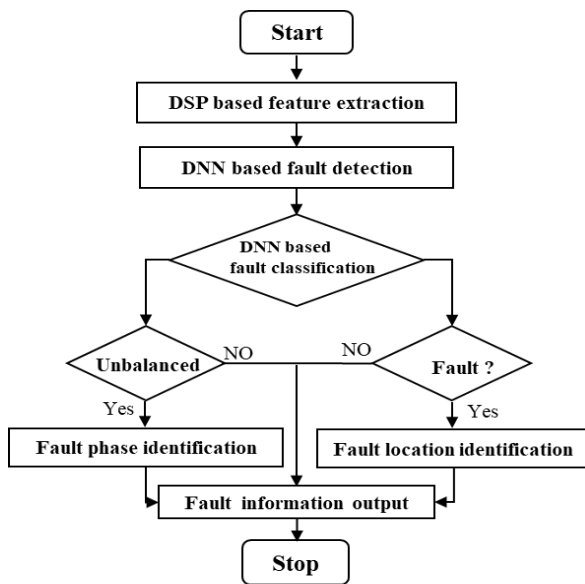


FIGURE 11. Flow chart of DNN based fault detection system for DC microgrid

3) ARTIFICIAL NEURAL NETWORK

In DC MGs, the power system's protection is of utmost importance, i.e., to prevent the circuit from over flow of current during a faulty event. A suitable protection plan in DC buses is needed because DC bus systems are unable to withstand high current loads. So, the ANN received much attention concerning fault detection, location, and classification in the power transmission network because of its better generalization and adaptive nature of work. ANN train the faulty signal as an input to determine the fault condition as an output [145]. Protection of DC power systems sometimes relies on AI and ML-based schemes to prevent the systems. DC MG fault localization is efficiently dealt with using the ANN-based strategies due to its speed and accuracy rates. [146],[66]. In [146] and [66], fault detection, location, and

isolation in the DC bus without shutting down the whole system to attain a reliable DC MG are presented in the above-mentioned articles. LV-based ML techniques are presented in DC MGs [146], while a fault in the DC bus is interconnected with the training of ANN. De-energizing of the system is prevented in the study for DC bus faults which is a lot faster to detect and isolate, resulting in reliable DC MG. Differential short circuit faults are the basis of neural network training in the DC system to maintain validity. Fig. 12 presents the DC MG fault detection and localization based on the ANN modules.

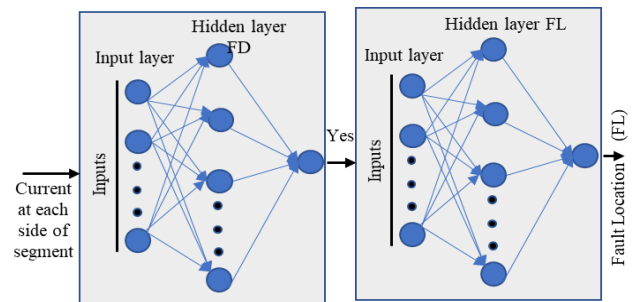


FIGURE 12. Artificial neural network model based fault detection and localization

The AI algorithm helps the DC system make the correct decision, tell whether the fault exists, and detect the fault location. To samples of waveforms are obtained for ANN training as presented in the DC fault analysis to detect and locate faults. The fault can be accurately detected and localized using the same input vectors applied in different ANNs. The wavelet multiresolution analysis is based on ANNs used for fault detection and location in DC MG [74]. In this study, ANN is used as a classifier because it provides a smart fault detection capability for a better solution. Above all, the relatively fast calculation time of ANN makes it a good candidate for the protection of DC MG due to the strict time restrictions inherited in DC fault isolation. Fig. 13 shows ANN-based fault detection and classification accuracies by concerning the type of fault. Fig. 13 explains the detection and location of faults (P-P and P-G) on the bus segment using the developed ANN module. In P-P and P-G faults, resistance shows 1Ω , 2.5Ω , 1.2Ω and 0.65Ω , 6Ω , 0.25Ω respectively. While, the fault location in each P-P and P-G is detected to train the model which shows 56%, 25%, 89% and 78%, 47%, 11% respectively. The expected results show high accuracy faults detection on bus segments, implementing the train ANN model. After accurately detecting and locating the faults on bus segments, CB is used for fault isolation. Moreover, the error accuracy within 1% for fault location is detected. Fault detection and classification techniques in MVDC SPSs by integrating ANNs with WT multi-resolution analysis technique are applied to protect DCSPS is discussed in [36].

To examine the ANN-based fault detection methods' effectiveness on the impact of noise/error in branch current measurements, time series current signals are added with the

Gaussian noise. For the test data formulation, the feature vectors are extracted from these signals. The typical signal-to-noise ratio (SNR) values of 50 dB, 30 dB, and 10 dB are used. The performance of the network containing error convergence with model accuracy is summarized in Table III. From the result, it is clearly seen that the error in the measurements has a significant impact on the overall fault identification accuracy of 98.5% in only the ANN model. In the considered worst scenario, (SNR of 10dB), the overall classification accuracy is only reduced to 2% compared to the current results with current measurements without noise error. Hence, it is concluded that the signal noise has an insignificant impact on the performance of only the ANN-based fault detection and identification method.

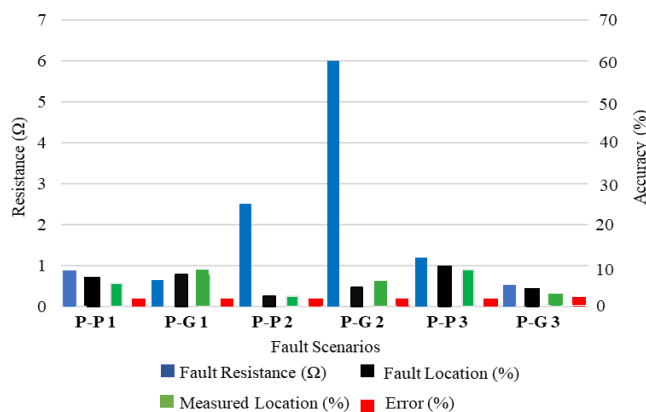


FIGURE 13. Accuracy comparisons of ANN-based fault detection and classification [75, 146]

TABLE III
ERROR CONVERGENCE WITH MODEL ACCURACY

Signal to Noise ratio (SNR)	Model Accuracy
Without noise	99.5%
50 dB	98.5%
30dB	98.0%
10 dB	97.5%

The flow chart of ANN model-based fault detection in DC MGs is shown in Fig. 14. The input current samples values are pre-processed using DSP methods to extract the fault features in both frequency and time domain [74]. Then, the extracted feature is given to the ANN model for detection and classification. If the fault is detected, then the model classifies the fault. The time series deviation of relative wavelet energy (RWT) in each decomposition level of the time series data embedding for the construction of the feature vector. The DWT-based decomposition method and ANN model for fault detection and classification are also discussed in [73]. In this study, the DWT and ANN models are deeply discussed, where it has been demonstrated that these techniques are very effective and reliable for fault detection and location in DC MGs.

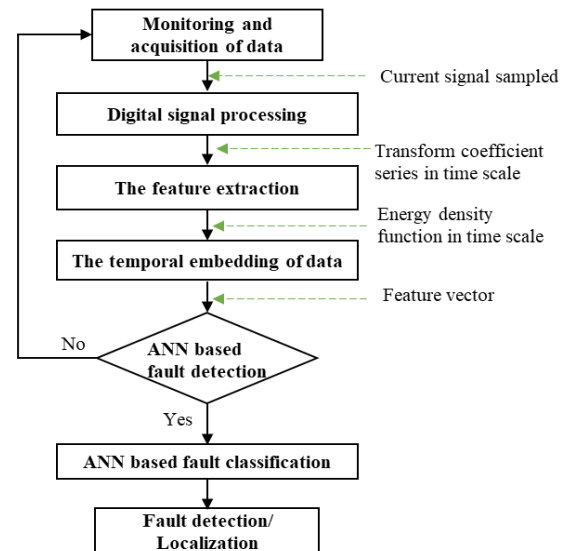


FIGURE 14. Flow chart of ANN based fault detection system for DC microgrid

For the stable operation of DC MGs, ANN-based strategy is capable of detecting the fault (P-P and P-G), and disconnect the fault current source to isolate the faulty portion in an effective manner. To restore the operation, reclosing is done after the detection and isolation of fault. The opening and reclosing of CBs and fault detections is controlled on DC bus without any communication link. The effective fault isolation and system recovery schemes for DC MGs are necessary to reduce the main grid blackout voltage to maintain the normal operation. The fault is created at 0.5 seconds during P-P and P-G faults. For the P-G fault, DC system can be isolated within less than 100 milliseconds, but in the P-P fault scenario, the grid outage voltage ranges from hundreds of milliseconds to seconds because it is dependent on fault current decay behavior. The voltage and current signal variation during mitigating of fault in the DC power system are depicted in Fig. 15. The DC fault current has a sudden increasing behavior after 0.5 seconds, while DC voltage decay starts which is associated with efficient fault detection.

The AI and ML techniques are adopted for the protection and power system control in DC MGs due to their error minimization capability, intelligent decision-making capability, high accuracy, robustness, and fast fault detection and classification. Though, ANN and DNN are prominently used in DC systems protection. A DNN is a deep conventional neural network with multiple hidden layers in between the input and output layers. In fact, ANN and DNN both are branches of the ML technique. However, the traditional neural network i.e. ANN can be either shallow or deep, therefore it is also called the shallow neural network (SNN) (i.e. one layer between input and output). The effective performance and high potency of DNN show more superiority as compared to the ANN due to their high network hierarchy and complex structure as depicted in Fig. 16.

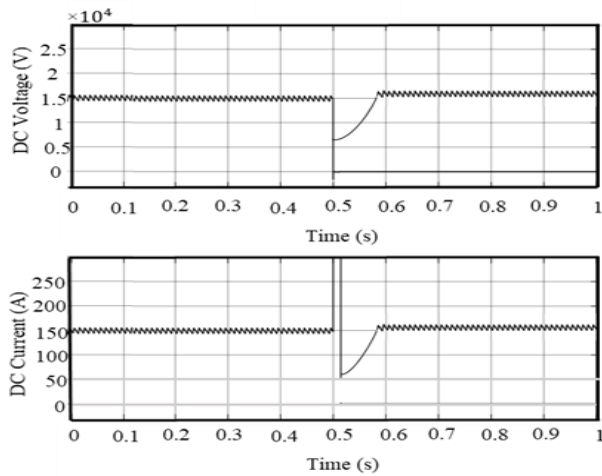


FIGURE 15. The waveforms of voltage and currents during fault mitigation

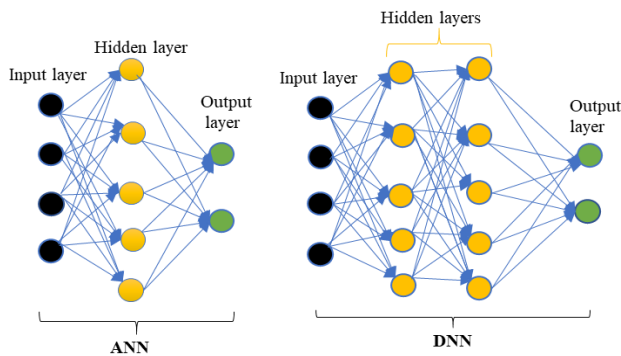


FIGURE 16. Structures of ANN and DNN

4) DECISION TREE-BASED TECHNIQUE

The AI and ML-based fault protection techniques have shown exemplary performance in AC MGs, but these protection techniques have not been adequately employed in DC MGs. In [41], an ANN has been utilized to detect and locates the fault, but MGs used in this paper is simple and also ANNs overfits when the number of hidden layer increases [147]. In [74], the combination of ANN and WT are implemented to detect and locates the occurrence of faults, but the proposed technique fails to identify the exact fault location in DC MGs. Also, in [148], the CNN is implemented to detect the faulty device like power converters, but these protection schemes are failing to protect the lines and loads properly. Therefore, the fault detection and location in DC MGs based on recurrent neural network (RCNN) and D-Tree presented in [149], in which the fault location on load feeders with high accuracy is determined by using RCNN. Besides, the D-Tree-based classifier is utilized to determine the overall system condition (whether it is healthy or faulty), as well as whether the fault is on the main DC bus or the lines. In [72], fuzzy logic- adaptive protection with bagged D-Tree-based techniques for fault detection and classification in protection relaying schemes for the microgrids.

The D-Tree algorithms are one of the most powerful ML techniques implemented for regression and classification as well as fault detection and locations by measuring the feeders current load and DC bus voltage continuously [150]. The D-Tree-based transient stability and islanding detection for fault protection using advanced data mining schemes is presented in [151], [152]. The D-Tree-based technique used for constructing optimal classification trees for fault detection and classification is explained in [153], [154]. So, a high degree of accuracy is obtained through a finding of methods resembling more than one tree for detection, locating, and the classification of fault [155], [156]. A D-Tree is an ML technique applied to breakdown complex problems into a hierarchy of simpler ones. While training a D-Tree, all training data is sent into the tree to optimize the internal nodes' parameters. Table IV. provides a summary of fault detection, locations, and classification methods in DC MGs based on AI and ML techniques.

TABLE IV
AI AND ML BASED FAULT DETECTION, LOCATION AND CLASSIFICATION FOR DC MGs

Methods	Key contributions	Limitations
ANN based-detection and location of a fault in DC MGs [146]	ANN technique effectively detects and locates the fault on the bus segment. Quickly detection and isolation, without de-energizing the entire system, and more reliable for DC MGs	The robustness of the uncertainty in measurement is not mentioned.
DNN [37]	Fast fault detection and location. Faults type, fault location information for DC MGs recovery	Reconfiguration of fault is not mentioned
Fuzzy Logic [129]	FL method is implemented for DC MGs protection.	It is used for detecting motion.
Fuzzy logic [157]	FL algorithm applied for detecting the unbalance in power and deviation in voltage. It improves the efficiency of the DC MGs.	It is only used for centralized methods
Hybrid ANN SVM [158]	It is used for the detection and location of fault for the protection of MGs. It has self-learning and self-training ability.	Complex and need a large number of datasets
Adaptive network-based FIS [88]	To identify the fault zone in MGs	Applicable only for the islanded mode operation. HIF is not mentioned
ANN [40],[146]	The main contribution is detection, location and isolation of fault in DC MGs and cannot require any communication.	Robustness to uncertainty in measurement is not mentioned.

C. MODEL BASED FAULT DETECTION AND IDENTIFICATION

DC MGs utilizes the model based fault detection and identification (FDI), which incorporates a detection factor as well. The parameter estimation and analytical knowledge of the DC power system comprise the model-based FDI, parity

relationship technique, as well as the observer/filter-based technique for FDI in DC MGs. Moreover, the control technique in DC MGs includes primary control, secondary, and central control functions. The main function of the local controller contained current/ voltage control for each VSC converter. The controller mainly covers the reliability, security, and economical operation for DC MGs at both interconnected DC MGs and proper communication with the main grid, which are suggested in [159]. DC MGs fault is divided into several types, i.e., AC side conventional fault, internal faults (include the switches failure IGBT and IGCT), and DC network faults. For the protection of DC MGs, the different types of protection strategies by detecting the fault in DC MGs, then isolation and configuration of fault. The model-based fault detection in DC MGs is presented in [160], where in this study, the novel model-based fault detection includes fault detection filter and Kalman fault detection filter techniques for fault detection in DC MGs. To design the filter, linear matrix inequalities (LMIs) are used. Fig. 17 depicts the model based fault-detection and isolation-technique.

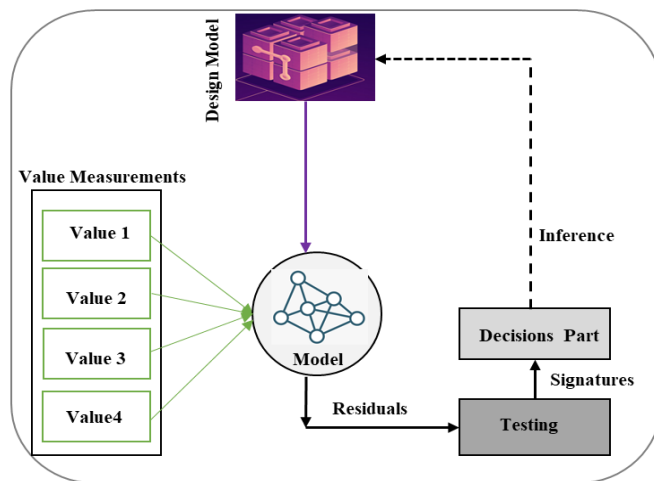


FIGURE 17. Model based fault detection and isolation techniques

The model-based scheme, which can be effective for fault detection in DC MGs, is presented in [78], and model-based fault detection and isolation in DC MGs are presented in [161]. These methods present the model-based fault management includes three stages like residual generation, statistical testing, and logical analysis of the system's fault. Recently In [162], the model-based FDI strategy has been presented for detecting components or the sensor faults for switching power converters. The model-based techniques are implemented with software, separating the effects of signals, disturbance, and fault on the residual signal, which is the main prerequisite for DC MGs protection. [163] used a model-based FDI to detect a fault in the DC/DC converters within the wind power generation systems. According to that study, a DC/DC converter's fault detection filter was designed and suggested. The proposed fault detection filter consists of a residual signal generator along with an observer. In [164], quantitative

model-based fault detection and isolation for a wind power generation system are discussed. Base on that study, a filter/observer is proposed, where the observer's innovation signal has been utilized for system modeling; and to detect and identify the faulty conditions. Moreover, the fault detection in MGs, smart MGs, along with model-based methods and their type, are presented in [165], [166], respectively.

D. A COMPARATIVE STUDY OF DIFFERENT METHODS OF FAULT MANAGEMENT IN DC MG SYSTEMS

The fault management of DC MGs poses many challenges such as (inception of the sudden increase in fault current and high peak fault current discharging from the DC-link capacitor, lack of appropriate DC current breaking equipment, lack of high preferential fault detection approaches, the long delay in fault isolation time as well as the physical experience of fault current measurement. Hence, the occurrence of a fault (P-P and P-G) and fault on the DC bus segment threaten the DC MGs operation). Despite their significant advantages of DC MGs protection and there are no written standards, experience or solution exist with regards to DC protection [11]. In DC MGs based on DGs and RESs, the potency of intelligent fault detection provides us some valuable benefits such as quick recovery, and fault restoration, which leads to a reduction in power interruption time [167], [15]. Various fault protection solutions have been proposed for DC MGs including overcurrent-based protection [11], [168], [169], current derivative-based method [11], and direction and under voltage-based protection [168]. However, the current and voltage dynamics have not been considered, and this technique causes unnecessary outage of sources and load in DC MGs.

The fault detection and isolation in low voltage DC bus MGs were presented in [58]. The limitation of this techniques is that; fault detection uses a specific threshold value, which means that fault occurs when the DC line current exceeds the threshold. Based on the operators experience the fault detection limit value is determined, which is the defecting factor. The present study aims to correct the limitation that occurs in [58], so that consideration and human actions do not affect the detection of the fault. Intelligent fault protection based on a Fuzzy logic system introduced for fault detection in DC MGs, where after the fault is erased, the whole system remains stable [134].

The fault protection performance and summary of different fault management techniques in DC MGs with the conducted fault protection techniques are provided in Table V. Thus, and it can be conducted that the proposed method has the potency to detect and isolate the fault smartly. Moreover, the suggested technique strongly locates the fault for isolation of the faulted section instantly by carefully monitoring the currents, and their deviation at both points on the faulted DC bus and systems will trip for few moments after the fault inception. When the input currents and their rate of change on both points increased steeply and it results in a deviation, which was not possible in the other fault protection methods of DC MGs. The

presented fault protection systems quickly detected change in the current rate that increases the threshold limit, and detect the fault instantly as an intelligent expert, which was not available in the compared protection methods.

TABLE V

A COMPARATIVE STUDY OF DIFFERENT METHODS FOR FAULT MANAGEMENT IN DC MICROGRID

Methods	Key Protection Challenges	Protection Remarks
Wavelet-based Multi-resolution Method ANN-based Analysis [74]	Influence of current branch ratings with noise, the current signals of the time series were supplemented by Gaussian white noise. Effective detection accuracy; and robustness to the measurement uncertainty like noise and smart detection of fault are the main protection challenges.	98%-99% of overall fault classification accuracy. Intelligently fault detection without any communication. It is featured by a quick fault localization and selective isolation.
Overcurrent with differential method [26]	Not able to detect HIF. The communication is link required to provide a quick and accurate method for the detection of the current direction. Dependency on differential current on line loading, wire length, and noise generated due to high sample rates. Robustness to uncertainty was not mention	To locate the fault and isolate the faulted section, it uses communication links between digital relays-measurement of error during transient coordination, system design issue, system architecture, and complexity of algorithms.
A Differential-based DC Protection [12]	Not proper measurements of current and misjudgment of direction. Primary protection failure. Reliability is less due to the small-scale deployment of fast CBs to have selective location and isolation of fault. Problems associated with unbalance load transient switching. The communication channel is required	For fault detection, it relies on a communication channel installed between the protection device on each side of the protected section. The drawbacks include, unable to provide backup protection. Robustness to uncertainty is not mentioned.
WT based method [170]	The drawbacks of WT-based DC protection method are; only frequency domain analysis and a high sample rate. Synchronization and transient analysis of the signal, issues of inertia and control of VSCs, and solution for transient state second-order derivative. Fault detection and localization are the main concerns.	WT technique is implemented for decomposition of common-mode current to detect and locate the ground fault at different network points. It requires a communication link. Moreover, the effectiveness of uncertainty was not mentioned

ANN Method [40], [128]

It has intelligent fault location and isolation capability. Challenges include more time consumption to estimate the signals criteria of the model without any communications, and it requires smart measuring algorithms. For fault detection, classification, and isolation this method requires data handling and burden reduction.

The sampled current measured values are directly implemented to classify the fault. For fault detection and location, it utilizes two ANN models. Within 1% error, the fault location can be detected. The fault classifier structure is complex. Though, it leads to long detection and training times. The ANN integrated with IGBTs to provide more efficient results with an overall classification accuracy of 99%.

The proposed Method

The fault detection in DC MGs based on the differential method [58] uses a specific threshold value, which means that when the DC bus line current is above the threshold value, the fault may occur. The limited value is determined based on the operator's experience, which is the main defect in the current differential-based methods

The fuzzy logic-based DC MGs protection takes less than 20 microseconds for fault detection and sends the fault isolation commands. The protection performance with high accuracy is the main concern of the fuzzy-based approach over the current differential methods.

In the current differential method for DC systems protection, it takes a long delay of 250 microseconds to detect the fault based on the current difference value and send trip command for fault isolation.

Quick detection is important to maintain the stability of DC MGs without waiting for a long delay to send a trip signals

IV. FAULT ISOLATION AND RECONFIGURATION

The fault isolation schemes are mainly used to stop the high short-circuit fault flow in the DC MGs by disconnecting the faulted part from the healthy one. As fault detection and locations are completed, the next step of fault management in DC MGs is fault isolation and fault reconfiguration to maintain systems reliability and stability. Whenever the fault is detected, it should be isolated from the rest of the healthy section. Different isolation techniques like DCCB, fuse, SSCB; and modular multilevel converter (MMC) configuration are the emerging breaker-less fault isolation devices. Recently, due to advancements in power electronic technologies, the researcher is focusing on breaker-less isolation. There are two types of fault isolation in DC MGs that are breaker-based fault isolation and breakerless based fault isolation.

In the DC system, the steady-state fault currents can damage the interfaced converters [103]. It is thus required that the fault detection and isolation must be completed within <10 ms. Furthermore, in the absence of natural zero crossings in DC

systems, additional arrangements are required while extinguishing the DC fault current for the protection of the DC MGs. For this purpose, different CB-based fault isolation techniques like DCCB, mechanical CBs, SSCB, and HCB used in DC power systems are discussed in [171]–[175]. In this study, the DC grids use voltage source converters and mechanical CBs. While “Breaker-less/converter-based” techniques are used for fault mitigation and eliminate the need for DCCBs in accordance with fully controllable PECs that coordinate with no load contactors or separate contactors to isolate fault [15], [176], [177]. The most indistinguishable protection is also closely related to the implementation of the DC power transmission system to minimize power loss to healthy parts of the system during the classification of potential errors and sequence recovery of the system. Another type of DC converters like a buck and boost type converter used for the limitation of fault current in DC power system presented in [178], [179], to reduce the harmonic distortion on phase current to a low level as well as the communication is required for the control purposes of the DC power system. The main efforts include switching losses, output power losses, efficiency, and total power losses.

The fault reconfiguration becomes an important aspect of the fault management in DC MGs after the fault detection and isolation. It ensures the continuity of power supply to the DC system during complicated operations such as cruising [180], ice-breaking [181], and dynamic positioning [182] for a marine mission to ensure the power flow to the critical load. In [183], the reconfiguration of the system network technique by considering the system reliability to control the power loss in distribution systems. While, In [184], the reconfiguration of a system network determines the minimum power loss in a network of distribution systems with uncertain load and renewable generation. The reconfiguration of fault in DC MGs mainly consists of load shedding selection strategies for reliable bus architecture to ensure the DC power supply from the generator to load. However, during the fault scenario, instability arises between the load and generator; this instability may cause the system blackout during operation. For this purpose, the protection of the system is quite important by implementing the fault reconfiguration methods [185]. The analytical hierarchy process to prioritize the load is presented [186]. In this study, expert control action determination modules have been developed to prioritize the load. The DC bus architecture dependencies including single bus architecture [20], multi-bus system [44], and DC zone-based fault isolation and reconfiguration presented in [187],[45]. The poor fault reconfiguration capability of the traditional DC bus makes it the least preferred choice for marine carriers such as ships. As mentioned in [26], the ring bus seems to have lower transient over-currents despite high power losses. Moreover, the resistance varies, which results in electromagnetic interference at switching frequencies. However, higher transient over currents with minimal losses are offered by the radial network. Multiple bus frameworks

can provide increased reliability of the DC SPS [44]. The impact of losses such as de-energizing of the DC bus could also be reduced by integrating ESSs in the converters, which would also improve fault detection, localization, isolation, and reconfiguration.

V. RESEARCH CHALLENGES AND FUTURE DIRECTIONS

The most challenging issue in DC MGs is fault management because of the lack of frequency and phasor information. Subsequently, lack of adequate standards in DC MGs protection, unintentional islanding, excessive circuit breakers, and protection coordination problems due to the intermittent nature of renewable energy sources and modes of operation. The other challenges include steep transition in DC fault current, direction, arcing, fault clearing time, and signal communication issues. Cogently, the power quality issue and cybersecurity issues are the prime challenges pose to the fault detection in DC MGs. It is pertinent to note here that the increased usage of renewable energy sources indigenously renders the researchers put forward new techniques to detect the fault in DC MGs.

The future research directions are as follows:

- Through innovating the communication network stability such as Local Area Network (LAN), Wide area network (WAN) and Field Area Network (FAN) and information security
- Intensifying a combined protection and control technique in future DC MGs can be effective in resolving the challenges like low voltage ride through (LVRT) and self-healing ability to provide fast fault recovery and resilience in response to the short-circuit situation.
- The intelligence control and protective devices like Solid State Transformer (SST), which mainly consists of high-power semiconductor components, high-frequency transformer (HFT), and the control circuits, which not only have the capability to Step-up and Step-down the voltage level but also have advantages like a) the power flow control (PFC) b) the short-circuit current limitation and c) seamless transition between the operating mode of DC MGs.
- Future efforts to protect DC MGs are expected to boost system intelligence by accomplishing effective integrated coordination between power-generation (PG), energy conservation, and end-user to maintain systems stability.
- To secure the upstream and downstream appliances would be one of the futuristic aspects of DC MGs. The development of DC MGs. The integration and protection of upstream and down stream devices will be an important factor in future research. With the growth of DC MGs, fault protection as a result of short circuits would be better handled. The controlling factor would be the first-line defense which would result in the advanced use of coordinated controls as opposed to the conservative protection schema.

- Implementation of computer vision-based deep learning methods and genetic algorithms (GA) for DC MGs to detect errors and their configurations enables full control of the secondary distribution network (SDN) using IoT-based sensors that will improve the reliability and potency of power systems. This research work will involve the development of a deep learning algorithm to include multiple types of DC short-circuits, the actual transmission of the model to the sensor node, and to improve its accuracy and efficiency so that it can be more accurate and faster, and error-corrected.
- By deploying the application of smart technologies like the internet of things (IoT) in the energy sector to monitor and control the power transmission, distribution, and supply system.
- By expanding the blockchain technology and smart IoT including cloud computing in the energy sector. Presently, IoT devices rely on centralization with the synchronization of multiple applications and machines. Security concerns regarding hacking have always been challenging. With the advent of blockchain, these issues can be dealt with effectively to help the end-users.
- Blockchain can help to resolve the need for multiple interfaces and foreign interference. Decentralization and democratized platforms also make it easier to synchronize a number of devices

The integration of IoT vision cloud and blockchain technology immensely acquires the advanced development and smooth shift towards the protection and secure control of load demands in DC MGs. By integrating RES, ESSs, and all-electric vehicles (EVs) into the smart grid, develop a broad research area on control techniques to address the challenges concern to DC power systems. The expedient feature of IoT vision and blockchain technology with wireless communication links initiate a productive fascination by investigating and adapting this recent technology in microgrid systems. Fig. 18 depicts the applications of IoT and blockchain technology in smart grids. The future research trend of emerging technology could be used as a new cyber layer that supports the operation and development of microgrid with various DGs. The cyber-physical security blockchain shall be responsible for handling security and data protection issues in smart grids.

In the coming era, IoT vision technology in smart power grid discussing the open issues, challenges, and future research trends which are classified into the following layer (i.e. physical layer, network layer, transport layer, application layer, miscellaneous issue, and the security issue) which has the ability to handle the hurdles in DC power system and we can apply this nascent technique in various smart grid applications such as energy acquisition, data fusion, congestion, huge data handling, devices integration, big data analytics, and other security issues. Apart from these issues and challenges, the backward capability, device-level power

usage limitations, multi-network providers, smart aggregation, interoperability of cross-domain IoT-based DC grids, smart meter configuration, prototyping, and scalability, which are the most important future research directions.

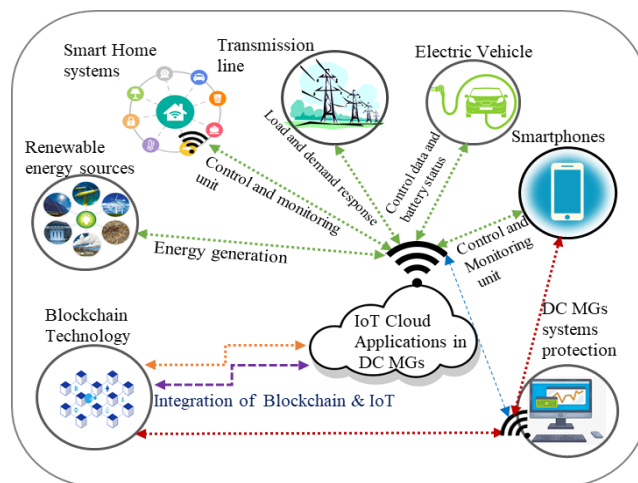


FIGURE 18. Integration of IoT and cloud computing technology in DC microgrids protection

VI. CONCLUSIONS

According to the distinct-characteristics of DC MGs during fault scenarios, proper fault detection in DC MGs becomes the prime focus of researchers after increasing dependency on renewable sources' usage. DC electric flow lacks many important features like frequency and phasor information, which pose a challenge to managing fault. However, signal processing based fault detection, wavelet based fault detection, background noise-based fault detection, and several other techniques discussed above are the prominent methodologies to manage fault in DC MGs. It is evident from the fact that dependency on DC MGs increases due to the excessive use of renewable sources of energy domestically as well as industrially. However, after detecting a fault, the fault location is being done in order to identify the fault. Once, the fault is identified, then the respective optimum methodology is used to restore the fault. Thus, in the future, fault management in DC MGs will be among the prior research fields

REFERENCES

- [1] Parlamento Europeu e do Conselho, "Proposta de Diretiva relativa à promoção da utilização de energia proveniente de fontes renováveis (reformulação)," *J. Of. da União Eur.*, vol. COM(2016), no. 767, pp. 1–116, 2017, [Online]. Available: https://ec.europa.eu/energy/sites/ener/files/documents/1_en_act_part1_v7_1.pdf0Ahttp://eurlex.europa.eu/resource.html?uri=cellar:3eb9ae57-faa6-11e6-8a3501aa75ed71a1.0007.02/DOC_1&format=PDF%0Ahttp://eurlex.europa.eu/legal-content/EN/TXT/?uri=CELEX:520.
- [2] H.Liao and J.V.Milanović, "Methodology for the analysis of voltage unbalance in networks with single-phase distributed generation," *IET Gener. Transm. Distrib.*, vol. 11, no. 2, pp. 550–559, 2017.
- [3] B. M.Eid, N. A.Rahim, J.Selvaraj, and A. H.EIKhateb, "Control methods and objectives for electronically coupled distributed energy

- resources in microgrids: A review," *IEEE Syst. J.*, vol. 10, no. 2, pp. 446–458, 2016.
- [4] X.Wang, J. M.Guerrero, F.Blaabjerg, andZ.Chen, "A review of power electronics based microgrids," *J. Power Electron.*, vol. 12, no. 1, pp. 181–192, 2012,
- [5] K.Das, A.Nitsas, M.Altin, A. D.Hansen, andP. E.Sorensen, "Improved Load-Shedding Scheme Considering Distributed Generation," *IEEE Trans. Power Deliv.*, vol. 32, no. 1, pp. 515–524, 2017.
- [6] C. N.Papadimitriou, E. I.Zountouridou, andN. D.Hatziargyriou, "Review of hierarchical control in DC microgrids," *Electr. Power Syst. Res.*, vol. 122, pp. 159–167, 2015.
- [7] F.Gao *et al.*, "Comparative Stability Analysis of Droop Control Approaches in Voltage-Source-Converter-Based DC Microgrids," *IEEE Trans. Power Electron.*, vol. 32, no. 3, pp. 2395–2415, 2017.
- [8] A.Tah andD.Das, "An Enhanced Droop Control Method for Accurate Load Sharing and Voltage Improvement of Isolated and Interconnected DC Microgrids," *IEEE Trans. Sustain. Energy*, vol. 7, no. 3, pp. 1194–1204, 2016.
- [9] L.Meng, T.Dragicevic, J. C.Vasquez, J. M.Guerrero, andJ. R.Pérez, "Modeling and sensitivity analysis of consensus algorithm based distributed hierarchical control for DC microgrids," *Conf. Proc. - IEEE Appl. Power Electron. Conf. Expo. - APEC*, vol. 2015-May, no. May, pp. 342–349, 2015.
- [10] M.Lonkar andS.Ponnaluri, "An overview of DC microgrid operation and control," *2015 6th Int. Renew. Energy Congr. IREC 2015*, 2015.
- [11] D.Salomonsson, L.Söder, andA.Sannino, "Protection of low-voltage DC microgrids," *IEEE Trans. Power Deliv.*, vol. 24, no. 3, pp. 1045–1053, 2009.
- [12] S. D. A.Fletcher, P. J.Norman, S. J.Galloway, P.Crolla, andG. M.Burt, "Optimizing the roles of unit and non-unit protection methods within DC microgrids," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 2079–2087, 2012.
- [13] H.Jiayi, J.Chuanwen, andX.Rong, "A review on distributed energy resources and MicroGrid," *Renew. Sustain. Energy Rev.*, vol. 12, no. 9, pp. 2472–2483, 2008.
- [14] A.El-Shahat andS.Sumaiya, "DC-microgrid system design, control, and analysis," *Electron.*, vol. 8, no. 2, 2019.
- [15] R. M.Cuzner andG.Venkataramanan, "The status of DC micro-grid protection," *Conf. Rec. - IAS Annu. Meet. (IEEE Ind. Appl. Soc.)*, pp. 1–8, 2008.
- [16] K.Dwlrq *et al.*, "Dxow &KdudfwhuljDwlrq Dqg 3Urhwhfwlyh 6Vwhp 'Hvljq Iru D 5Hvlgqhqlwldo ' & 0Lfurjulg," vol. 5, 2017.
- [17] G.Alee andW.Tschudi, "Edison redux: 380 Vdc brings reliability and efficiency to sustainable data centers," *IEEE Power Energy Mag.*, vol. 10, no. 6, pp. 50–59, 2012.
- [18] A.Kwasinski, "Quantitative evaluation of DC microgrids availability: Effects of system architecture and converter topology design choices," *IEEE Trans. Power Electron.*, vol. 26, no. 3, pp. 835–851, 2011.
- [19] ABB, "Technical Application Papers No.14 Faults in LVDC microgrids with front-end converters," no. 14, pp. 1–65, 2015.
- [20] T.Dragičević, X.Lu, J. C.Vasquez, andJ. M.Guerrero, "DC Microgrids - Part II: A Review of Power Architectures, Applications, and Standardization Issues," *IEEE Trans. Power Electron.*, vol. 31, no. 5, pp. 3528–3549, 2016.
- [21] ETSI, "Enviromentak Engineering (EE); Power supply interface at the input to telecommunications and datacom (ICT) equipment;," *Eur. Stand.*, vol. 1, no. 10, pp. 1–31, 2011.
- [22] "IEEE Std 946-1992: IEEE Recommended Practice for the Design of DC Auxiliary Power Systems for Generating Stations - Ghent University Library." <https://lib.ugent.be/catalog/ebk01:3780000000090477> (accessed Oct. 12, 2020).
- [23] I.Hwang, S.Kim, Y.Kim, andC. E.Seah, "A survey of fault detection, isolation, and reconfiguration methods," *IEEE Trans. Control Syst. Technol.*, vol. 18, no. 3, pp. 636–653, 2010.
- [24] M.Mobarrez, D.Fregosi, S.Bhattacharya, andM. A.Bahmani, "Grounding architectures for enabling ground fault ride-through capability in DC microgrids," *2017 IEEE 2nd Int. Conf. Direct Curr. Microgrids, ICDCM 2017*, pp. 81–87, 2017.
- [25] S.Eren, M.Pahlevani, A.Bakhshai, andP.Jain, "An adaptive droop DC-bus voltage controller for a grid-connected voltage source inverter with LCL filter," *IEEE Trans. Power Electron.*, vol. 30, no. 2, pp. 547–560, 2015.
- [26] J.DoPark, J.Candelaria, L.Ma, andK.Dunn, "DC ring-bus microgrid fault protection and identification of fault location," *IEEE Trans. Power Deliv.*, vol. 28, no. 4, pp. 2574–2584, 2013.
- [27] F. M.Uriarte *et al.*, "A DC arc model for series faults in low voltage microgrids," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 2063–2070, 2012.
- [28] M.Kempkes, I.Roth, andM.Gaudreau, "Solid-state circuit breakers for Medium Voltage DC power," *2011 IEEE Electr. Sh. Technol. Symp. ESTS 2011*, pp. 254–257, 2011.
- [29] J.Yang, J. E.Fletcher, andJ.O'Reilly, "Short-circuit and ground fault analyses and location in VSC-based DC network cables," *IEEE Trans. Ind. Electron.*, vol. 59, no. 10, pp. 3827–3837, 2012.
- [30] X.Song, C.Peng, andA. Q.Huang, "A Medium-Voltage Hybrid DC Circuit Breaker, Part I: Solid-State Main Breaker Based on 15 kV SiC Emitter Turn-OFF Thyristor," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 5, no. 1, pp. 278–288, 2017.
- [31] K.Dwlrq *et al.*, "Dxow &KdudfwhuljDwlrq Dqg 3Urhwhfwlyh 6Vwhp 'Hvljq Iru D 5Hvlgqhqlwldo ' & 0Lfurjulg," vol. 5, pp. 0–5, 2017.
- [32] K.Palaniappan, W.Sedano, N.Hoefl, R.Cuzner, andZ. J.Shen, "Fault discrimination using SiC JFET based self-powered solid state circuit breakers in a residential DC community microgrid," *2017 IEEE Energy Convers. Congr. Expo. ECCE 2017*, vol. 2017-Janua, pp. 3747–3753, 2017.
- [33] P. F.Ribeiro, C. A.Duque, P. M.daSilveira, andA. S.Cerqueira, *Power Systems Signal Processing For Smart Grids*. 2013.
- [34] N. W. A.Lidula andA. D.Rajapakse, "A pattern-recognition approach for detecting power islands using transient signals-part II: Performance evaluation," *IEEE Trans. Power Deliv.*, vol. 27, no. 3, pp. 1071–1080, 2012.
- [35] W.Li, M.Luo, A.Monti, andF.Ponci, "Wavelet based method for fault detection in Medium Voltage DC shipboard power systems," *2012 IEEE I2MTC - Int. Instrum. Meas. Technol. Conf. Proc.*, pp. 2155–2160, 2012.
- [36] W.Li, A.Monti, andF.Ponci, "Fault detection and classification in medium voltage dc shipboard power systems with wavelets and artificial neural networks," *IEEE Trans. Instrum. Meas.*, vol. 63, no. 11, pp. 2651–2665, 2014.
- [37] J. J. Q.Yu, Y.Hou, A. Y. S.Lam, andV. O. K.Li, "Intelligent fault detection scheme for microgrids with wavelet-based deep neural networks," *IEEE Trans. Smart Grid*, vol. 10, no. 2, pp. 1694–1703, 2019.
- [38] N.Perera andA. D.Rajapakse, "Recognition of fault transients using a probabilistic neural-network classifier," *IEEE Trans. Power Deliv.*, vol. 26, no. 1, pp. 410–419, 2011.
- [39] A. J.Mair, E. M.Davidson, S. D. J.McArthur, S. K.Srivastava, K.Schoder, andD. A.Cartes, "Machine learning techniques for diagnosing and locating faults through the automated monitoring of power electronic components in shipboard power systems," *IEEE Electr. Sh. Technol. Symp. ESTS 2009*, pp. 469–476, 2009.
- [40] I.Almutairy andM.Alluhaidan, "Fault Diagnosis Based Approach to Protecting DC Microgrid Using Machine Learning Technique," *Procedia Comput. Sci.*, vol. 114, pp. 449–456, 2017.
- [41] Q.Yang, J.Li, S.LeBlond, andC.Wang, "Artificial Neural Network Based Fault Detection and Fault Location in the DC Microgrid," *Energy Procedia*, vol. 103, no. April, pp. 129–134, 2016, doi: 10.1016/j.egypro.2016.11.261.
- [42] Z. J.Shen, G.Sabui, Z.Miao, andZ.Shuai, "Wide-bandgap solid-state circuit breakers for DC power systems: Device and circuit considerations," *IEEE Trans. Electron Devices*, vol. 62, no. 2, pp. 294–300, 2015.
- [43] K. M. C.Atendido andR.Zamora, "Reconfiguration and load shedding for resilient and reliable multiple microgrids," *2017 IEEE Innov. Smart Grid Technol. - Asia Smart Grid Smart Community, ISGT-Asia 2017*, pp. 1–5, 2018.
- [44] R. S.Balog andP. T.Krein, "Bus selection in multibus DC microgrids," *IEEE Trans. Power Electron.*, vol. 26, no. 3, pp. 860–867, 2011.

- [45] M. W. Rose and R. M. Cuzner, "Fault isolation and reconfiguration in a three-zone system," *2015 IEEE Electr. Sh. Technol. Symp. ESTS 2015*, pp. 409–414, 2015.
- [46] S. Beheshtaein, R. M. Cuzner, M. Forouzes, M. Savaghebi, and J. M. Guerrero, "DC Microgrid Protection: A Comprehensive Review," *IEEE J. Emerg. Sel. Top. Power Electron.*, no. May, pp. 1–1, 2019.
- [47] S. Beheshtaein, M. Savaghebi, J. C. Vasquez, and J. M. Guerrero, "Protection of AC and DC microgrids: Challenges, solutions and future trends," *IECON 2015 - 41st Annu. Conf. IEEE Ind. Electron. Soc.*, pp. 5253–5260, 2015.
- [48] S. Mirsaedi, X. Dong, S. Shi, and B. Wang, "AC and DC microgrids: A review on protection issues and approaches," *J. Electr. Eng. Technol.*, vol. 12, no. 6, pp. 2089–2098, 2017.
- [49] K. Satpathi, A. Ukil, and J. Pou, "Short-Circuit Fault Management in DC Electric Ship Propulsion System: Protection Requirements, Review of Existing Technologies and Future Research Trends," *IEEE Trans. Transp. Electrification*, vol. 4, no. 1, pp. 272–291, 2017.
- [50] W. Javed, D. Chen, M. E. Farrag, and Y. Xu, "System configuration, fault detection, location, isolation and restoration: A review on LVDC microgrid protections," *Energies*, vol. 12, no. 6, 2019.
- [51] D. M. Bui, S. L. Chen, C. H. Wu, K. Y. Lien, C. H. Huang, and K. K. Jen, "Review on protection coordination strategies and development of an effective protection coordination system for DC microgrid," *Asia-Pacific Power Energy Eng. Conf. APPEEC*, vol. 2015-March, no. March, 2014.
- [52] S. Mirsaedi, X. Dong, S. Shi, and D. Tzelepis, "Challenges, advances and future directions in protection of hybrid AC/DC microgrids," *IET Renew. Power Gener.*, vol. 11, no. 12, pp. 1495–1502, 2017.
- [53] S. Mirsaedi, X. Dong, and D. M. Said, "Towards hybrid AC/DC microgrids: Critical analysis and classification of protection strategies," *Renew. Sustain. Energy Rev.*, vol. 90, no. March, pp. 97–103, 2018.
- [54] D. K. J. S. Jayamaha, N. W. A. Lidula, and A. D. Rajapakse, "Protection and grounding methods in DC microgrids: Comprehensive review and analysis," *Renew. Sustain. Energy Rev.*, vol. 120, no. February 2019, p. 109631, 2020.
- [55] S. Sarangi, B. K. Sahu, and P. K. Rout, "Distributed generation hybrid AC/DC microgrid protection: A critical review on issues, strategies, and future directions," *Int. J. Energy Res.*, vol. 44, no. 5, pp. 3347–3364, 2020.
- [56] K. Satpathi, N. Thukral, A. Ukil, and M. A. Zagrodnik, "Directional protection scheme for MVDC shipboard power system," *IECON Proc. (Industrial Electron. Conf.)*, pp. 3840–3847, 2016.
- [57] M. Monadi, M. A. Zamani, J. I. Candela, A. Luna, and P. Rodriguez, "Protection of AC and DC distribution systems Embedding distributed energy resources: A comparative review and analysis," *Renew. Sustain. Energy Rev.*, vol. 51, pp. 1578–1593, 2015.
- [58] J. Do Park and J. Candelaria, "Fault detection and isolation in low-voltage dc-bus microgrid system," *IEEE Trans. Power Deliv.*, vol. 28, no. 2, pp. 779–787, 2013.
- [59] J. M. Meyer and A. Rufer, "A DC hybrid circuit breaker with ultra-fast contact opening and integrated gate-commutated thyristors (IGCTs)," *IEEE Trans. Power Deliv.*, vol. 21, no. 2, pp. 646–651, 2006.
- [60] S. D. A. Fletcher, P. J. Norman, S. J. Galloway, and G. M. Burt, "Determination of protection system requirements for DC unmanned aerial vehicle electrical power networks for enhanced capability and survivability," *IET Electr. Syst. Transp.*, vol. 1, no. 4, pp. 137–147, 2011.
- [61] J. Yang, J. E. Fletcher, and J. O'Reilly, "Multi-terminal DC wind farm collection and transmission system internal fault analysis," *IEEE Int. Symp. Ind. Electron.*, vol. 25, no. 4, pp. 2437–2442, 2010.
- [62] H. Ri et al., "7Udqvlhw 9Rowdjh Dqg) Uhtxhq\ 6Wdelolw \ Ri Dq," pp. 5–9, 2016.
- [63] S. A. Amamra, H. Ahmed, and R. A. El-Schiemy, "Firefly Algorithm Optimized Robust Protection Scheme for DC Microgrid," *Electr. Power Components Syst.*, vol. 45, no. 10, pp. 1141–1151, 2017.
- [64] T. S. Ustun, C. Ozansoy, and A. Zayegh, "Modeling of a centralized microgrid protection system and distributed energy resources according to IEC 61850-7-420," *IEEE Trans. Power Syst.*, vol. 27, no. 3, pp. 1560–1567, 2012.
- [65] A. K. Sahoo, "Protection of microgrid through coordinated directional over-current relays," *2014 IEEE Glob. Humanit. Technol. Conf. - South Asia Satell. GHTC-SAS 2014*, no. April, pp. 129–134, 2014.
- [66] S. Rahman Fahim, S. K. Sarker, M. Sheikh, and S. Das, "Microgrid Fault Detection and Classification: Machine Learning Based Approach, Comparison, and Reviews," *Energies*, vol. 13, no. 13, p. 3460, 2020.
- [67] C. S. Chang, Z. Xu, and A. Khambadkone, "Enhancement and laboratory implementation of neural network detection of short circuit faults in DC transit system," *IEE Proc. - Electr. Power Appl.*, vol. 150, no. 3, pp. 344–350, May 2003, Accessed: Aug. 24, 2020. [Online]. Available: https://digital-library.theiet.org/content/journals/10.1049/ip-epa_20030308.
- [68] D. P. Mishra, S. R. Samantaray, and G. Joos, "A combined wavelet and data-mining based intelligent protection scheme for microgrid," *IEEE Trans. Smart Grid*, vol. 7, no. 5, pp. 2295–2304, 2016.
- [69] P. K. Ray, S. R. Mohanty, and N. Kishor, "Disturbance detection in grid-connected distributed generation system using wavelet and S-transform," *Electr. Power Syst. Res.*, vol. 81, no. 3, pp. 805–819, 2011.
- [70] M. Manohar, E. Koley, and S. Ghosh, "Microgrid protection under wind speed intermittency using extreme learning machine," *Comput. Electr. Eng.*, vol. 72, pp. 369–382, 2018.
- [71] T. S. Abdelgayed, W. G. Morsi, and T. S. Sidhu, "A new approach for fault classification in microgrids using optimal wavelet functions matching pursuit," *IEEE Trans. Smart Grid*, vol. 9, no. 5, pp. 4838–4846, 2018.
- [72] S. Netsanet, J. Zhang, and D. Zheng, "Bagged decision trees based scheme of microgrid protection using windowed fast fourier and wavelet transforms," *Electron.*, vol. 7, no. 5, 2018.
- [73] S. Ghosh, A. Ghatak, D. Khan, and G. Roy, "A Survey on DC Microgrid Fault Detection Techniques," *SSRN Electron. J.*, no. January, pp. 0–3, 2020.
- [74] D. K. J. S. Jayamaha, N. W. A. Lidula, and A. D. Rajapakse, "Wavelet-Multi Resolution Analysis Based ANN Architecture for Fault Detection and Localization in DC Microgrids," *IEEE Access*, vol. 7, pp. 145371–145384, 2019.
- [75] H. Cui, X. Dong, H. Deng, M. Dehghani, K. Alsubhi, and H. M. A. Aljahdali, "Cyber Attack Detection Process in Sensor of DC Micro-Grids Under Electric Vehicle based on Hilbert-Huang Transform and Deep Learning," *IEEE Sens. J.*, no. c, pp. 1–1, 2020.
- [76] X. Dai and Z. Gao, "From model, signal to knowledge: A data-driven perspective of fault detection and diagnosis," *IEEE Trans. Ind. Informatics*, vol. 9, no. 4, pp. 2226–2238, 2013.
- [77] A. Bouzida, O. Touhami, R. Ibtouen, A. Belouchrani, M. Fadel, and A. Rezzoug, "Through Discrete Wavelet Transform," *IEEE Trans. Ind. Electron.*, vol. 58, no. 9, pp. 4385–4395, 2011.
- [78] Z. Gao, C. Cecati, and S. X. Ding, "A survey of fault diagnosis and fault-tolerant techniques-part II: Fault diagnosis with knowledge-based and hybrid/active approaches," *IEEE Trans. Ind. Electron.*, vol. 62, no. 6, pp. 3768–3774, 2015.
- [79] R. W. Schafer, "of a Speech Analysis- Synthesis System Based realization," *Audio*, no. 1, 1973.
- [80] S. Institution of Engineering and Technology. and S. R. Samantaray, *IET generation, transmission & distribution.*, vol. 8, no. 2. Institution of Engineering and Technology, 2007.
- [81] R. A. Brown, M. Louis Lauzon, and R. Frayne, "A General description of linear time-frequency transforms and formulation of a fast, invertible transform that samples the continuous S-transform spectrum nonredundantly," *IEEE Trans. Signal Process.*, vol. 58, no. 1, pp. 281–290, 2010.
- [82] P. Pillaya Bhattacharjee, "Application of wavelets to model short-term power system disturbances," *IEEE Trans. Power Syst.*, vol. 11, no. 4, pp. 2031–2037, 1996.
- [83] R. Escudero, J. Noel, J. Elizondo, and J. Kirtley, "Microgrid fault detection based on wavelet transformation and Park's vector approach," *Electr. Power Syst. Res.*, vol. 152, pp. 401–410, 2017.
- [84] "Power Grid Faults Location with Traveling Wave Based on Hilbert-Huang Transform--《Automation of Electric Power Systems》2008年 08 期 ." http://en.cnki.com.cn/Article_en/CJFDTotal-DLXT200808015.htm (accessed Aug. 20, 2020).

- [85] L.Zhang, X.Han, J.Jia, T.Gao, and Y.Ma, "Power systems faults location with traveling wave based on Hilbert-Huang transform," *2009 Int. Conf. Energy Environ. Technol. ICEET 2009*, vol. 2, no. 5, pp. 197–200, 2009.
- [86] H. N. D. R. Rosa M de castro M fernandez, "An overview of wavelet transforms application in power systems," *14 th Power Syst. Comput. Conferr. Sevilla*, no. June, pp. 24–28, 2002.
- [87] P. Balakrishnan, K. Sathiyasekar, and S. Rakkimithu, "Transmission line protection based on discrete wavelet transform," *Int. J. Appl. Eng. Res.*, vol. 9, no. 24, pp. 27379–27392, 2014.
- [88] Y. Y. Hong, Y. H. Wei, Y. R. Chang, Y. DerLee, and P. W. Liu, "Fault detection and location by static switches in microgrids using wavelet transform and adaptive network-based fuzzy inference system," *Energies*, vol. 7, no. 4, pp. 2658–2675, 2014.
- [89] Y. Shi, T. Zheng, and C. Yang, "Reflected traveling wave based single-ended fault location in distribution networks," *Energies*, vol. 13, no. 15, 2020.
- [90] F. Filippetti, G. Franceschini, C. Tassoni, and P. Vas, "Recent developments of induction motor drives fault diagnosis using AI techniques," *IEEE Trans. Ind. Electron.*, vol. 47, no. 5, pp. 994–1004, 2000.
- [91] S. A. Saleh, "Signature-coordinated digital multirelay protection for microgrid systems," *IEEE Trans. Power Electron.*, vol. 29, no. 9, pp. 4614–4623, 2014.
- [92] S. A. Saleh, R. Ahshan, M. S. Abu-Khaizaran, B. Alsaid, and M. A. Rahman, "Implementing and testing d-q WPT-based digital protection for microgrid systems," *IEEE Trans. Ind. Appl.*, vol. 50, no. 3, pp. 2173–2185, 2014.
- [93] R. R. Coifman and M. V. Wickerhauser, "Entropy-based algorithms for best basis selection," *IEEE Trans. Inf. Theory*, vol. 38, no. 2, pp. 713–718, 1992.
- [94] H. T. Yang and C. C. Liao, "A de-noising scheme for enhancing wavelet-based power quality monitoring system," *IEEE Trans. Power Deliv.*, vol. 16, no. 3, pp. 353–360, 2001.
- [95] X. Long and Y. W. Li, "A new technique to detect faults in de-energized distribution feeders," *Proc. Int. Conf. Harmon. Qual. Power, ICHQP*, vol. 26, no. 3, pp. 64–69, 2012.
- [96] B. P. Kumar, G. S. Ilango, M. J. B. Reddy, and N. Chilakapati, "Online fault detection and diagnosis in photovoltaic systems using wavelet packets," *IEEE J. Photovoltaics*, vol. 8, no. 1, pp. 257–265, 2018.
- [97] A. Yilmaz and G. Bayrak, "A real-time UWT-based intelligent fault detection method for PV-based microgrids," *Electr. Power Syst. Res.*, vol. 177, no. August, 2019.
- [98] D. S. Kumar, D. Srinivasan, and T. Reindl, "A Fast and Scalable Protection Scheme for Distribution Networks with Distributed Generation," *IEEE Trans. Power Deliv.*, vol. 31, no. 1, pp. 67–75, 2016.
- [99] B. Chaitanya, A. Yadav, and A. Soni, "Communication assisted fuzzy based adaptive protective relaying scheme for microgrid," *J. Power Technol.*, vol. 98, no. 1, pp. 57–69, 2018.
- [100] S. Kar and S. Ranjan Samantaray, "A Fuzzy Rule Base Approach for Intelligent Protection of Microgrids," *Electr. Power Components Syst.*, vol. 43, no. 18, pp. 2082–2093, Nov. 2015.
- [101] T. Tao, "右上端 (Fourier Transform) 左上端 (Fourier Transform)," vol. 30, no. Iii, pp. 1–5, 1990.
- [102] Y. M. Yeap and A. Ukil, "Fault detection in HVDC system using Short Time Fourier Transform," *IEEE Power Energy Soc. Gen. Meet.*, vol. 2016-Novem, pp. 8–12, 2016.
- [103] K. Satpathi, Y. M. Yeap, A. Ukil, and N. Gedda, "Short-Time Fourier Transform Based Transient Analysis of VSC Interfaced Point-to-Point DC System," *IEEE Trans. Ind. Electron.*, vol. 65, no. 5, pp. 4080–4091, 2018.
- [104] E. Cabal-Yepez, A. G. Garcia-Ramirez, R. J. Romero-Troncoso, A. Garcia-Perez, and R. A. Osornio-Rios, "Reconfigurable monitoring system for time-frequency analysis on industrial equipment through STFT and DWT," *IEEE Trans. Ind. Informatics*, vol. 9, no. 2, pp. 760–771, 2013.
- [105] S. R. Samantaray, A. Samui, and B. C. Babu, "S-transform based cumulative sum detector (CUSUM) for islanding detection in Distributed Generations," *2010 Jt. Int. Conf. Power Electron. Drives Energy Syst. PEDES 2010 2010 Power India*, 2010.
- [106] E. Maali Amiri and B. Vahidi, "Integrated protection scheme for both operation modes of microgrid using S-Transform," *Int. J. Electr. Power Energy Syst.*, vol. 121, no. March, p. 106051, 2020.
- [107] D. Li, A. Ukil, K. Satpathi, and Y. M. Yeap, "Improved S Transform Based Fault Detection Method in VSC Interfaced DC System," *IEEE Trans. Ind. Electron.*, vol. 0046, no. c, pp. 1–1, 2020.
- [108] Y. Pan, P. M. Silveira, M. Steurer, T. L. Baldwin, and P. F. Ribeiro, "A fault location approach for high-impedance grounded DC shipboard power distribution systems," *IEEE Power Energy Soc. 2008 Gen. Meet. Convers. Deliv. Electr. Energy 21st Century, PES*, pp. 2–7, 2008.
- [109] P. Spanos, "Review of The Hilbert-Huang Transform in Engineering," edited by Norden E. Huang and Nii O. Attoh-Okiné The Hilbert-Huang Transform in Engineering Taylor & Francis, CRC Press \$149.85," *J. Waterw. Port, Coastal, Ocean Eng.*, vol. 132, no. 5, pp. 426–427.
- [110] A. Gururani, S. R. Mohanty, and J. C. Mohanta, "Microgrid protection using Hilbert-Huang transform based-differential scheme," *IET Gener. Transm. Distrib.*, vol. 10, no. 15, pp. 3707–3716, 2016.
- [111] V. A. Institution of Engineering and Technology., R. M. Monaro, D. Campos-Gaona, D. V. Coury, and O. Anaya-Lara, *IET generation, transmission & distribution.*, vol. 14, no. 15. Institution of Engineering and Technology, 2007.
- [112] Z. Li, "Hilbert-Huang transform based application in power system fault detection," *2009 Int. Work. Intell. Syst. Appl. ISA 2009*, pp. 25–28, 2009.
- [113] M. Mishra, M. Sahani, and P. K. Rout, "An islanding detection algorithm for distributed generation based on Hilbert-Huang transform and extreme learning machine," *Sustain. Energy, Grids Networks*, vol. 9, pp. 13–26, 2017.
- [114] M. Mishra and P. K. Rout, "Detection and classification of micro-grid faults based on HHT and machine learning techniques," *IET Gener. Transm. & Distrib.*, vol. 12, no. 2, pp. 388–397, Sep. 2017. Accessed: Aug. 27, 2020. [Online]. Available: <https://digital-library.theiet.org/content/journals/10.1049/iet-gtd.2017.0502>.
- [115] A. Institution of Engineering and Technology., S. R. Mohanty, and J. C. Mohanta, *IET generation, transmission & distribution.*, vol. 10, no. 15. Institution of Engineering and Technology, 2007.
- [116] M. V. Polignano, *濟無 No Title No Title*, vol. 53, no. 9, 2019.
- [117] S. Gautam and S. M. Brahma, "Overview of mathematical morphology in power systems - A tutorial approach," *2009 IEEE Power Energy Soc. Gen. Meet. PES '09*, pp. 1–7, 2009.
- [118] Y.-S. Oh *et al.*, "Detection of high-impedance fault in low-voltage DC distribution system via mathematical morphology," *J. Int. Counc. Electr. Eng.*, vol. 6, no. 1, pp. 194–201, 2016.
- [119] F. Ghalavand, B. A. Mohammadi Alizade, H. Gaber, and H. Karimipour, "Microgrid islanding detection based on mathematical morphology," *Energies*, vol. 11, no. 10, pp. 1–18, 2018.
- [120] M. Chen, Y. Huang, and J. Qu, "High impedance fault identification method of distribution network," *Chongqing Daxue Xuebao/Journal Chongqing Univ.*, vol. 36, no. 9, pp. 83–88, 2013.
- [121] M. J. B. Reddy, D. V. Rajesh, P. Gopakumar, and D. K. Mohanta, "Smart fault location for smart grid operation using RTUs and computational intelligence techniques," *IEEE Syst. J.*, vol. 8, no. 4, pp. 1260–1271, 2014.
- [122] E. Guillén-García, L. Morales-Velazquez, A. L. Zorita-Lamadrid, O. Duque-Perez, R. A. Osornio-Rios, and R. D. J. Romero-Troncoso, "Accurate identification and characterisation of transient phenomena using wavelet transform and mathematical morphology," *IET Gener. Transm. Distrib.*, vol. 13, no. 18, pp. 4021–4028, 2019.
- [123] N. Bayati, H. R. Baghaee, A. Hajizadeh, M. Soltani, and Z. Lin, "Mathematical morphology-based local fault detection in DC Microgrid clusters," *Electr. Power Syst. Res.*, vol. 192, no. November 2020, p. 106981, 2021.
- [124] J. A. Marrero, "DC Systems," vol. 00, no. c, pp. 1707–1711.
- [125] G. Patil and M. F. A. R. Satarkar, "Autonomous protection of low voltage DC microgrid," *2014 Int. Conf. Power, Autom. Commun. INPAC 2014*, pp. 23–26, 2014.
- [126] I. Almutairy and M. Alluhaidan, "ScienceDirect ScienceDirect Fault Diagnosis Based Approach to Protecting DC Microgrid Using

- Machine Learning Technique,” *Procedia Comput. Sci.*, vol. 114, pp. 449–456, 2017.
- [127] S.Kar, S. R.Samantaray, andM. D.Zadeh, “Data-Mining Model Based Intelligent Differential Microgrid Protection Scheme,” *IEEE Syst. J.*, vol. 11, no. 2, pp. 1161–1169, 2017.
- [128] Q.Yang, J.Li, S.Le, andC.Wang, “Artificial Neural Network Based Fault Detection and Fault Location in the DC Microgrid,” *Energy Procedia*, vol. 103, no. April, pp. 129–134, 2016.
- [129] B. K.Bose, “Expert system, fuzzy logic, and neural networks in power electronics and drives,” *Power Electron. Var. Freq. Drives Technol. Appl.*, vol. 82, no. 9402594, pp. 559–630, 1996.
- [130] N. K.Chanda andY.Fu, “ANN-based fault classification and location in MVDC shipboard power systems,” *NAPS 2011 - 43rd North Am. Power Symp.*, 2011.
- [131] K.DeKerf *et al.*, “Wavelet-based protection strategy for DC faults in multi-terminal VSC HVDC systems,” *IET Gener. Transm. & Distrib.*, vol. 5, no. 4, pp. 496–503, Apr.2011, Accessed: Aug.06, 2020. [Online]. Available: <https://digital-library.theiet.org/content/journals/10.1049/iet-gtd.2010.0587>.
- [132] G.Chawla, M. S.Sachdev, andG.Ramakrishna, “Design, implementation and testing of an Artificial Neural Network based admittance relay,” *IFAC Proc. Vol.*, vol. 5, no. PART 1, pp. 125–130, 2006.
- [133] A.Abdali, K.Mazlumi, andR.Noroozian, “Fast fault detection and isolation in low-voltage DC microgrids using fuzzy inference system,” *5th Iran. Jt. Congr. Fuzzy Intell. Syst. - 16th Conf. Fuzzy Syst. 14th Conf. Intell. Syst. CFIS 2017*, pp. 172–177, 2017.
- [134] D. P.Mishra andP.Ray, *Fault detection, location and classification of a transmission line*, vol. 30, no. 5. Springer London, 2018.
- [135] A.Ferrero, P.Milano, andS.Sangiovanni, “Fault-type digital,” vol. 10, no. 1, pp. 169–175, 1995.
- [136] J. M.Mendel, “Fuzzy Logic Systems for Engineering: A Tutorial,” *Proc. IEEE*, vol. 83, no. 3, pp. 345–377, 1995.
- [137] O. V. G.Swathika, S.Angalaeswari, V. A.Krishnan, K.Jamuna, andJ. L. F.Daya, “Fuzzy Decision and Graph Algorithms Aided Adaptive Protection of Microgrid,” *Energy Procedia*, vol. 117, pp. 1078–1084, 2017.
- [138] H.Wang andW. W. L.Keerthipala, “Fuzzy-neuro approach to fault classification for transmission line protection,” *IEEE Power Eng. Rev.*, vol. 17, no. 9, p. 41, 1997.
- [139] S.Samal, S. R.Samantaray, andM. S.Manikandan, “A DNN based Intelligent Protective Relaying Scheme for Microgrids,” *2019 8th Int. Conf. Power Syst. Transit. Towar. Sustain. Smart Flex. Grids, ICPS 2019*, 2019.
- [140] N.Ketkar, *Deep Learning with Python*. 2017.
- [141] F.Lv, C.Wen, Z.Bao, andM.Liu, “Fault diagnosis based on deep learning,” *Proc. Am. Control Conf.*, vol. 2016-July, no. 2, pp. 6851–6856, 2016.
- [142] T. S.Abdelgayed, W. G.Morsi, andT. S.Sidhu, “Fault detection and classification based on co-training of semisupervised machine learning,” *IEEE Trans. Ind. Electron.*, vol. 65, no. 2, pp. 1595–1605, 2017.
- [143] E.Casagrande, W. L.Woon, H. H.Zeineldin, andD.Svetinovic, “A differential sequence component protection scheme for microgrids with inverter-based distributed generators,” *IEEE Trans. Smart Grid*, vol. 5, no. 1, pp. 29–37, 2014.
- [144] D.Zhang, X.Han, andC.Deng, “Review on the research and practice of deep learning and reinforcement learning in smart grids,” *CSEE J. Power Energy Syst.*, vol. 4, no. 3, pp. 362–370, 2018.
- [145] S.Ekici, S.Yildirim, andM.Poyraz, “Energy and entropy-based feature extraction for locating fault on transmission lines by using neural network and wavelet packet decomposition,” *Expert Syst. Appl.*, vol. 34, no. 4, pp. 2937–2944, 2008.
- [146] Q.Yang, J.Li, S.LeBlond, andC.Wang, “Artificial Neural Network Based Fault Detection and Fault Location in the DC Microgrid,” *Energy Procedia*, vol. 103, pp. 129–134, 2016.
- [147] J. M.Yoon, D.He, andB.Qiu, “Full ceramic bearing fault diagnosis using LAMSTAR neural network,” *PHM 2013 - 2013 IEEE Int. Conf. Progn. Heal. Manag. Conf. Proc.*, 2013.
- [148] M.Haque, M. N.Shaheed, andS.Choi, “Deep Learning Based Micro-Grid Fault Detection and Classification in Future Smart Vehicle,” *2018 IEEE Transp. Electr. Conf. Expo, ITEC 2018*, pp. 201–206, 2018.
- [149] D. P.Dnedulvkduli *et al.*, “DXOW ’ HWHFWLRQ DQG / RFDWLRQ LQ ’& 0LFURJULGV E \,” pp. 5–10.
- [150] K.Sun, S.Likhate, V.Vittal, V. S.Kolluri, andS.Mandal, “An online dynamic security assessment scheme using phasor measurements and decision trees,” *IEEE Trans. Power Syst.*, vol. 22, no. 4, pp. 1935–1943, 2007.
- [151] L.Wehenkel, M.Pavella, E.Euxibie, andB.Heilbronn, “Decision tree based transient stability method a case study,” *IEEE Trans. Power Syst.*, vol. 9, no. 1, pp. 459–469, 1994.
- [152] K.El-Arroudi, G.Joos, I.Kamwa, andD. T.McGillis, “Intelligent-based approach to islanding detection in distributed generation,” *IEEE Trans. Power Deliv.*, vol. 22, no. 2, pp. 828–835, 2007.
- [153] S. R.Safavian andD.Landgrebe, “A Survey of Decision Tree Classifier Methodology,” *IEEE Trans. Syst. Man Cybern.*, vol. 21, no. 3, pp. 660–674, 1991.
- [154] K. R.Hess, M. C.Abbuzzese, R.Lenzi, M. N.Raber, andJ. L.Abbuzzese, “Classification and regression tree analysis of 1000 consecutive patients with unknown primary carcinoma,” *Clin. Cancer Res.*, vol. 5, no. 11, pp. 3403–3410, 1999.
- [155] A.Criminisi, J.Shotton, andE.Konukoglu, “Decision forests: A unified framework for classification, regression, density estimation, manifold learning and semi-supervised learning,” *Foundations and Trends in Computer Graphics and Vision*, vol. 7, no. 2–3. Now Publishers, Inc., pp. 81–227, 2011.
- [156] L.Breiman, “Random forests,” *Mach. Learn.*, vol. 45, no. 1, pp. 5–32, 2001.
- [157] F.Ni, L.Yan, J.Liu, M.Shi, J.Zhou, andX.Chen, “Fuzzy logic-based virtual capacitor adaptive control for multiple HESSs in a DC microgrid system,” *Int. J. Electr. Power Energy Syst.*, vol. 107, no. November 2018, pp. 78–88, 2019.
- [158] H.Lin, K.Sun, Z.-H.Tan, C.Liu, J. M.Guerrero, andJ. C.Vasquez, “Adaptive protection combined with machine learning for microgrids,” *IET Gener. Transm. & Distrib.*, vol. 13, no. 6, pp. 770–779, Jan.2019, Accessed: Aug.06, 2020. [Online]. Available: <https://digital-library.theiet.org/content/journals/10.1049/iet-gtd.2018.6230>.
- [159] S.Gautam andS. M.Brahma, “Guidelines for selection of an optimal structuring element for Mathematical Morphology based tools to detect power system disturbances,” *IEEE Power Energy Soc. Gen. Meet.*, vol. 0, no. 1, pp. 1–6, 2012.
- [160] A.Salimi, Y.Batmani, andH.Bevrani, “Model-Based Fault Detection in DC Microgrids,” *2019 Smart Grid Conf. SGC 2019*, pp. 1–6, 2019.
- [161] J. J.Gertler, “Survey of Model-Based Failure Detection and Isolation in Complex Plants,” *IEEE Control Syst. Mag.*, vol. 8, no. 6, pp. 3–11, 1988.
- [162] J.Poon, P.Jain, I. C.Konstantakopoulos, C.Spanos, S. K.Panda, andS. R.Sanders, “Model-based fault detection and identification for switching power converters,” *IEEE Trans. Power Electron.*, vol. 32, no. 2, pp. 1419–1430, 2017.
- [163] M.Hosseinzadeh andF.Rajaei Salmasi, “Analysis and detection of a wind system failure in a micro-grid,” *J. Renew. Sustain. Energy*, vol. 8, no. 4, p. 043302, Jul.2016.
- [164] S.Asgari, A.Yazdizadeh, M. G.Kazemi, andM.Kamarzarin, “Model-Based fault detection and isolation for V47/660kW wind turbine,” *ICEE 2015 - Proc. 23rd Iran. Conf. Electr. Eng.*, vol. 10, no. September, pp. 1574–1579, 2015.
- [165] Y.Bansal andR.Sodhi, “Microgrid fault detection methods: Reviews, issues and future trends,” *Int. Conf. Innov. Smart Grid Technol. ISGT Asia 2018*, pp. 401–406, 2018.
- [166] J.Hare, X.Shi, S.Gupta, andA.Bazzi, “Fault diagnostics in smart micro-grids: A survey,” *Renew. Sustain. Energy Rev.*, vol. 60, pp. 1114–1124, 2016.
- [167] T.Ericsen, N.Hingorani, andY.Khersonsky, “Power electronics and future marine electrical systems,” *IEEE Trans. Ind. Appl.*, vol. 42, no. 1, pp. 155–163, 2006.
- [168] M.Saeedifard, M.Graovac, R. F.Dias, andR.Iravani, “DC power systems: Challenges and opportunities,” *IEEE PES Gen. Meet. PES 2010*, pp. 1–7, 2010.
- [169] P.Salonen, P.Nuutinen, P.Peltoniemi, andJ.Partanen, “LVDC distribution system protection - Solutions, implementation and

- measurements,” *2009 13th Eur. Conf. Power Electron. Appl. EPE '09*, 2009.
- [170] H. S. W. Ri *et al.*, “6Lqjoh * Urxqg) Dxow / Rfdwlrq \$ Ojruwlkp Lq ' & 0Lfurjulq % Dvhg Rq : Dyhohw 7Udqvirup,” vol. 5.
- [171] C. M. Franck, “HVDC circuit breakers: A review identifying future research needs,” *IEEE Trans. Power Deliv.*, vol. 26, no. 2, pp. 998–1007, 2011.
- [172] L. L. Qi, A. Antoniazzi, L. Raciti, and D. Leoni, “Design of Solid-State Circuit Breaker-Based Protection for DC Shipboard Power Systems,” *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 5, no. 1, pp. 260–268, 2017.
- [173] M. Hajian, D. Jovcic, and B. Wu, “Evaluation of semiconductor based methods for fault isolation on high voltage DC grids,” *IEEE Trans. Smart Grid*, vol. 4, no. 2, pp. 1171–1179, 2013.
- [174] C. Peng, X. Song, A. Q. Huang, and I. Husain, “A Medium-Voltage Hybrid DC Circuit Breaker - Part II: Ultrafast Mechanical Switch,” *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 5, no. 1, pp. 289–296, 2017.
- [175] A. J. Far and D. Jovcic, “Modelling of hybrid DC circuit breaker based on phase-control thyristors,” *IEEE Power Energy Soc. Gen. Meet.*, vol. 2018-Janua, no. 2, pp. 1–5, 2018.
- [176] P. Cairoli, I. Kondratiev, and R. A. Dougal, “Coordinated control of the bus tie switches and power supply converters for fault protection in DC microgrids,” *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 2037–2047, 2013.
- [177] R. M. Cuzner and D. A. Esmaili, “Fault tolerant shipboard MVDC architectures,” *Electr. Syst. Aircraft, Railw. Sh. Propulsion, ESARS*, vol. 2015-May, 2015.
- [178] S. Sivakumar, M. J. Sathik, P. S. Manoj, and G. Sundararajan, “An assessment on performance of DC-DC converters for renewable energy applications,” *Renew. Sustain. Energy Rev.*, vol. 58, pp. 1475–1485, 2016.
- [179] S. Waffler and J. W. Kolar, “A Novel Low-Loss Modulation Strategy for High-Power Bidirectional Buck + Boost Converters,” *IEEE Trans. Power Electron.*, vol. 24, no. 6, pp. 1589–1599, 2009.
- [180] J. L. Kirtley, A. Banerjee, and S. Englebretson, “Motors for Ship Propulsion,” *Proc. IEEE*, vol. 103, no. 12, pp. 2320–2332, 2015.
- [181] Z. Ye, H. Yang, M. Zheng, and M. Pourbehzadi, “Reconfiguration-Based Stochastic Operation Management of Automated Distribution Systems Considering Smart Sensors, Electric Vehicle, and,” no. c, pp. 1–8, 2020.
- [182] A. Swider and E. Pedersen, “Data-driven methodology for the analysis of operational profile and the quantification of electrical power variability on marine vessels,” *IEEE Trans. Power Syst.*, vol. 34, no. 2, pp. 1598–1609, 2019.
- [183] B. Amanulla, S. Chakrabarti, and S. N. Singh, “Reconfiguration of power distribution systems considering reliability and power loss,” *IEEE Trans. Power Deliv.*, vol. 27, no. 2, pp. 918–926, 2012.
- [184] H. Haghghat and B. Zeng, “Distribution System Reconfiguration under Uncertain Load and Renewable Generation,” *IEEE Trans. Power Syst.*, vol. 31, no. 4, pp. 2666–2675, 2016.
- [185] K. Sun, L. Zhang, Y. Xing, and J. M. Guerrero, “A distributed control strategy based on DC bus signaling for modular photovoltaic generation systems with battery energy storage,” *IEEE Trans. Power Electron.*, vol. 26, no. 10, pp. 3032–3045, 2011.
- [186] J. Z. Zhu and M. R. Irving, “Combined active and reactive dispatch with multiple objectives using an analytic hierarchical process,” *IEE Proc. Gener. Transm. Distrib.*, vol. 143, no. 4, pp. 344–352, 1996.
- [187] R. Cuzner and A. Jeutter, “DC zonal electrical system fault isolation and re-configuration,” *IEEE Electr. Sh. Technol. Symp. ESTS 2009*, pp. 227–234, 2009.



Zulfiqar Ali was born in Gilgit Baltistan, Pakistan, in 1996. He received his B.Sc. in Computer Systems Engineering from Mirpur University of Science and Technology (MUST), Mirpur AJ&K, Pakistan, in 2017. He joined National Highways Authority Islamabad, Pakistan as Trainee Engineer for 2 years. He is currently pursuing masters in the Department of Electrical Engineering from National Kaohsiung University of Science and Technology (NKUST), Kaohsiung, Taiwan. His research interests include DC Microgrid, power converter control, fault protection, fault detection, fault isolation, smart grid, artificial intelligence and machine learning, signal processing and DC Shipboard power system.



Yacine Terriche received a B.S. degree in electrical engineering from the University of Science and Technology, Constantine, Algeria in 2011, an M.S. degree in electrical engineering from the University of Constantine 1, Constantine, Algeria, and a Ph.D. degree in electrical engineering from Aalborg University, Aalborg, Denmark in 2020. During his Ph.D. he has been working as a Research Assistant at Kaohsiung University of Science of Technology, Kaohsiung, Taiwan from 1 December 2019 to 15 September 2020. Now, Yacine Terriche is working a Research Assistant at Aalborg University. His research interests include power electronics modeling and control, signal processing, power quality issues, active and passive power filters, static VAR compensators and maritime microgrids



Le Quang Nhat Hoang received his Bachelor's Degree in Mechanical Engineering from the Ho Chi Minh City University of Industry, Vietnam in 2011. From then he worked as a lecture and teaching assistant at Dong Nai Technology University, Vietnam. Currently, he is a master student at the Department of Microelectronics Engineering, National Kaohsiung University of Science and Technology, Taiwan. His research interests include machine learning techniques, shipboard power system, and control algorithm.



Syed Zagam Abbas completed graduation in Electrical Engineering from Mirpur University of Science and technology in 2017. He has a keen interest to pursue research in the field. The subjected research is one of the masterpieces of research works done in the field.



Mustafa Alrayah Hassan (S'18, M'20) received the B.Sc. degree in electrical engineering from the University of Blue Nile, Sudan, in 2006, the M.Sc. degree in electrical power engineering from the University of Khartoum, Sudan, in 2013, and the Ph.D. degree in electrical engineering from the Hebei University of Technology, China, in 2019. He worked as a Lecturer with the International University of Africa, Khartoum, Sudan, in 2014. Since 2019, he has been a Visiting Assistant Professor with the African Center of Excellence in Energy for Sustainable Development, University of Rwanda, Kigali, Rwanda. He is currently a Postdoctoral Researcher with National Kaohsiung University of Science and Technology, Kaohsiung, Taiwan. He is also worked as an Assistant Professor and the Head of Electrical Department with the University of Blue Nile, 2019-2020. He has authored or coauthored many conferences and journal articles. He reviewed many articles with several IEEE journals such as the IEEE Transactions on

Industrial Electronics, IEEE Transactions on Industrial Informatics, IEEE Transactions on Transportation Electrification, IEEE Journal of Emerging and Selected Topics in Power Electronics, IEEE Access, and IET Power Electronics. His current research interests include, power electronic converters, distributed generation systems, renewable energy integration, smart grid, DC microgrids stability and control, Shipboard DC microgrids, nonlinear control systems, adaptive passivity-based control, and sliding mode control.



Muhammad Sadiq received his B.S degree in Textile Engineering from the Balochistan University of Information Technology, Engineering and Management Sciences, Quetta, Pakistan in 2013, the M.S degree in industrial engineering and management from University of the Punjab, Lahore, Pakistan in 2019. He joined Nishat Mills as a Deputy Manager for 2 years. He is currently pursuing PhD degree in electrical engineering from National Kaohsiung University of Science and Technology, Taiwan. His research interest includes Harbor microgrids, energy management, and modeling of DC EV charging station for harbor applications.



Chun-Lien Su (M'01-SM'13) received the Diploma degree in Electrical Engineering from National Kaohsiung Institute of Technology, Taiwan, the M.S. and Ph.D. degrees in Electrical Engineering from the National Sun Yat-Sen University, Taiwan in 1992, 1997, and 2001, respectively. In 2002 and 2006, he was Assistant Professor and Associate Professor at the Department of Marine Engineering, National Kaohsiung Marine University, Taiwan, respectively. From 2012 to 2017, he was as a Full Professor where he was the Director at the Energy and Control Research Center. From Aug. 2017 to Jan. 2018 he was a Visiting Professor at the Department of Energy Technology, Aalborg University, Denmark. He was Director at the Maritime Training Center, National Kaohsiung University of Science and Technology (NKUST) from Feb. 2018 to Jul. 2020. Since Aug. 2020, he has been now Professor at the Department of Electrical Engineering in NKUST and Director at Center for Electrical Power and Energy. His research interests include power system analysis and computing, power quality, maritime microgrids, and offshore energy; recently specially focused on electrical infrastructure for offshore wind

farms and maritime microgrids for electrical ships, vessels, ferries and seaports. He was Guest Editors of the IEEE TRANSACTIONS ON INDUSTRIAL INFORMATICS Special Issues: Next Generation Intelligent Maritime Grids in 2017 and IET RENEWABLE POWER GENERATION Special Issues: Power Quality and Protection in Renewable Energy Systems and Microgrids in 2019. He received the best paper prize of the Industrial & Commercial Power Systems Conference at IEEE-IAS for the period 2012-2013, and the best paper award of IEEE International Conference on Smart Grid and Clean Energy Technologies in 2018.



Josep M. Guerrero (Fellow, IEEE) received the B.S. degree in telecommunications engineering, the M.S. degree in electronics engineering, and the Ph.D. degree in power electronics from the Technical University of Catalonia, Barcelona, Spain, in 1997, 2000, and 2003, respectively. Since 2011, he has been a Full Professor with the Department of Energy Technology, Aalborg University, Aalborg, Denmark, where he is responsible for the Microgrid Research Program. Since 2014, he has been a Chair Professor with Shandong University, Jinan, China. Since 2015, he has been a Distinguished Guest Professor with Hunan University, Changsha, China. Since 2016, he has been a Visiting Professor Fellow with Aston University, Birmingham, U.K., and a Guest Professor with the Nanjing University of Posts and Telecommunications, Nanjing, China. In 2019, he became a Villum Investigator. He has published more than 500 journal articles in the fields of microgrids and renewable energy systems, which are cited more than 30 000 times. His research interests include different microgrid aspects, including power electronics, distributed energy storage systems, hierarchical and cooperative control, energy management systems, smart metering, and the Internet of Things for ac/dc microgrid clusters and islanded minigrids, recently specially focused on maritime microgrids for electrical ships, vessels, ferries, and seaports. Dr. Guerrero was elevated as an IEEE Fellow for his contributions on “distributed power systems and microgrids” in 2015. He received the Best Paper Award of the IEEE TRANSACTIONS ON ENERGY CONVERSION for the period 2014–2015 and the Best Paper Prize of the IEEE Power and Energy Society (PES) in 2015. He also received the Best Paper Award of the Journal of Power Electronics in 2016. During five consecutive years, from 2014 to 2018, he was awarded by Clarivate Analytics (former Thomson Reuters) as a Highly Cited Researcher. He is also an Associate Editor for a number of the IEEE TRANSACTIONS.