

## Assessment of heat pumps for district heating applications

Liso, Vincenzo; Bojesen, Carsten

*Publication date:*  
2019

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*

Liso, V., & Bojesen, C. (2019). *Assessment of heat pumps for district heating applications*. Paper presented at CUE2019 Applied Energy Symposium 2019, Xiamen, China.

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### Take down policy

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.

# ASSESSMENT OF HEAT PUMPS FOR DISTRICT HEATING APPLICATIONS

Vincenzo Liso <sup>1\*</sup>, Carsten Bojesen <sup>2</sup>

<sup>1</sup> Department of Energy Technology, Aalborg University – Denmark (Corresponding Author)

<sup>2</sup> Department of Energy Technology, Aalborg University – Denmark

## ABSTRACT

Heat pumps will be a major player in the future energy system for their ability to efficiently extract heat from a source at lower temperature and provide it at higher temperature using electrical work. If coupled with a heat storage tank, the system can store heat and provide it at the point in time when the electricity price is more favorable.

In this study, we present a model of the heat pump energy performance using the coefficient of performance (COP) and the Lorentz efficiency. The latter gives an indication of the offset of the actual COP from the theoretical COP. We then compare different refrigerants performance to find out which one provide the best performance for district heating application. Finally, we study the cost-optimal operation of a heat pump with and without a thermal storage tank.

Results show that ammonia is a better candidate in terms of performance compared to other selected refrigerants. The performance analysis shows that the heat pump has a better Lorentz efficiency for lower COPs. Finally, we show that coupling the heat pump to a thermal storage tank can reduce the electricity cost of operation.

**Keywords:** Heat pumps; COP Lorentz Efficiency.

## NONMENCLATURE

### Abbreviations

|          |                             |
|----------|-----------------------------|
| DH       | District heating            |
| HP       | Heat pump                   |
| $T_{LM}$ | Logarithmic mean            |
| VHC      | Volumetric Heating Capacity |

## 1. INTRODUCTION

Different options have been considered to provide heat and electricity for domestic use in the future energy

system. This may include fuel cells [1], solar collectors [2], and heat pumps. Heat pumps can provide heat at the desiderate temperature without producing CO<sub>2</sub> if driven by electricity from renewable sources.

Heat pumps work according to the reverse Rankine cycle. The main components in the cycle are a compressor, an expansion valve, an evaporator and a condenser. However, a combination of multiple cycles is seen in some cases. In the internal circuit, a refrigerant goes through repetitive compressions and expansions. During the compression phase, heat is released to the sink while during the expansion heat is absorbed from the heat source [3].

With the aim to select a feasible refrigerant for district heating applications in this paper we develop a model of a single-cycle heat pump with different selected refrigerants. We then model the heat pump coupled with a heat storage tank in EnergyPRO. The software calculate the cost-optimal operation of the system with electricity price traded on the Day-Ahead spot market.

## 2. MATERIAL AND METHOD

The heat pump model was developed in Python using the libraries Coolprop [4] and Numpy. The cost optimization of the heat pump with and without the heat storage tank was developed in the software platform EnergyPRO [5]. In the following sections, the heat pump model is presented.

### 2.1 The Lorentz COP

The heat pump, theoretical energy performance is usually calculated using the Lorentz COP as described in the equation below:

$$\text{COP}_{\text{Lorentz}} = \frac{T_{LM,H}}{T_{LM,H} - T_{LM,C}} = \frac{T_{LM,H}}{T_{\text{lift}}} \quad (1)$$

This COP value is based on a Lorentz cycle in which the heat absorption/rejection occurs by a non-

isothermal process with same temperature change for both the heat source and sink. In the cycle compression and expansion are isentropic therefore the all cycle process is considered reversible [1]. The  $COP_{Lorentz}$  only depends on the source and sink temperatures and not on the characteristics of the heat pump (eg refrigerant type, evaporator and condenser, expansion valve, number of cycles, pressure drops). In the equation  $T_{LM,H}$  and  $T_{LM,C}$  are defined as the logarithmic mean temperature of the hot and cold stream:

$$T_{LM,H} = \frac{\Delta T_H}{\ln \frac{T_{H,o}}{T_{H,i}}} \quad T_{LM,C} = \frac{\Delta T_C}{\ln \frac{T_{C,i}}{T_{C,o}}} \quad (2)$$

with  $T_{LM,C} < T_{LM,H}$ .

The temperature lift is the difference between the logarithmic mean temperatures in equation (2):

$$T_{Lift} = T_{LM,H} - T_{LM,C} \quad (3)$$

The COP increases when the temperature lift,  $T_{Lift}$ , is reduced i.e. when the source and sink temperature are closer with each other. In other words, the heat pump performs better with small temperature lifts.

In figure 1, the temperature levels of the refrigerant and source/supply are shown on the TS diagram. In practice, a temperature glide of the refrigerant is seen during both condensation and evaporation, which causes a temperature variation during these two stages.

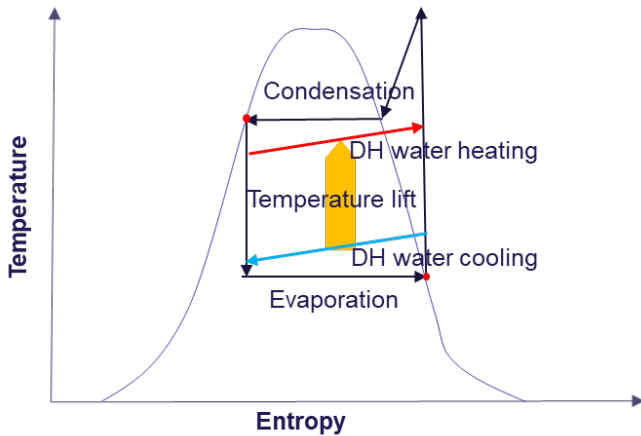


Figure 1. Refrigerant TS diagram with temperature levels of the heat source and supply. The 2 red dots are the positions where it is assumed the end of condensation and evaporation processes

Figure 2 shows the Lorentz COP values for different Log-mean temperatures of source and sink. A sharp increase of the COP values is seen when the source mean temperature increases while the sink mean temperature reduces hence reducing the temperature lift.

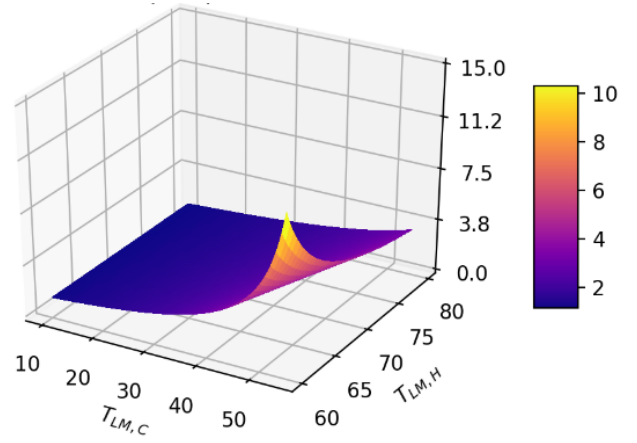


Figure 2. Lorentz COP at different  $T_{LM,H}$  and  $T_{LM,C}$

The heat pump cycle is limited by system process irreversibilities (e.g. compressor and other components efficiency, heat losses) and refrigerant limitations (e.g. critical temperature and pressure). Therefore a factor called Lorentz efficiency,  $\eta_{Lorentz}$ , is introduced and it is defined as the ratio of the actual heat pump COP, usually provided by the manufacturer, compared with the theoretical Lorentz COP, that is, the ratio between the useful output and the reversible heat output.

$$\eta_{Lorentz} = \frac{COP_{HP}}{COP_{Lorentz}} \quad (4)$$

In this equation, the  $COP_{HP}$  is the ratio of the heat pump heat capacity and the compressor consumption.

$$COP_{HP} = \frac{\dot{Q}_{HP}}{\dot{W}_{Comp}} \quad (5)$$

The heat provided by the HP is the sum of the heat of condensation and the compressor work.

$$\dot{Q}_{HP} = \dot{Q}_{Cond} + \dot{W}_{Comp} \quad (6)$$

The compressor work is defined as the product of the isentropic compressor work and the compressor efficiency.

$$\dot{W}_{Comp} = \eta_{Comp} \dot{W}_{isen} \quad (7)$$

The compressor efficiency,  $\eta_{Comp}$ , was fixed to 0.5 and the isentropic compressor,  $\dot{W}_{isen}$ , assumes the compressor process isentropic.

In the model calculation, it is assumed that the refrigerant reaches zero "vapor quality" at the end of the condensation and "vapor quality" equal to one at the end of the evaporation. This is shown in figure 1 with two red dots.

Refrigerants with larger heating capacity require less compressor power as less mass flow is needed to produce the same amount of heating. To analyze this refrigerant property we introduce a parameter called “volumetric heating capacity” which is the product of the density of the refrigerant at the compressor inlet and the heat realized by the heat pump. We define this value per unit of volume [6].

$$VHC = \dot{Q}_{HP} \rho_{ref} \quad (8)$$

## 2.2 Comparison between feasible refrigerant for HP

The study considers different refrigerants mainly used in industrial applications and for water heating. They are listed below with their main characteristics.

**R410a** It have been used in several application from water-cooled to heat-cooled heat pump.

**R1234ze(E)** is a medium pressure refrigerant which has been used in commercial building and supermarkets. It is considered a substitute for R134a [7].

**R290(Propane)** is used in heat pumps for water heating as a natural refrigerant to substitute R134a.

**R717 (Ammonia)** is a common natural working fluid for heat pump. It is characterized by high latent heat which is evident by the magnitude of its saturation vapour curve compared to other refrigerants. This is reflected in smaller refrigerant flow rates. The vertical saturation curve during the gas compression shown on the P-h diagram shows that there is limited enthalpy change during the compression and therefore less work.

Table 1. Properties of some common refrigerant for heat pumps

| Fluid             | Boiling point (°C) at Patm | Critical temperature (°C) | Critical pressure (bar) |
|-------------------|----------------------------|---------------------------|-------------------------|
| <b>R717</b>       | -33.3                      | 132.2                     | 113.5                   |
| <b>R290</b>       | -42.1                      | 96.7                      | 42.5                    |
| <b>R410A</b>      | -48.5                      | 70.1                      | 49.3                    |
| <b>R1234ze(e)</b> | -18.95                     | 109.4                     | 101.1                   |

## 3. RESULTS

### 3.1 HP modelling results with selected refrigerants

In this section, the main results produced by the model are plotted. First, we analyzed the saturation curves on the TS and PH diagrams; afterward we analyzed the heat pump performance operations with the following assumptions:

- The evaporator temperature ranges between 10°C and 20°C and the condenser outlet temperature of 70°C.
- Pinch temperatures of 5°C at the evaporator and the condenser. These temperature values should be representative of those found in district heating.

In figure 2 we can see, the comparison between of the saturation curves of the identified refrigerants. All the selected refrigerants can operate the cycle below the critical temperature values. All refrigerants, except for R1234ze(E), can be considered as “dry” as the isentropic compression process from start to end is in the vapor phase. R1234ze(E) shows an almost vertical saturated vapor branch of the saturation curve and therefore is classified as a “isentropic” refrigerant. This implies that they need to be superheated at the evaporator outlet in order to avoid liquid slugging in the compressor.

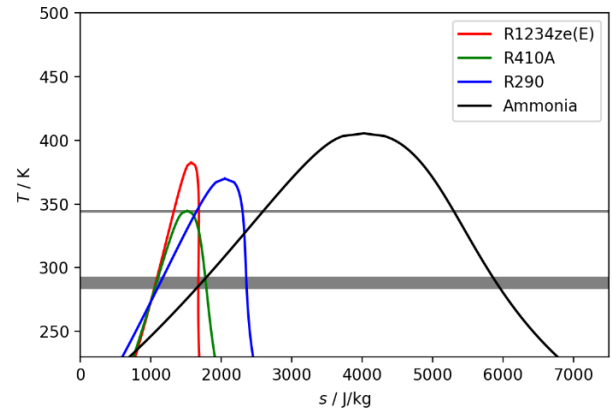


Figure 4. Saturation curve for selected refrigerants on the TS curve

The plots of the saturation curves on the PH diagram in figure 5 are important because from the size of the saturation dome indicates the amount of heat ( $\Delta H$ ) which is released during the refrigerant condensation. From the figure, ammonia has the largest heat release during the phase change. Also, the working pressure of the refrigerants can be inferred.

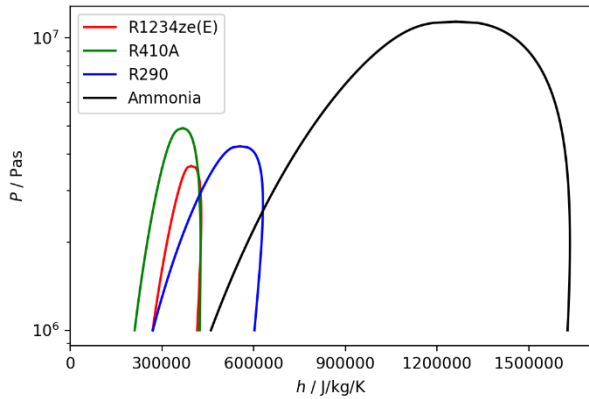


Figure 5. Refrigerants saturation curves on the PH diagram

Figure 6 shows the volumetric heating capacity of heat pump cycle for the mentioned working fluids. The VHC depends on the density of the working fluid and the heating effect. It is useful to indicate the volume of refrigerant necessary to produce the heating effect. From the figure is evident that the VHC values of ammonia and R410A are higher compared meaning that they produce less heat for unit volume.

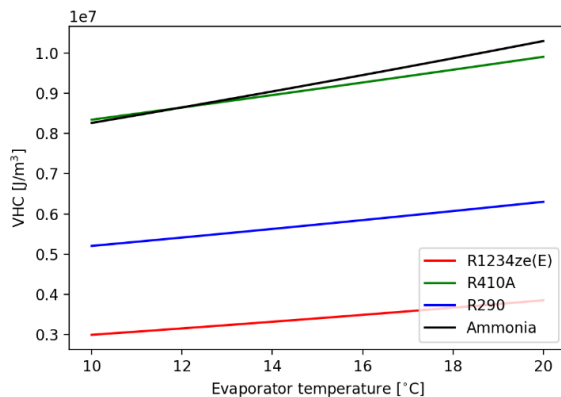


Figure 6. Refrigerants volumetric Heating capacity (Tcond=70°C)

The  $\Delta P$  during the compression it is useful to estimate the compressor work. Different cycles must to operate at different pressure difference for the same source and sink temperatures. From figure 7, it appears a large variation of  $\Delta P$  across different refrigerants.

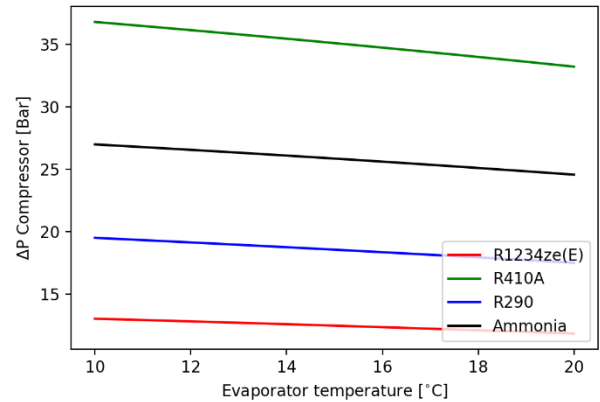


Figure 7. Compressor pressure difference (Tcond=70°C)

Finally, the compressor work is function of the enthalpy difference and the compressor efficiency at the specified cycle temperatures interval and will contribute the heat pump heat generation. Plots of the cycle  $\dot{W}_{Comp}$  are shown in figure 8.

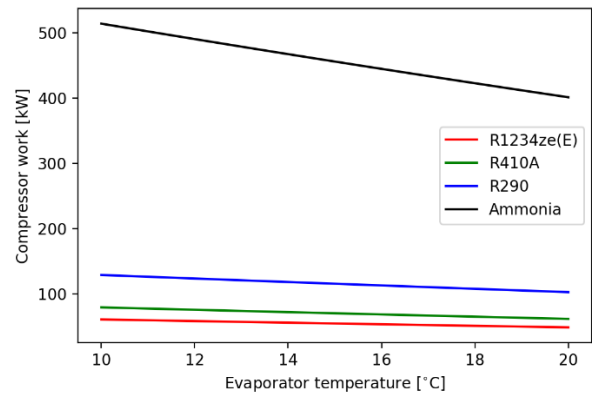


Figure 8. Compressor work (Tcond=70°C)

The heat pump modelling leads to the COP values shown in figure 9. It can be seen that Ammonia has the largest values of COP among the selected refrigerant. In addition, it is evident that the COP increases when the temperature lift is reduced. The figure offers also a comparison of the real COP with the Lorentz COP, which is the one that produces the largest values. This is attributable to the fact that the Lorentz COP assumes isentropic processes and does not include the specific characteristics of the refrigerants.

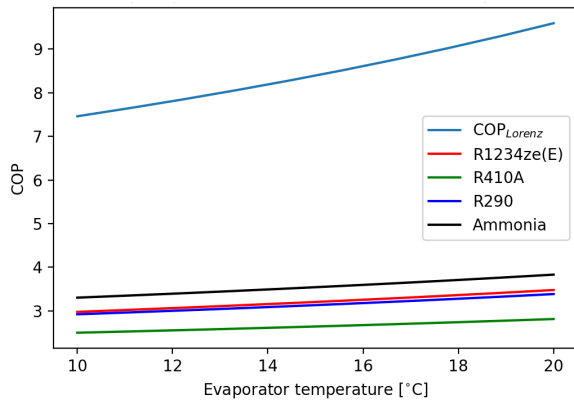


Figure 9. Heat pump COP ( $T_{\text{cond}}=70^{\circ}\text{C}$ )

temperature lifts. This can be explained with the fact that the compression work is larger for higher temperature lifts and therefore the compression accounts for a larger portion for the heat generation compared to the condensation process.

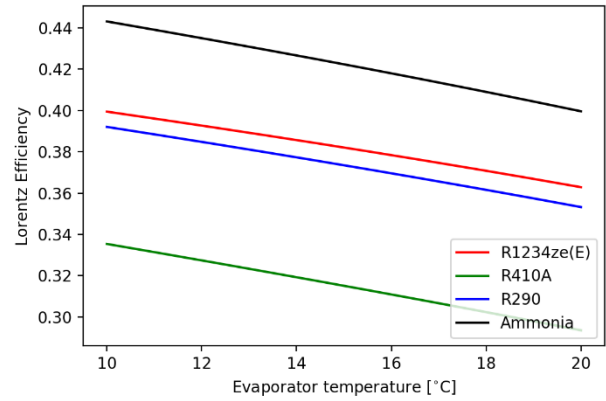


Figure 10. Lorentz efficiency,  $\eta_{\text{Lorentz}}$  of selected refrigerants ( $T_{\text{cond}}=70^{\circ}\text{C}$ )

Figure 10 show the Lorentz efficiency calculated as  $\eta_{\text{Lorentz}} = \text{COP}_{\text{HP}} / \text{COP}_{\text{Lorentz}}$ . It is evident that the Lorentz efficiency is higher in the case of ammonia refrigerant. The reason is attributed to the fact that a larger fraction of heat is produced in the compression process compared to other refrigerant as shown in figure 8.

Besides, it appears that the  $\eta_{\text{Lorentz}}$  decreases with the increase of the temperature lift. In other words, real COP values are closer to the ideal COP values for larger

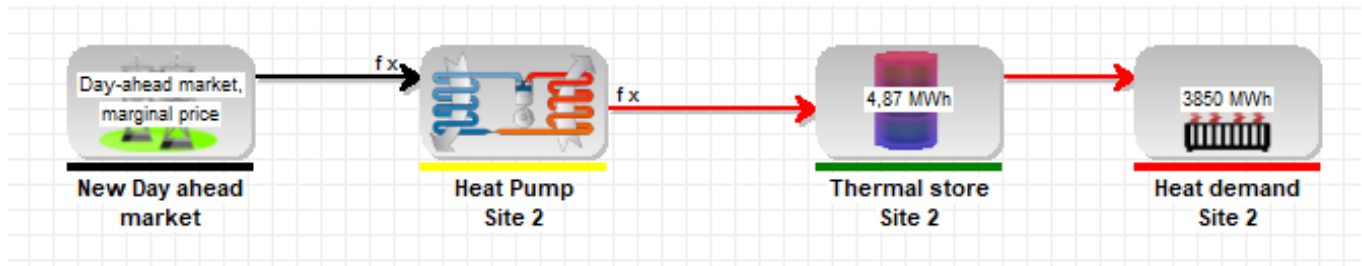


Figure 11. Example in EnergyPRO software platform of a heat pump coupled with a thermal storage tank for district heating with electricity price traded on the Day-Ahead spot market

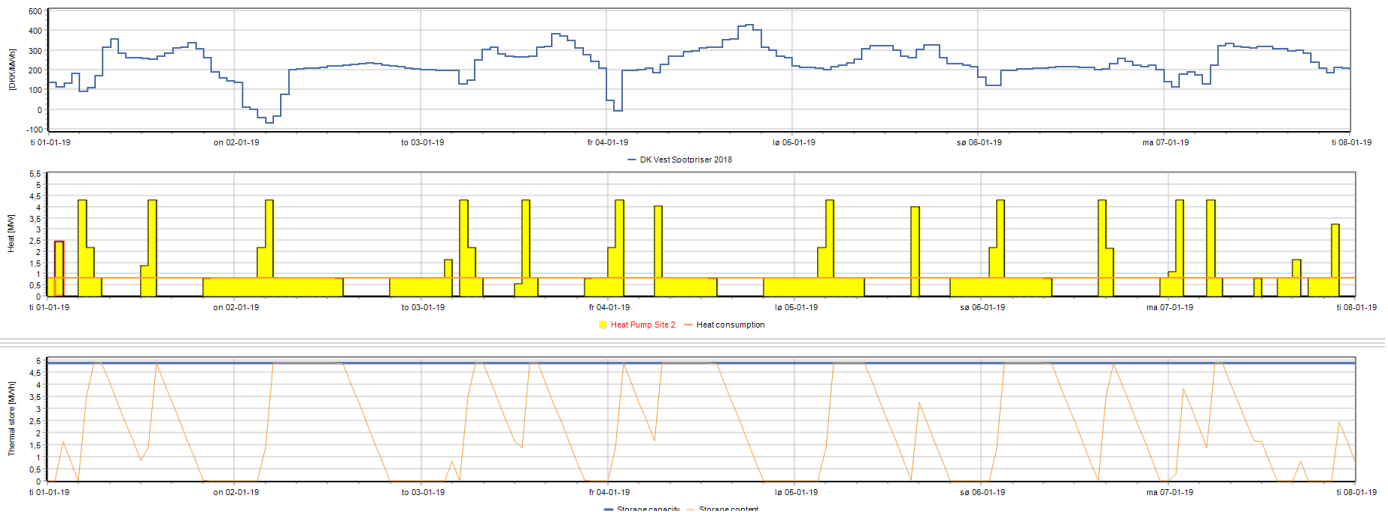


Figure 12. One week operation in EnergyPRO software platform of a heat pump with a thermal storage tank. *Top.* electricity price fluctuations. *Middle.* Heat produced by the heat pump. *Bottom.* Thermal storage level in the tank.

### 3.2 Cost optimization and comparison HP with and without thermal storage tank

The heat pump model was coupled with a thermal storage tank in EnergyPRO to simulate the cost savings in a situation where there is a continuous change in the electricity price due to short term trades in the electricity market. In figure 11, we can see the model diagram as shown in EnergyPRO. The configuration with the thermal storage was compared to a configuration of a heat pump operating without the thermal storage. In figure 12, we show the results with the cost optimization based on the electricity cost in Denmark during one week. The heat storage tank gives the possibility to use the heat pump when the electricity cost is lower.

We can assume that the cost of operation is affected by the electricity cost and the size of the thermal storage and the heat pump. In the case study, the electricity savings for using the thermal storage was in the range of 61% percent. Besides the number of hours of operation was reduced of 70% on the yearly based compared to a case without the thermal storage.

## 4. DISCUSSION

While the heat pumps have higher COP for lower temperature lifts, their Lorentz efficiency can show a different behavior. In this study, we compared the actual COP with the Lorentz COP, which represents the ideal maximum COP that can be achieved by a heat pump. The actual operating cycle is affected by irreversibilities that prevent the system to reach the max ideal performance. Similar studies were conducted before led to same conclusions. For instance in [8] energy and exergy losses were calculated on each component of the heat pump.

The heat storage tank is crucial to take advantage of a favorable electricity price in situations of intraday fluctuations of the electricity cost leading to significant electricity cost reductions over the year.

## 5. CONCLUSIONS

In this paper, we have developed a simple model for comparing performance of refrigeration single cycle. While in the majority of the cases heat pump performance are identified using the COP values, the Lorentz efficiency indicates in which point of operation the heat pump provides the best energy efficiency. Consequently, we have proven and quantified the benefits of using thermal storage tank in the context of variable electricity price.

While this model produces reasonable results for the future, the model can be expanded by including more

detailed modelling description of the heat pump components.

## ACKNOWLEDGEMENT

We acknowledge research funding from the Danish agency EUDP. Project: P771 Metoder til effektiv udnyttelse af værksinterne varmekilder med varmepumper.

## REFERENCE

- [1] V. Liso, M. P. Nielsen, S. K. Kær. Operation strategy for solid oxide fuel cell systems for small-scale stationary applications. *International Journal of Green Energy*. Volume 6, Issue 6, Pages 583-593
- [2] M. Gambini, M. Vellini. Hybrid thermal power plants: Solar-electricity and fuel-electricity productions. *Energy Conversion and Management*. 195. 2019. 682-689.
- [3] Lars Reinholdt, Jóhannes Kristófersson, Benjamin Zühlsdorf, Brian Elmegaard, Jonas Jensen, Torben Ommen, Pernille Hartmund Jørgensen. Heat pump COP, part 1: Generalized method for screening of system integration potentials. In: *Proceedings of the 13th IIR Gustav Lorentzen Conference, Valencia, 2018*
- [4] Bell, Ian H. and Wronski, Jorrit and Quoilin, Sylvain and Lemort, Vincent. Pure and Pseudo-pure Fluid Thermophysical Property Evaluation and the Open-Source Thermophysical Property Library CoolProp, *Industrial & Engineering Chemistry Research*, 53, 6, 2498—2508, 2014.
- [5] EnergyPRO. EMD Internationals. <https://www.emd.dk/energypro/>
- [4] Heat Pumps in CHP Systems: High-efficiency Energy System Utilising Combined Heat and Power and Heat Pumps. PhD Thesis Ommen, T. S., 2015, DTU Mechanical Engineering. Ommen, T. S., 2015, DTU Mechanical Engineering
- [6] In short about R1234ze. Pavel Makhnatch. [www.kth.se](http://www.kth.se)
- [7] Miquel Pitarch, Estefanía Hervas-Blasco, Emilio Navarro-Peris, José González-Maciá, José M. Corberán. Evaluation of optimal subcooling in subcritical heat pump systems, *International Journal of Refrigeration*, Volume 78, 2017, Pages 18-31, ISSN 0140-7007
- [8] F. Suleman, I. Dincer, M. Agelin-Chaab, Energy and exergy analyses of an integrated solar heat pump system, *Applied Thermal Engineering*, Volume 73, Issue 1, 2014, Pages 559-566