

## **Passivity-Based Analysis and Design of Linear Voltage Controllers for Voltage-Source Converters**

Liao, Yicheng; Wang, Xiongfei; Blaabjerg, Frede

*Published in:*  
I E E E Open Journal of the Industrial Electronics Society

*DOI (link to publication from Publisher):*  
[10.1109/OJIES.2020.3001406](https://doi.org/10.1109/OJIES.2020.3001406)

*Creative Commons License*  
CC BY 4.0

*Publication date:*  
2020

*Document Version*  
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

*Citation for published version (APA):*  
Liao, Y., Wang, X., & Blaabjerg, F. (2020). Passivity-Based Analysis and Design of Linear Voltage Controllers for Voltage-Source Converters. *I E E E Open Journal of the Industrial Electronics Society*, 1, 114-126.  
<https://doi.org/10.1109/OJIES.2020.3001406>

### **General rights**

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

### **Take down policy**

If you believe that this document breaches copyright please contact us at [vbn@aub.aau.dk](mailto:vbn@aub.aau.dk) providing details, and we will remove access to the work immediately and investigate your claim.



# Passivity-Based Analysis and Design of Linear Voltage Controllers For Voltage-Source Converters

YICHENG LIAO <sup>ID</sup> (Student Member, IEEE), XIONGFEI WANG <sup>ID</sup> (Senior Member, IEEE),  
AND FREDE BLAABJERG <sup>ID</sup> (Fellow, IEEE)

(Invited Paper)

Department of Energy Technology, Aalborg University, Aalborg 9220, Denmark

CORRESPONDING AUTHOR: XIONGFEI WANG (e-mail: xwa@et.aau.dk)

**ABSTRACT** This article presents a systematic evaluation on the impedance passivity of voltage-controlled voltage-source converters. The commonly used single- and dual-loop control structures with different linear controllers are compared extensively, considering the effect of the time delay involved in the control loop. A virtual impedance control, co-designed with different voltage control schemes, is then proposed to eliminate the negative output resistance till half of the sampling frequency, which improves the system stability for grid-forming converters in grid-connected applications. Both frequency-domain analysis and experimental results validate the theoretical findings.

**INDEX TERMS** Voltage-source converter, voltage control, passivity, harmonic stability, impedance analysis.

## NOMENCLATURE

$L_g, L_{g1}, L_{g2}$	Inductances in grid impedance	I-dominant	Controller can be approximated as an I controller in the high-frequency response (e.g., R, PR-I, or IR controller)
$C_g$	Capacitance in grid impedance		
$L_1$	LC filter inductance of the voltage-source converter (VSC)	$K_P$	Equivalent P controller gain of $G_v$ in the high-frequency response
$C_f$	LC filter capacitance of the VSC	$K_I$	Equivalent I controller gain of $G_v$ in the high-frequency response
$f_{LC}$	LC resonant frequency	$G_i$	Transfer function of the current controller
$f_0/\omega_0$	Fundamental frequency/angular frequency	$K_{pi}$	P controller gain in $G_i$
$f_s (T_s)$	Sampling frequency (sampling period)	$G_d$	Transfer function of the time delay
$f_{sw}$	Switching frequency	$T_d$	Total delay time in the digital control
$v_g$	Grid voltage	$f_c/\omega_c$	Critical frequency/angular frequency that changes the sign of $\cos(\omega T_d)$
$v$	Capacitor voltage	$H_v$	Transfer function of the voltage feedback decoupling loop
$i_1$	VSC-side current flowing through $L_1$	$Z_v$	Transfer function of the virtual impedance
$i_2$	VSC output current	$T_v$	Loop gain of the voltage control
$G_v$	Transfer function of the voltage controller	$f_{mc}$	Magnitude crossover frequency of $T_v$
$K_{pv}$	Proportional (P) controller gain in $G_v$	$T_i$	Loop gain of the current control
$K_{rv}$	Resonant (R) controller gain in $G_v$	GM	Gain margin
$\zeta$	Damping factor in the R controller	$Z_o$	VSC output impedance
$K_{iv}$	Integral (I) controller gain in $G_v$	$R_o$	Real part of the output impedance
PI-dominant	Controller can be approximated as a PI controller in the high-frequency response (e.g., PR controller)		

–R region Non-passive region, i.e., frequency range where the VSC has a negative resistance

## I. INTRODUCTION

Voltage-source converters (VSCs) are widely used with renewable energy resources [1]. The grid-following control, which employs the voltage-oriented vector current control, has been dominant for the past decade for VSCs [2]. However, the increasing share of VSC-based resources is fundamentally changing the grid operation, and the grid-following control tends to have more instability issues, particularly seen in weak grids [3]. To tackle this challenge, the grid-forming control, which operates the VSC as a voltage-stiff source using vector-voltage control, is developed [4]–[8], and hence, the dynamic behavior of the vector-voltage control becomes important for the grid-forming VSCs.


The vector-voltage control has for long time since been used with uninterruptible power supplies [9], [10], energy storage systems [11], and converter-based micro-grids [12]–[14]. The voltage control schemes based on linear controllers have been extensively studied, which can be classified into two groups, i.e., the single-loop control [15]–[18] and the dual-loop control [19]–[23], in respect to the number of feedback control variables [24]. The single-loop control directly regulates the output voltage across the LC-filter capacitor [18], while the dual-loop control adds an inner feedback loop based on the inductor current [23]. The inner current loop allows preventing VSCs from overcurrent and embedding a virtual resistance to dampen the LC-filter resonance [22]. However, due to the time delay of the digital control ( $T_d$ ), the virtual resistance emulated by the proportional current controller becomes negative in the frequency range above the critical frequency, i.e.,  $1/(4T_d)$  [25], which jeopardizes the stability of the inner current loop. Furthermore, the stability of outer voltage loop can be also threatened, since the phase of the voltage loop gain considering the time-delay impact tends to cross over  $180^\circ$  around the LC resonant frequency [18]. Therefore, the single-loop voltage control is usually preferred in the low pulse-ratio (i.e., the ratio of the VSC switching frequency to the fundamental frequency) applications, e.g., the aircraft power supplies at the fundamental frequency of 400 Hz [16], [17].

To address the adverse effect of the time delay and widen the frequency region of stable operation, several voltage controllers have been reported recently. For single-loop control structure, instead of using the conventional proportional + integral (PI) controller in the  $dq$  frame or P + resonant (PR) controller in the  $\alpha\beta$  frame, only the R controller tuned at the fundamental frequency in the  $\alpha\beta$  frame is developed in [17] to widen the stability region. Alternatively, a PR-I controller co-designed with a low-pass filter added into the voltage feedback decoupling loop is proposed in [18], which further widens the stability region. The prominent features of those controllers include: 1) the resonant behavior at the fundamental frequency to guarantee zero steady-state tracking error in the  $\alpha\beta$  frame; 2) the dominant integral (I-dominant) behavior

in the high-frequency range, which adds a phase lag to prevent the phase of the loop gain from crossing over  $180^\circ$  around the LC resonant frequency [18]. The same benefit applies also to the dual-loop control, which can alternatively be realized by different I-dominant controllers as discussed in [24].

Within the dual-loop control structure, the additional feedback decoupling loop from the capacitor voltage to the output of the inner current controller can also be embedded, which not only mitigates the effect of time delay, but also leads to better damping and improved transient response [26]. Besides the voltage-feedback decoupling control, the output-current feedforward control has also been utilized to synthesize various virtual impedances for VSCs [27]–[32]. However, most of those control schemes are focusing on the stability and waveform quality of the voltage control under the LC filter resonance, the nonlinear and unbalanced loads. The impedance passivity of the voltage control, i.e., the negative output resistance (damping) contributed from the voltage-controlled VSCs to the connected electrical systems [33], is seldom discussed.

The impedance passivity is a frequency-domain interpretation of a system passivity from the input-output viewpoint for an  $n$ -port linear time-invariant system [34]. Differing from the time-domain analysis based on energy storage functions [35]–[37], the passivity analysis based on frequency-domain impedance models allows for a control design-oriented analysis for small-signal stability enhancement [38], thus it has been extensively studied with current-controlled VSCs in grid-connected applications [39]–[46]. It has been pointed out that the time delay together with the current controller can lead to negative resistance of the VSCs in the high-frequency range, which could result in harmonic oscillations when interacting with the grid impedances [38]. Several passivity enhancement solutions have been put forward for current-controlled VSCs. A voltage feedforward control by a differentiator can be used to widen the passive region till half of the sampling frequency [41], whose performance is further discussed by passivity indices from the perspective of the entire system [42]. However, this derivative feedforward control method is merely applicable for the converter-side current control. A damping injection method by embedding a discrete derivative controller into the current controller is thus studied for passivity enhancement, which applies to both converter-side and grid-side current control [43]. However, the analysis relies on a detailed discrete-domain model, which leads to a difficult parameter tuning effort. The non-passivity caused by resonant current controllers can be mitigated by implementing the delay compensation method [44] or embedding a predictive current controller [45]. In addition to controller design, a co-design method of LCL filters is put forward for paralleled VSCs, by which the non-passive region can be canceled [46]. These passivity-based studies mainly focus on the single-loop current control, where the control interactions are relatively simple, thus they cannot be readily applied to voltage-controlled VSCs with multiple feedback control loops.

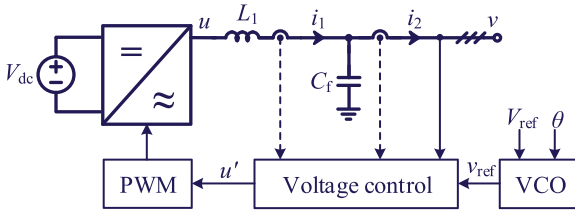


**FIGURE 1.** Voltage-controlled VSC with LC filter.

Only a few attempts to improve the impedance passivity of voltage-controlled VSCs can be found in [47], [48]. A passivity-oriented voltage control scheme is reported in [47]. Yet, the modeling and controller design are based on the discrete-domain model, by which it is difficult to reveal the explicit relationship between the passivity and the voltage control. With the continuous-domain modelling, the non-passive region for voltage-controlled VSCs can be analytically derived in the frequency domain [48]. However, this work only considers a specific dual-loop control scheme. The impedance passivity affected by the diversity of voltage control schemes still remain unclear, such as the single-loop control and the dual-loop control considering the voltage-feedback decoupling loop.

This paper thus presents a systematic evaluation of the impedance passivity of voltage-controlled VSCs. It begins with general modeling of both the single-loop and dual-loop control schemes, from which the preference of employing a high-frequency I-dominant controller for the voltage loop is pointed out. The impedance passivity for both control structures is further analyzed with an explicit non-passive region derived. Next, a passivity-based virtual impedance control is proposed, which is co-designed with the high-frequency I-dominant voltage controllers or the dual-loop control with voltage feedback decoupling loop. The method allows widening the passive region till half of the sampling frequency, which applies to different control schemes. Finally, stability analysis and experimental results are given to validate the effectiveness of the controller design.

## II. SYSTEM DESCRIPTION AND MODELLING

Fig. 1 shows a single-line diagram of a voltage-controlled VSC with an LC filter. The capacitor voltage  $v$  is controlled by a voltage controller, and the voltage reference  $v_{\text{ref}}$  is generated by a voltage control oscillator (VCO).  $i_1$  and  $i_2$  denote the inductor current and the VSC output current, respectively. It is noted that even though the LCL filter is usually installed in real applications, the grid-side filter represents the external disturbance for the voltage control, therefore, it is not considered in the following VSC modeling and control design. A constant dc-link voltage is assumed. The system configuration and control scheme apply to both single- and three-phase converters. In addition, there can be any outer-loop power control used for voltage reference generation, whose slower dynamics are neglected. Therefore, the following modeling and analysis only focus on the high-frequency dynamics of the VSC.

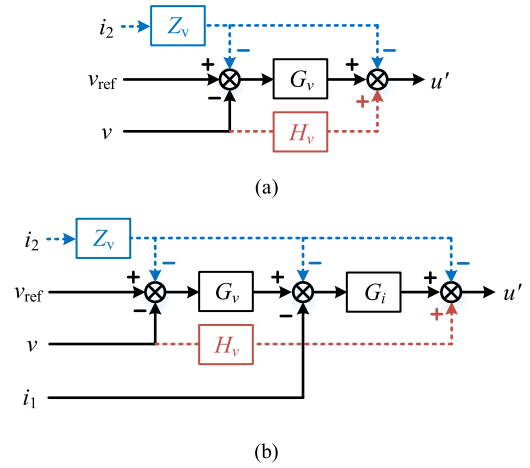

**FIGURE 2.** Voltage control schemes in VSCs. (a) Single-loop control; (b) Dual-loop control.

**TABLE 1.** Main System Parameters For the Studied VSC in Fig. 1


Quantity	Symbol	Value
DC-link voltage	$V_{\text{dc}}$	700 V
Filter inductance (resistance)	$L_1$ (ESR)	2 mH (0.1 $\Omega$ )
Filter capacitance	$C_f$	3 $\mu\text{F}$ <sup>a</sup> / 10 $\mu\text{F}$ <sup>b</sup>
LC resonant frequency	$f_{\text{LC}}$	2.06 kHz <sup>a</sup> / 1.13 kHz <sup>b</sup>
Voltage reference magnitude	$V_{\text{ref}}$	190 V
Switching / sampling frequency	$f_{\text{sw}} / f_s$	10 kHz / 10 kHz

<sup>a</sup>Single-loop control; <sup>b</sup>Dual-loop control.

Fig. 2 illustrates the general structures of the single-loop control and the dual-loop control. The single-loop control directly regulates the capacitor voltage by  $G_v$ , while the dual-loop control adds an inner inductor current control loop using  $G_i$ . In addition to the two feedback loops, feedforward loops or feedback decoupling loops can be alternatively added for the improved dynamic performance [9]. The feedforward control is based on the output current, which is also known as the virtual impedance control represented by  $Z_v$  in the blue dashed paths. It is noted that  $Z_v$  can be flexibly fed forward to different locations with various forms of controllers. The capacitor voltage feedback decoupling control is added to the modulated voltage through  $H_v$  in the red dashed paths.

The main system parameters of the studied VSC are listed in Table 1. The following derivations are carried out by assuming that the VSC switching frequency is equal to the sampling frequency ( $f_s$ ) and the total delay time ( $T_d$ ) is  $1.5T_s$  ( $T_s = 1/f_s$ ), but the conclusions can be extended to the VSCs with unequal switching and sampling frequencies and different delay time, which will be discussed in Section IV. Since the stable frequency region of the LC filter resonant frequency ( $f_{\text{LC}}$ ) for the single-loop control is  $(f_s/6, f_s/2)$  with  $T_d = 1.5T_s$  [18], and that for the dual-loop control is  $(0 \text{ Hz}, f_s/6)$  [23], two sets of capacitances are selected for  $C_f$ .

The VSC can be treated as a linear time-invariant system with a constant dc-link voltage [49], whose small-signal

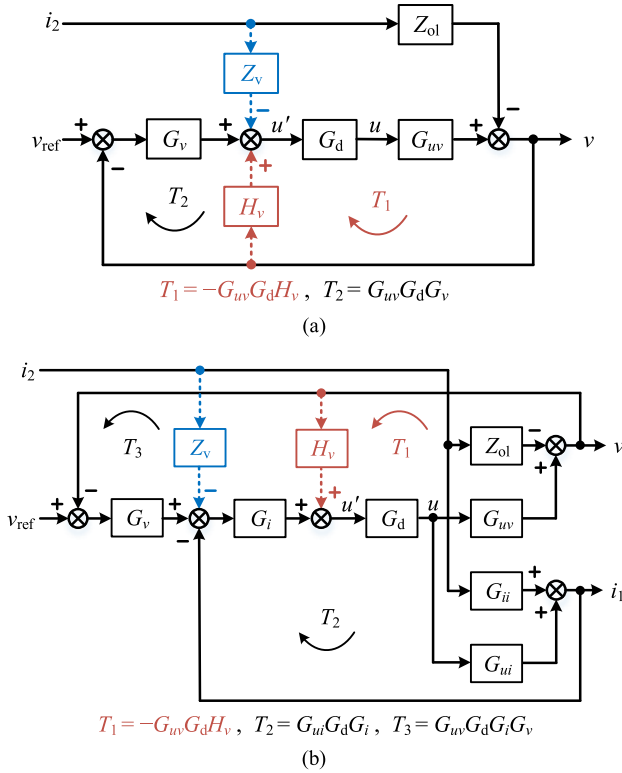

**FIGURE 3.** Small-signal models of VSC. (a) Single-loop control; (b) Dual-loop control.

models with the single-loop or dual-loop control are shown in Fig. 3, where the feedforward control loop  $Z_v$  is optionally added at the output of the voltage controller. All the transfer functions are represented in the continuous domain, yet with the Laplace transform variable “ $s$ ” omitted for brevity. Since the transfer functions of the plant and controllers are symmetrical in the  $\alpha\beta$  frame, the system dynamics can be represented by a single-input and single-output (SISO) model.  $Z_{ol}$  (open-loop impedance),  $G_{uv}$ ,  $G_{ii}$ , and  $G_{ui}$  are the transfer functions derived from the plant, which are

$$Z_{ol} = \frac{Z_{L1}}{1 + Z_{L1}Y_{Cf}}, \quad (1)$$

$$G_{uv} = \frac{1}{1 + Z_{L1}Y_{Cf}}, \quad (2)$$

$$G_{ii} = \frac{1}{1 + Z_{L1}Y_{Cf}}, \quad (3)$$

$$G_{ui} = \frac{Y_{Cf}}{1 + Z_{L1}Y_{Cf}}, \quad (4)$$

where  $Z_{L1}$  is the impedance of  $L_1$  and  $Y_{Cf}$  is the admittance of  $C_f$ .  $G_d$  denotes the transfer function of time delay, which is given by

$$G_d = e^{-sT_d} = e^{-1.5sT_s} \quad (5)$$

**TABLE 2.** Control Parameters For the Studied VSC

Single-loop control (Fig. 3(a))				
Control type	Voltage loop			
PR	$K_{pv}$	0.025	$K_{rv}$	$1000 \text{ s}^{-1}$
R	$K_{rv}$		2400 $\text{s}^{-1}$	
PR-I	$K_{pv}$	2400	$K_{rv}$	$20000 \text{ s}^{-1}$
IR	$K_{iv}$	1200	$K_{rv}$	$1200 \text{ s}^{-1}$
Dual-loop control (Fig. 3(b))				
Control type	Current loop	Voltage loop		
PR	$K_{pi}$ 8 $\Omega$	$K_{pv}$	0.012 S	$K_{rv}$ 50 S/s
R	$K_{pi}$ 8 $\Omega$	$K_{rv}$		350 S/s
PR-I	$K_{pi}$ 8 $\Omega$	$K_{pv}$	350 S/s	$K_{rv}$ 35000 S/s <sup>2</sup>
IR	$K_{pi}$ 8 $\Omega$	$K_{iv}$	175 S/s	$K_{rv}$ 175 S/s
PR& $H_v$	$K_{pi}$ 12 $\Omega$	$K_{pv}$	0.06 S	$K_{rv}$ 10 S/s

The voltage loop gain and the VSC output impedance for the single-loop control are then derived from Fig. 3(a) as

$$T_v = \frac{T_2}{1 + T_1} = \frac{G_{uv}G_dG_v}{1 - G_{uv}G_dH_v}, \quad (6)$$

$$Z_o = -\frac{v}{i_2} = \frac{Z_{ol} + G_{uv}G_dZ_v}{1 + T_1 + T_2} \quad (7)$$

The voltage-loop gain and the control output impedance for the dual-loop control are derived from Fig. 3(b) as

$$T_v = \frac{T_3}{1 + T_1 + T_2} = \frac{G_{uv}G_dG_iG_v}{1 - G_{uv}G_dH_v + G_{ui}G_dG_i} \quad (8)$$

$$Z_o = -\frac{v}{i_2} = \frac{Z_{ol}(1 + T_2) + G_{uv}G_dG_iG_{ii} + G_{uv}G_dG_iZ_v}{1 + T_1 + T_2 + T_3} \quad (9)$$

In (6)–(9), the terms represented by  $Z_v$  model the dynamic effects of the feedforward control loops, while the terms represented by  $T_1$  denote the effects of the feedback decoupling control loops. It is seen that the feedforward control loop merely shapes the control output impedance without impacting the voltage-loop gain, while the feedback decoupling control loop influences both the voltage-loop gain and the control output impedance.

### III. VOLTAGE CONTROL EVALUATION

In this section, the impacts of controllers on the voltage-loop gain are evaluated first for both single-loop control and dual-loop control, and the design guideline for improving the voltage control performance is summarized. The virtual impedance control is not considered in this section, since it does not affect the voltage loop gain. All the control parameters used for the following analysis are listed in Table 2. How they are selected will be introduced in the following analysis.

The control is implemented in  $\alpha\beta$  frame, thus R controllers [50] are utilized, whose transfer function is defined as

$$K_R(s) = \frac{K_R s}{s^2 + 2\zeta\omega_0 s + \omega_0^2}, \quad (10)$$

**TABLE 3.** Different Voltage Controllers and Their Approximations

Controller Type	Transfer Function	High-frequency approximation
PR	$G_v = K_{pv} + K_{rv}R(s)$	$G_v \approx K_p + K_i/s = K_{pv} + K_{rv}/s$
R	$G_v = K_{rv}R(s)$	$G_v \approx K_i/s = K_{rv}/s$
PR-I	$G_v = (K_{pv} + K_{rv}R(s))/s$	$G_v \approx K_i/s = K_{pv}/s$
IR	$G_v = K_{iv}/s + K_{rv}R(s)$	$G_v \approx K_i/s = (K_{iv} + K_{rv})/s$


where  $K_r$  is the R controller gain,  $\zeta$  is the damping factor, and  $\omega_0$  is the central angular frequency. In this work,  $\zeta$  is selected as 0.01 to consider a bandwidth of 1 Hz for the R controller in case of any frequency drift in  $\omega_0$  [51]. The R controller provides sufficiently large gain at  $\omega_0$  and introduces an integral behavior in the high-frequency range larger than  $\omega_0$ . It is worth noting that if the control is implemented in the  $dq$  frame, all R controllers should be replaced with I controllers, and the controller transfer functions can then be transformed into the  $\alpha\beta$  frame for modeling and analysis. Then, the frequency shift caused by the inverse Park transformation needs to be considered in controller transfer functions [52].

For the voltage control design, different factors, such as gain margin (GM), phase margin, and magnitude crossover frequency ( $f_{mc}$ ), can be considered. This section focuses on discussing the stability limitations of different voltage control schemes. Thus, the same stability margin is designed in order to compare the maximum magnitude crossover frequencies. All cases are designed with the same GM of 3 dB.

### A. SINGLE-LOOP CONTROL

For the single-loop control, the controller is designed by analyzing the voltage loop gain directly. If  $G_v$  is a P controller, it will be merely stable when  $f_{LC}$  belongs to  $(f_s/3, f_s/2)$ , while if  $G_v$  is I-dominant in the high-frequency range, the stable region of  $f_{LC}$  will be widened to  $(f_s/6, f_s/2)$  [18]. Thus, the conventional proportional and resonant (PR) controller, which behaves as a PI controller in the high-frequency range, will have a stable region in between the aforementioned two frequency ranges. Hence, the high-frequency I-dominant controller is preferred for the single-loop control, which can be realized by different controllers, such as the R controller only, the PR-I controller, or the IR controller [24]. These controllers and their high-frequency approximations are listed in Table 3.

The Bode diagrams of voltage-loop gains with different controllers are plotted for the single-loop control in Fig. 4. They are all designed with GMs of 3 dB, which are denoted by the solid circles in the magnitude plot. Then, the maximum magnitude crossover frequencies can be compared. According to (6), when the feedback decoupling loop is disabled ( $H_v = 0$ ),  $G_{uv}$  introduces an LC resonant peak in the high-frequency range at  $f_{LC}$ , while  $G_v$  can shape the loop gain differently according to the controller types given in Table 3. In (6), the total phase lag of  $T_v$  is contributed by the sum of phase

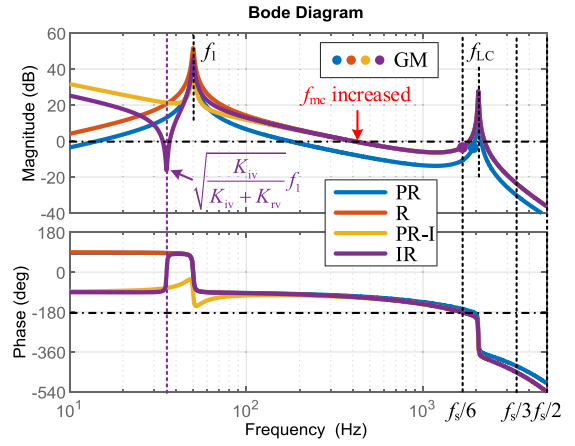**FIGURE 4.** Bode diagram of voltage loop gain for single-loop control (Fig. 3(a)) using different controllers.


lags of  $G_v$ ,  $G_d$ , and  $G_{uv}$ .  $G_d$  introduces phase lag gradually as the frequency increases, which reaches to  $-90^\circ$  at  $f_s/6$ , and  $G_{uv}$  leads to a phase drop of  $-180^\circ$  at  $f_{LC}$ . If  $G_v$  is PI-dominant (PR) in the high-frequency range, by adding their phase lags up, the phase response of  $T_v$  can easily cross over  $-180^\circ$  at  $f_{LC}$ . Consequently, due to the poorly damped LC resonance, a low enough gain of  $G_v$  is required to guarantee a positive GM. This explains why the PR control results in a low magnitude-crossover frequency, i.e.,  $f_{mc}$ . It is noted that this indicates a different single-loop control design rule compared with L-filtered current-controlled VSCs, where usually a high bandwidth around 1/10 of the switching frequency is achievable with enough stability margin [53]. The other three high-frequency I-dominant controllers (R, PR-I, IR) introduce more phase lag than the PR controller, by which the phase response of  $T_v$  can cross over  $-180^\circ$  exactly at  $f_s/6$ . Then at  $f_{LC} > f_s/6$ , the phase response has already exceeded  $-180^\circ$ , thus the gain of  $G_v$  can be designed relatively larger, leading to a higher  $f_{mc}$  and a better control performance. Moreover, both the PR-I and IR controllers feature a higher gain in the low-frequency range than the R controller. The IR controller yields a pair of conjugate zeros below the fundamental frequency, yet it does not affect much on the voltage control performance.

In the single-loop voltage control, the feedback decoupling loop by a lower-pass filter can be used to further widen the stability region to  $f_{LC} > f_s/4$  [18]. This damping control is unnecessary for the case when  $f_{LC} > f_s/6$  is satisfied, as shown in Fig. 4, thus it is not discussed further in this article.

### B. DUAL-LOOP CONTROL

In the dual-loop control, the inner current loop is designed first. It is assumed to be merely with P controller in the stability analysis, due to the negligible effect of the R controller in the high-frequency range [53], i.e.,  $G_i = K_{pi}$ . The current loop gain is derived as

$$T_i = \frac{T_2}{1 + T_1} = \frac{sC_f G_d K_{pi}}{1 + s^2 L_1 C_f - G_d H_v} \quad (11)$$

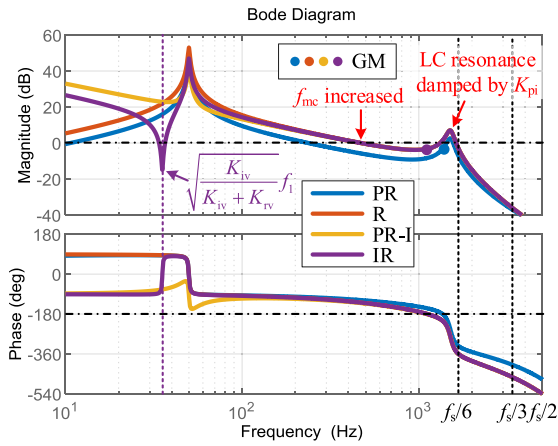

**FIGURE 5.** Bode diagram of voltage loop gain with different voltage controllers for dual-loop control (Fig. 3(b)).

It is worth noting that the current loop should be designed to be stable first. Otherwise, the outer voltage loop will have a non-minimum phase response, which cannot be stabilized [23]. Consequently, the current-loop gain is designed to achieve a positive GM. In this work,  $K_{pi} = 8 \Omega$  is chosen to achieve a GM of 3 dB for  $H_v = 0$ , based on the parameters given in Table 1.

Then the voltage loop is designed by closing the current loop. The voltage loop gain can be further represented as

$$T_v = \frac{T_3}{1 + T_1 + T_2} = \frac{G_d K_{pi} G_v}{1 + s^2 L_1 C_f + s C_f G_d K_{pi} - G_d H_v} \quad (12)$$

### 1) NO VOLTAGE FEEDBACK DECOUPLING


From (12), when  $H_v$  is disabled, the current controller gain as well as the time delay provides active damping to the LC resonance, yet the resultant voltage loop gain is still similar to that of the single-loop control given by (6). Therefore, the design of the dual-loop voltage control follows the same rule as that for the single-loop control, i.e., using a high-frequency I-dominant controller to obtain a higher magnitude-crossover frequency [24]. The Bode diagrams for the designed voltage loop gains are shown in Fig. 5, which only differ from Fig. 4 around the LC resonant frequency, where the magnitude responses are damped by the current controller and the phase drops are slightly shifted due to the time delay effect.

### 2) WITH VOLTAGE FEEDBACK DECOUPLING

With  $H_v$  enabled by a unity gain [26], the voltage loop gain in the low-frequency range can be approximated as

$$T_v = \frac{T_3}{1 + T_1 + T_2} \approx_{s=j\omega}^{low f} \frac{K_{pi} G_v}{j\omega (T_d + C_f K_{pi})} \quad (13)$$

where an integral behavior in the low-frequency range is coming from the cancellation effect of  $1 - G_d H_v$ . It is noted that this low-frequency range for the integral behavior is wide enough almost till one tenth of the sampling frequency. Consequently, there is no need to use a high-frequency I-dominant

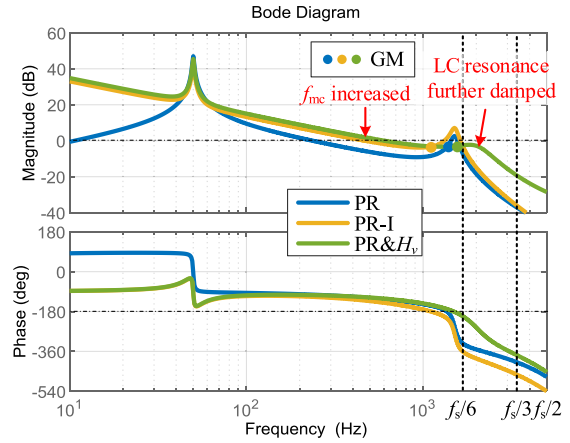

**FIGURE 6.** Bode diagram of voltage loop gain for dual-loop control (Fig. 3(b)) with and without feedback decoupling.


controller for  $G_v$  to increase the low-frequency magnitude of the loop gain, and thus the conventional PR controller is sufficient to achieve a larger  $f_{mc}$ . This control is referred to as PR& $H_v$  control for brevity in the following analysis.

The decoupling effect of  $1 - G_d H_v$  also applies to the inner current loop gain according to (11), thus  $K_{pi}$  can be designed with a larger value than without  $H_v$ , for the same GM of the current loop, which provides more active damping to the LC resonance. In this case,  $K_{pi}$  can be increased to  $12 \Omega$  with a GM of 3 dB. The Bode diagram of the voltage loop gain for the PR& $H_v$  control is plotted in Fig. 6. It is clear that compared with the PR control and PR-I control, the PR& $H_v$  control further dampens the LC resonance with the increased  $K_{pi}$ . And the decoupling effect of  $1 - G_d H_v$  results in a similar reference tracking effect to the PR-I control.

### C. SUMMARY

In summary, the LC-filter resonance together with the time delay can easily result in phase crossing over  $180^\circ$  around  $f_{LC}$  for the voltage-controlled VSC, which poses challenges to the design of a fast voltage control loop using conventional PR controller only. Hence, there are several ways to enhance the voltage control performance:

- A conventional way is to add the inner current control loop to provide active damping to the LC resonance. This is the major difference between the single-loop control and the dual-loop control in respect to the voltage control loop gain, yet the improvement is limited by the time delay.
- Using high-frequency I-dominant voltage controllers to provide additional phase lag, such that the loop-gain phase crossing over  $180^\circ$  can be prevented around the LC resonant frequency. Such a way can significantly increase the magnitude-crossover frequency and apply for both the single-loop control and the dual-loop control.
- Applying the voltage feedback decoupling loop with unity gain for dual-loop control. On one hand, due to the

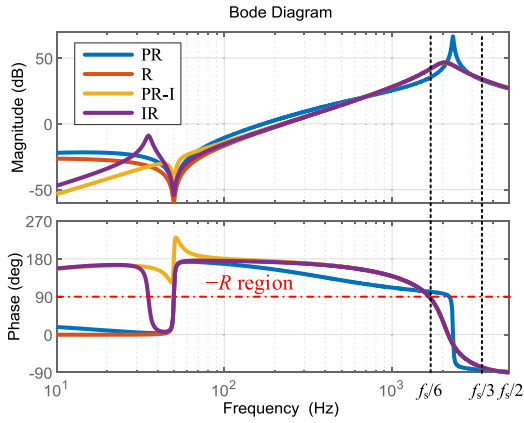

**FIGURE 7.** Bode diagram of closed-loop output impedance for single-loop control using different controllers.

compensation effect of time delay in the low frequency range, the current-loop P controller can be designed larger to provide more damping to the LC resonance. On the other hand, the low-frequency integral behavior is naturally introduced in the voltage loop gain, which helps to widen the control bandwidth.

#### IV. PASSIVITY ANALYSIS AND DESIGN

The impedance passivity of the voltage-controlled VSC implies that the control output impedance  $Z_o$  has non-negative real part, i.e., the phase response of  $Z_o$  is within  $[-90^\circ, +90^\circ]$  [38]. Based on the controller design in Section III, the impedance passivity of both the single-loop and dual-loop are discussed in this section. The virtual impedance control is optionally considered because of its shaping impact on the output impedance profile. The passivity-based virtual impedance control, co-designed with various voltage control schemes, is then proposed.


##### A. SINGLE-LOOP CONTROL

###### 1) PASSIVITY ANALYSIS

For the single-loop control, supposing that  $G_v \approx K_p + K_i/s$  is valid for the high-frequency approximation, it can be derived that the sign of the real-part of  $Z_o$ , i.e.,  $R_o$ , is determined by

$$\text{sgn}\{R_o(\omega)\} = \text{sgn}\{-K_p\omega L_1 \sin(\omega T_d) - K_i L_1 \cos(\omega T_d)\} \quad (14)$$

where  $\text{sgn}\{\bullet\}$  is the sign function. It can be seen that  $R_o$  changes with the frequency and its sign is influenced by the time delay, the control parameters and the L filter. When the high-frequency I-dominant controllers are used with  $G_v$ , assuming  $K_p = 0$ , the sign of  $R_o$  is merely dependent on the sign of  $\cos(\omega T_d)$ . The critical frequency is thus defined as the frequency where the sign of  $\cos(\omega T_d)$  changes, i.e.,  $f_c = 1/(4T_d)$ , which is  $f_s/6$  when  $T_d = 1.5T_s$ . Consequently,  $R_o < 0$  for  $f < f_s/6$ , while  $R_o > 0$  for  $f_s/6 < f < f_s/2$ . That is to say, the single-loop voltage control can result in a negative resistance in the low-frequency range.

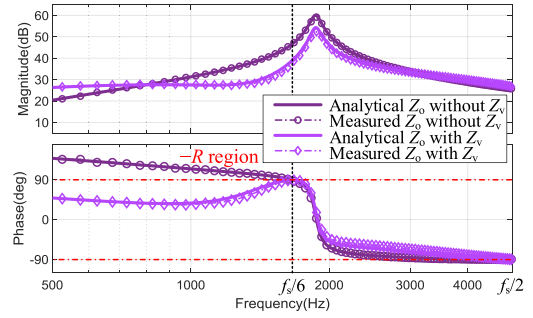

**FIGURE 8.** Closed-loop output impedances without / with virtual impedance control  $Z_v$  for single-loop control obtained analytically and by frequency scan.

Fig. 7 compares the closed-loop output impedances for the single-loop voltage control with different controllers. If the effect of different controllers near the fundamental frequency is neglected, it is found that the non-passive ( $-R$ ) region appears in a wide low-frequency range. The PR control results in a wider  $-R$  region, while the other three high-frequency I-dominant controllers reduce the  $-R$  region to  $f < f_s/6$ .

###### 2) PASSIVITY DESIGN BY VIRTUAL IMPEDANCE

It is indicated by (7) that the virtual impedance control can reshape the output impedance and it is thus used to mitigate the non-passive region of the control output impedance.

Since high-frequency I-dominant controllers can widen the voltage control bandwidth and simplify the  $-R$  region to  $f < f_s/6$ , the virtual impedance control is co-designed with  $G_v \approx K_i/s$  for the high-frequency response. Supposing first that  $Z_v$  adopts a P controller, it can be derived that


$$\text{sgn}\{R_o(\omega)\} = \text{sgn}\{[Z_v(1 - \omega^2 L_1 C_f) - K_i L_1] \cos(\omega T_d)\} \quad (15)$$

which is determined by the multiplication of  $\cos(\omega T_d)$  and a frequency-dependent coefficient. If such a coefficient can be designed to have the same sign with  $\cos(\omega T_d)$  till  $f_s/2$ , then the passivity of  $Z_o$  will be guaranteed till  $f_s/2$ . Hence, the sufficient condition of the passivity is

$$Z_v = \frac{K_i L_1}{1 - \left(\frac{\pi}{2T_d}\right)^2 L_1 C_f} = \frac{K_i L_1}{1 - \left(\frac{\omega_s}{6}\right)^2 L_1 C_f} > 0 \quad (16)$$

for the single-loop voltage control with high-frequency I-dominant controllers. It is noted that  $\pi/(2T_d)$  is the critical angular frequency, i.e.,  $\omega_c$  ( $\omega_s/6$  in this case), that changes the sign of  $\cos(\omega T_d)$ .

Fig. 8 shows the impact of virtual impedance control on the output impedance of the single-loop control with a high-frequency I-dominant controller, where an IR controller is used as an example. The analytical results are calculated by (7), and the measured results are also provided by means of the frequency scan in simulations using switching models, which prove the accuracy of the modeling. It can be seen that the virtual impedance control can eliminate the  $-R$  till half of the sampling frequency.

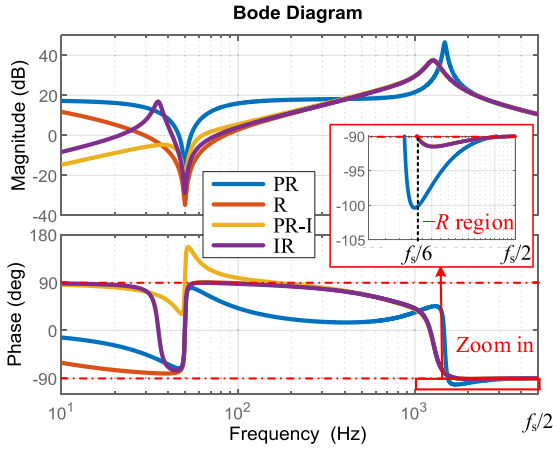

**FIGURE 9.** Bode diagram of closed-loop output impedance for dual-loop control using different controllers.

## B. DUAL-LOOP CONTROL

### 1) PASSIVITY ANALYSIS

The passivity of  $Z_o$  for the dual-loop control is analyzed in the same way by supposing that  $G_v \approx K_p + K_i/s$  for the high-frequency approximation, which yields

$$\begin{aligned} \text{sgn}\{R_o(\omega)\} &= \text{sgn}\left\{-\omega L_1 K_{pi} K_p \sin(\omega T_d) + K_{pi}(1 - K_1 L_1) \cos(\omega T_d) \right. \\ &\quad \left. + K_{pi}^2 K_p\right\} \end{aligned} \quad (17)$$

Similarly, the time delay and controller parameters impact the  $-R$  region. When  $K_p = 0$ , the sign of  $R_o$  is also merely dependent on the sign of  $\cos(\omega T_d)$ . Hence, the high-frequency I-dominant controllers can simplify the  $-R$  region for the dual-loop control. Due to  $K_1 L_1 < 1$ , it can be further derived that  $-R$  appears for  $f_s/6 < f < f_s/2$  when  $T_d = 1.5 T_s$ . This is in oppose to the result of single-loop control.

Fig. 9 compares the closed-loop output impedances for the dual-loop control with different voltage controllers. It can be found that the high-frequency I-dominant controllers also significantly reduce the  $-R$  region compared with the PR controller.


### 2) PASSIVITY DESIGN BY VIRTUAL IMPEDANCE

Considering the virtual impedance control, the  $-R$  region for the dual-loop control based on high-frequency I-dominant controllers can be determined by

$$\begin{aligned} \text{sgn}\{R_o(\omega)\} &= \text{sgn}\left\{K_{pi}\left[1 - K_1 L_1 + Z_v(1 - \omega^2 L_1 C_f)\right] \cos(\omega T_d)\right\} \end{aligned} \quad (18)$$

To make  $Z_o$  passive till  $f_s/2$ , the sufficient condition is derived as

$$Z_v = \frac{1 - K_1 L_1}{\left(\frac{\pi}{2T_d}\right)^2 L_1 C_f - 1} = \frac{1 - K_1 L_1}{\left(\frac{\omega_s}{6}\right)^2 L_1 C_f - 1} > 0 \quad (19)$$

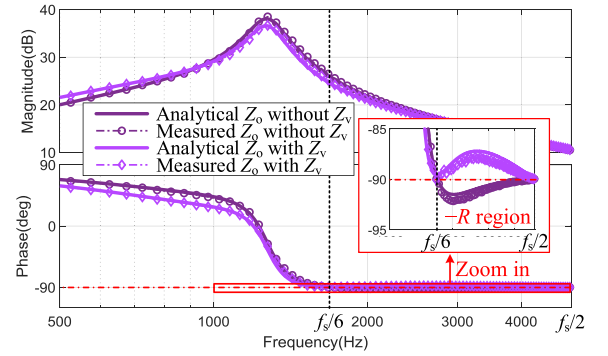

**FIGURE 10.** Closed-loop output impedances without / with virtual impedance control  $Z_v$  for dual-loop control obtained analytically and by frequency scan.

Fig. 10 shows the impact of virtual impedance control on the output impedance of the dual-loop control, where an IR controller is used as an example. From the zoom-in view in Fig. 10, it is clear that the  $-R$  region within  $(f_s/6, f_s/2)$  can be eliminated by the virtual impedance control.

### 3) PASSIVITY DESIGN WITH VOLTAGE FEEDBACK DECOUPLING

As elaborated in Section III, the unity voltage feedback decoupling loop essentially introduces an integral behavior in the low-frequency range, which leads to a similar voltage control performance to the PR-I control. The passivity-based design for the PR& $H_v$  control is thus discussed further in the following.

Supposing that  $G_v \approx K_p + K_i/s$  for the high-frequency approximation and considering the virtual impedance control, the sign of  $R_o$  can be determined by

$$\begin{aligned} \text{sgn}\{R_o\} &= \text{sgn}\left\{-\omega L_1 (K_{pi} K_p - H_v) \sin(\omega T_d) \right. \\ &\quad \left. + K_{pi} [1 - K_1 L_1 + Z_v (1 - \omega^2 L_1 C_f)] \cos(\omega T_d) \right. \\ &\quad \left. + K_{pi} (1 + Z_v) (K_{pi} K_p - H_v) \right\} \end{aligned} \quad (20)$$


It can be seen that only if  $K_{pi} K_p = H_v$ , the  $-R$  region can be simply determined by the term of  $\cos(\omega T_d)$ , and then the passivity of  $Z_o$  can be guaranteed till  $f_s/2$  by using (19).

Fig. 11 examines the impedance passivity for the PR& $H_v$  control. To realize a passivity design,  $K_{pi} = 10 \Omega$  and  $K_p = K_{pv} = 0.1 \text{ S}$  is chosen such that  $K_{pi} K_p = H_v = 1$ . It can be seen that the  $-R$  region within  $(f_s/6, f_s/2)$  can also be effectively eliminated by the virtual impedance.


## C. DISCUSSION

### 1) PARAMETER VARIATION

The proposed passivity-based design in (16) and (19) relies on the controller gain, time delay, and LC filter parameters. The controller gain and time delay are relatively constant, yet the LC filter parameters can vary from manufacturers and

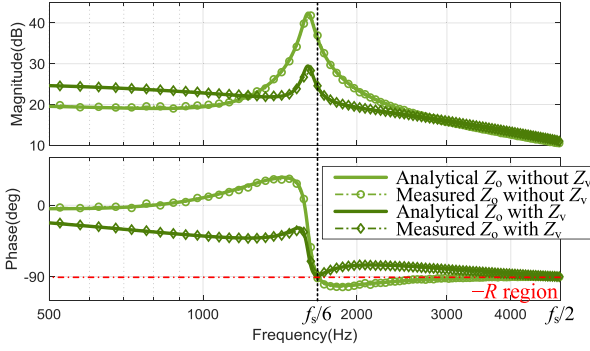

**FIGURE 11.** Closed-loop output impedance without / with virtual impedance control  $Z_v$  for PR& $H_v$  control obtained analytically and by frequency scan.

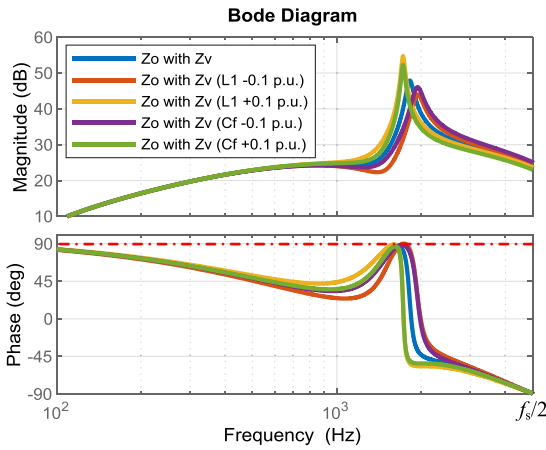


**FIGURE 12.** Closed-loop output impedance with virtual impedance control  $Z_v$  for single-loop control considering LC parameter variation.


operating points. Also, the filters may wear out during life-time. These variations of filter parameters could affect the passivity, which is thus discussed further. The parameter variation in LC filters can mainly come from the equivalent series resistance (ESR) and the deviation in inductance or capacitance from the nominal values, e.g., due to aging.

Theoretically,  $R_o$  reaches zero critically at  $f_s/6$ , which is the worst point for passivity. If any ESR is considered in the LC filter, it dissipates energy, which always provides more active damping. Therefore, the ESR does not threaten the passivity design.

As for the inductance or capacitance error, it is inevitable in real applications, which can lead to a slight shift of the LC resonant frequency. The impacts of the inductance and capacitance variation on the impedance passivity are investigated further. The parameter variations of  $\pm 0.1$  p.u. on  $L_1$  and  $C_f$  are considered, and an ESR of  $0.1 \Omega$  in  $L_1$  is considered at the same time. Fig. 12 shows the VSC output impedances with virtual impedance control for the single-loop control as an example. The control parameters are designed based on nominal values of the LC filter, while the impedances are calculated considering the LC parameter variation.

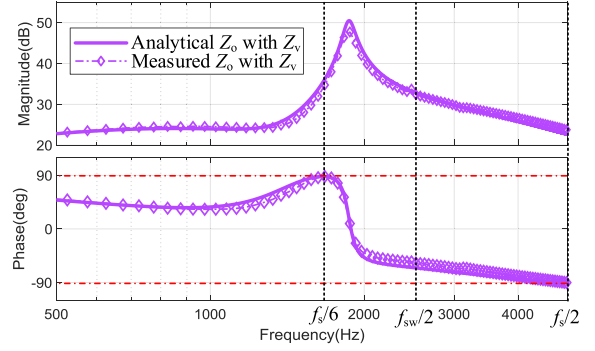

**FIGURE 13.** Closed-loop output impedance for single-loop control obtained analytically and by frequency scan with  $f_{sw} = 0.5f_s$  and  $T_d = 1.5T_s$ .

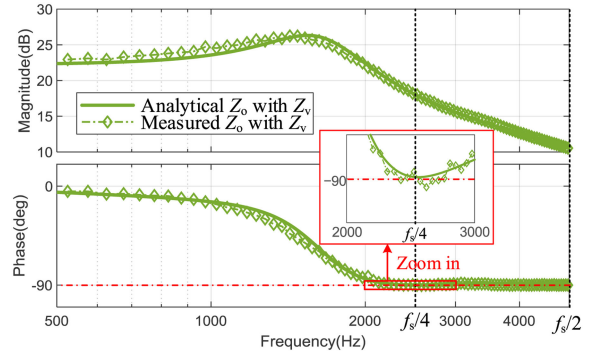


**FIGURE 14.** Closed-loop output impedance for dual-loop PR& $H_v$  control obtained analytically and by frequency scan with  $f_{sw} = f_s$  and  $T_d = T_s$ .

The ESR effect on passivity can be seen from the blue line, where the phase of  $Z_o$  does not reach to  $+90^\circ$  at  $f_s/6$ , implying a better passivity. Considering the parameter variation of  $L_1$  and  $C_f$ , it is found that the passivity is slightly worse, since the phase response near  $f_s/6$  gets closer to or even exceeds  $+90^\circ$ . The variation of  $\pm 0.1$  p.u. on  $L_1$  or  $C_f$  leads to the same frequency shift of  $f_{LC}$ , but the passivity change is more sensitive to the variation of  $L_1$ , since the passivity impacted by the  $L_1$  variation is worse than that impacted by  $C_f$  variation. However, due to the active damping provided by the ESRs in the circuit, the passivity-based virtual impedance design can tolerate the LC parameter variation to some extent, as seen from Fig. 12 that the passivity is almost guaranteed even with the LC parameter variation.


## 2) APPLICABILITY OF PASSIVITY-BASED CONTROL

The previous analysis is based on the assumptions that  $f_{sw} = f_s$  and  $T_d = 1.5T_s$ . The proposed passivity-based control is also applicable when  $f_{sw} \neq f_s$  or  $T_d \neq 1.5T_s$ .

Two more cases are studied for the validation of the proposed control [54]. Fig. 13 shows the frequency-scanned impedance with  $f_{sw} = 0.5f_s = 5$  kHz and  $T_d = 1.5T_s$  for the single-loop control, where the sampling frequency is selected twice as the switching frequency and the double PWM update is considered within a switching period. Fig. 14 shows the

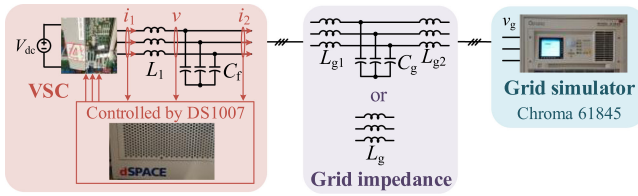

**FIGURE 15.** Experimental setup for grid-connected VSC for stability analysis.

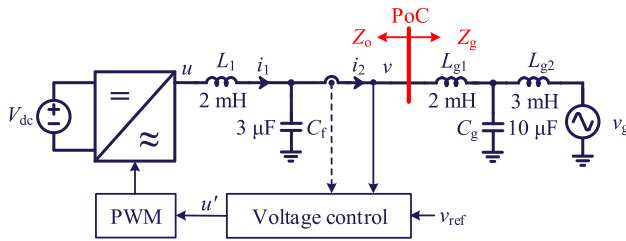

**FIGURE 16.** Grid-connected VSC through a resonant grid impedance for stability analysis of single-loop control.

result when  $f_{sw} = f_s = 10$  kHz and  $T_d = T_s$  for the dual-loop PR& $H_v$  control, where the critical frequency becomes  $f_s/4$ . This case can be realized by shifting the sampling instant toward the PWM update instant in order to reduce the calculation delay as  $0.5T_s$  [55]. Then with the PWM delay of  $0.5T_s$  considered, the total delay is reduced as one sampling period. In both cases, it can be seen that the passivity can be well designed till half of the sampling frequency.

## V. STABILITY VALIDATION


In this section, the passivity analysis is validated by the impedance-based stability analysis [56] and experimental tests on a grid-connected, voltage-controlled VSC.

Fig. 15 shows the experimental setup. A grid simulator, Chroma 61845, is utilized to emulate the ideal grid. A three-phase VSC with LC filter is controlled by DS1007 as a voltage source, which is connected to the grid through the grid impedances. The switching and sampling frequencies are selected as 10 kHz. Two cases with different grid impedances are studied for the stability analysis of single-loop control and dual-loop control, respectively.


### A. SINGLE-LOOP CONTROL

It is found from Fig. 7 and Fig. 8 that  $Z_o$  has an inductive behavior in the low-frequency range with  $-R$ , which can lead to harmonic oscillations when the VSC interacts with another electrical system that has a capacitive impedance. Hence, a resonant grid impedance is tested. The system configuration and nominal values of the passive components are shown in Fig. 16.

The high-frequency I-dominant voltage controller is utilized, which allows for the passivity-based design by virtual impedance. The VSC output impedance  $Z_o$  and the grid impedance  $Z_g$  seen at the point of connection (PoC) are plotted

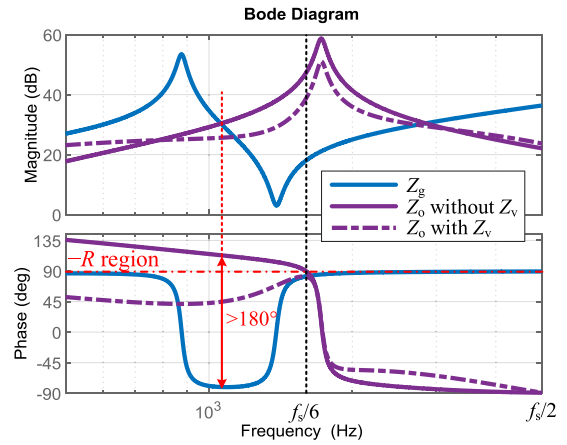

**FIGURE 17.** Impedance-based stability analysis for single-loop control without and with the virtual impedance control.

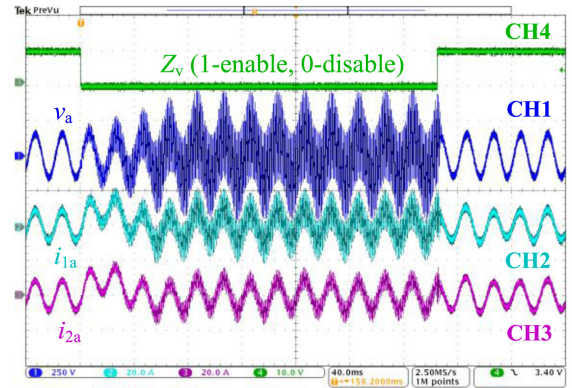

**FIGURE 18.** Experimental results for single-loop control without and with the virtual impedance control.



in Fig. 17. The VSC controller design is based on the nominal values of the LC filter, which are the same as given in Table 2. The impedance Bode plots are calculated based on actual values of all the passive components in the experiments, including their ESRs (around  $0.4 \Omega$  for each inductor), which can be tested in advance by a network analyzer. The major difference is that all the inductors have an actual inductance 0.1 p.u. larger than the nominal values. It can be seen without the virtual impedance control, the non-passivity of  $Z_o$  makes the phase difference between  $Z_o$  and  $Z_g$  to exceed  $180^\circ$  at their impedance-magnitude crossover frequency, which indicates instability according to the Nyquist stability criterion. In contrast, the  $-R$  can be eliminated till  $f_s/2$  by the virtual impedance control, and thus the system is stabilized.

The experimental results are shown in Fig. 18. The channels CH1, CH2, and CH3 show the capacitor voltage, the inductor current, and the output current, respectively, for the phase- $a$ . The channel CH4 shows the Enable signal for the virtual impedance control. With the virtual impedance control disabled, the system becomes unstable, which verifies the impedance-based stability analysis in Fig. 17.

**TABLE 4.** Controller Evaluation For Passivity Analysis and Design of Voltage-Controlled VSCs


Control Scheme	Voltage controller synthesis	$-R$ region	Passivity-based design by virtual impedance (till $f_s/2$ )
Single-loop control	$G_v$ : PR	$f \in (0, f_{cR})$ $f_{cR} > f_c$	Not applicable
	$G_v$ : R, PR-I, or IR (high-frequency I-dominant)	$f \in (0, f_c)$	$Z_v = \frac{K_1 L_1}{1 - \omega_c^2 L_1 C_f} > 0$
Dual-loop control	$H_v=0$ , $G_v$ : PR	$f \in (f_{cR}, f_s/2)$ $f_{cR} < f_c$	Not applicable
	$H_v=0$ , $G_v$ : R, PR-I, or IR (high-frequency I-dominant)	$f \in (f_c, f_s/2)$	$Z_v = \frac{1 - K_1 L_1}{\omega_c^2 L_1 C_f - 1} > 0$
	$H_v = K_{pi} K_{pv}$ $G_v$ : PR	$f \in (f_c, f_s/2)$	

Notes:  $f_c$  ( $\omega_c$ ) – critical frequency (angular frequency) that changes the sign of  $\cos(\omega T_d)$ , i.e.,  $f_c = 1/(4T_d)$ ;  $f_{cR}$  – critical frequency that changes the sign of  $R_o$ ;  $K_1$  – equivalent high-frequency integral gain of the voltage controller.

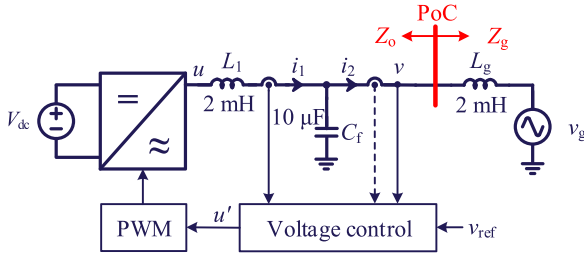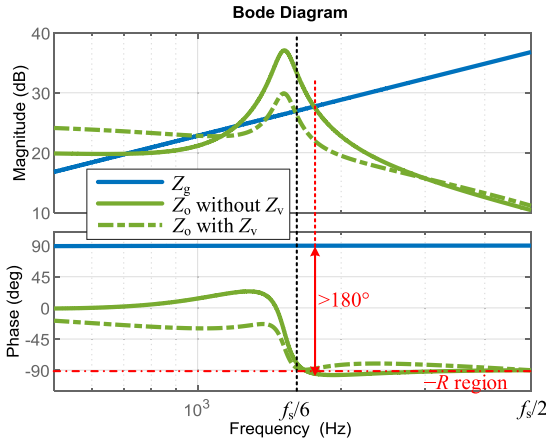**FIGURE 19.** Grid-connected VSC through an inductive grid impedance for stability analysis of dual-loop control.**FIGURE 20.** Impedance-based stability analysis for PR&Hv dual-loop control without and with the virtual impedance control.

## B. DUAL-LOOP CONTROL

For the dual-loop control,  $Z_o$  has a capacitive behavior in the high-frequency range with  $-R$ , which thus can lead to harmonic instability when the VSC interacts with another system that has an inductive impedance. Hence, an inductive grid impedance is tested for the stability validation. Fig. 19

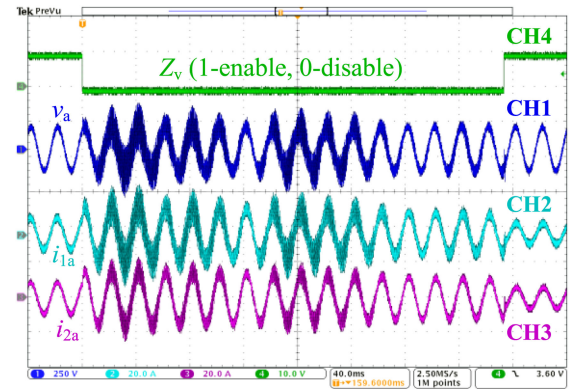**FIGURE 21.** Experimental results for PR&Hv dual-loop control without and with the virtual impedance control.

shows the system configuration and circuit parameters with nominal values.

The passivity for the dual-loop control is validated based on the PR&Hv control. The frequency responses of the grid impedance and the VSC impedance are plotted in Fig. 20. It is seen that the system is unstable without virtual impedance control, since the phase difference is larger than  $180^\circ$  at the impedance magnitude crossover frequency. This instability can be prevented by the virtual impedance control based on the design of  $K_{pi} K_{pv} = H_v$  as discussed in Section IV. Experimental results are provided in Fig. 21, which also verifies the stability analysis.

## VI. CONCLUSION

This paper studies the passivity-based controller design for voltage-controlled VSCs. Both the single-loop and dual-loop voltage control schemes have been discussed. It has been revealed that the control performance can be significantly

enhanced by the high-frequency I-dominant controllers. The major findings with the passivity analysis and control design for different control schemes are summarized in Table 4:

- a) The explicit  $-R$  regions have been compared. It is seen that the  $-R$  appears in the low-frequency range for the single-loop control, and appears in the high-frequency till  $f_s/2$  for the dual-loop control. The critical frequency  $f_c = 1/(4T_d)$ , which is determined by time delay, plays an important role in the width of the  $-R$  region.
- b) The virtual impedance controller gain, which is co-designed with the voltage controllers to realize the passivity till half of the sampling frequency, has been analytically derived. The value of  $Z_v$  is determined by the LC filter, the time delay, and the equivalent high-frequency integral gain of the voltage controller.

Experimental tests have validated the effectiveness of the passivity-based design. Compared with the exiting methods, the proposed method does not need much parameter tuning efforts and applies well to various voltage control schemes.


## REFERENCES

- [1] D. Boroyevich, I. Cvetkovic, R. Burgos, and D. Dong, "Intergrid: A future electronic energy network," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 1, no. 3, pp. 127–138, Sep. 2013.
- [2] F. Blaabjerg, R. Teodorescu, M. Liserre, and A. V. Timbus, "Overview of control and grid synchronization for distributed power generation systems," *IEEE Trans. Ind. Electron.*, vol. 53, no. 5, pp. 1398–1409, Oct. 2006.
- [3] X. Wang and F. Blaabjerg, "Harmonic stability in power electronic based power systems: Concept, modeling, and analysis," *IEEE Trans. Smart Grid*, vol. 10, no. 3, pp. 2858–2870, May 2019.
- [4] K. De Brabandere, B. Bolsens, J. Van den Keybus, A. Woyte, J. Driesen, and R. Balmans, "A voltage and frequency droop control method for parallel inverters," *IEEE Trans. Power Electron.*, vol. 22, no. 4, pp. 1107–1115, Jul. 2007.
- [5] H.-P. Beck and R. Hesse, "Virtual synchronous machine," in *Proc. 9th Int. Conf. Electr. Power Qual. Utilization (EQUPE)*, Oct. 2007, pp. 1–6.
- [6] L. Zhang, L. Harnefors, and H. Nee, "Power-synchronization control of grid-connected voltage-source converters," *IEEE Trans. Power Syst.*, vol. 25, no. 2, pp. 809–820, May 2010.
- [7] B. Kroposki *et al.*, "Achieving a 100% renewable grid: Operating electric power systems with extremely high levels of variable renewable energy," *IEEE Power Energy Mag.*, vol. 15, no. 2, pp. 61–73, Mar./Apr. 2017.
- [8] R. Lasseter, Z. Chen, and D. Pattabiraman, "Grid-forming inverters: A critical asset for power grid," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 8, no. 2, pp. 925–935, Jun. 2020.
- [9] M. J. Ryan, W. E. Brumsickle, and R. D. Lorenz, "Control topology options for single-phase UPS inverters," *IEEE Trans. Ind. Appl.*, vol. 33, no. 2, pp. 493–501, Mar./Apr. 1997.
- [10] P. Mattavelli, F. Polo, F. Dal Lago, and S. Saggini, "Analysis of control delay reduction for the improvement of UPS voltage-loop bandwidth," *IEEE Trans. Ind. Electron.*, vol. 55, no. 8, pp. 2903–2911, Aug. 2008.
- [11] M. Stecca, L. R. Elizondo, T. B. Soeiro, P. Bauer and P. Palensky, "A comprehensive review of the integration of battery energy storage systems into distribution networks," *IEEE Open J. Ind. Electron. Soc.*, vol. 1, pp. 46–65, 2020.
- [12] M. Chandorkar, D. M. Divan, R. Adapa, "Control of parallel connected inverters in standalone ac supply systems," *IEEE Trans. Ind. Appl.*, vol. 29, no. 1, pp. 136–143, Jan./Feb. 1993.
- [13] J. Rocabert, A. Luna, F. Blaabjerg, and P. Rodriguez, "Control of power converters in AC microgrids," *IEEE Trans. Power Electron.*, vol. 27, no. 11, pp. 4734–4749, Nov. 2012.
- [14] S. D'silva, M. Shadmand, S. Bayhan, and H. Abu-Rub, "Towards grid of microgrids: Seamless transition between grid-connected and islanded modes of operation," *IEEE Open J. Ind. Electron. Soc.*, vol. 1, pp. 66–81, 2020.
- [15] A. V. Jouanne, P. N. Enjeti, and D. J. Lucas, "DSP control of high power UPS systems feeding nonlinear loads," *IEEE Trans. Ind. Electron.*, vol. 43, no. 1, pp. 121–125, Feb. 1996.
- [16] U. B. Jensen, F. Blaabjerg, and J. K. Pedersen, "A new control method for 400-Hz ground power units for airplanes," *IEEE Trans. Ind. Appl.*, vol. 36, no. 1, pp. 180–187, Jan./Feb. 2000.
- [17] Z. Li, Y. Li, P. Wang, H. Zhu, C. Liu, and F. Gao, "Single-loop digital control of high-power 400-Hz ground power unit for airplanes," *IEEE Trans. Ind. Electron.*, vol. 57, no. 2, pp. 532–543, Feb. 2010.
- [18] X. Wang, P. C. Loh, and F. Blaabjerg, "Stability analysis and controller synthesis for single-loop voltage-controlled VSIs," *IEEE Trans. Power Electron.*, vol. 32, no. 9, pp. 7394–7404, Sep. 2017.
- [19] P. C. Loh, M. J. Newman, D. N. Zmood, and D. G. Holmes, "A comparative analysis of multiloop voltage regulation strategies for single and three-Phase UPS systems," *IEEE Trans. Power Electron.*, vol. 18, no. 5, pp. 1176–1185, Sep. 2003.
- [20] P. C. Loh and D. G. Holmes, "Analysis of multiloop control strategies for LC/CL/LCL-filtered voltage-source and current-source inverters," *IEEE Trans. Ind. Appl.*, vol. 41, no. 2, pp. 644–654, Mar./Apr. 2005.
- [21] Y. Li, D. M. Vilathgamuwa, and P. C. Loh, "Design, analysis, and real-time testing of a controller for multibus microgrid system," *IEEE Trans. Ind. Electron.*, vol. 19, no. 5, pp. 1195–1204, Sep. 2004.
- [22] Y. W. Li, "Control and resonance damping of voltage-source and current source converters with LC filters," *IEEE Trans. Ind. Electron.*, vol. 56, no. 5, pp. 1511–1521, May 2009.
- [23] Y. Geng, Y. Yun, R. Chen, K. Wang, H. Bai, and X. Wu, "Parameters design and optimization for LC-type off-grid inverters with inductor-current feedback active damping," *IEEE Trans. Power Electron.*, vol. 33, no. 1, pp. 703–715, Jan. 2018.
- [24] Y. Liao and X. Wang, "Evaluation of voltage regulators for dual-loop control of voltage-controlled VSCs," in *Proc. IEEE Energy Convers. Congr. Expo.*, Sep. 2019, pp. 5036–5042.
- [25] D. Pan, X. Ruan, C. Bao, W. Li, and X. Wang, "Optimized controller design for LCL-type grid-connected inverter to achieve high robustness against grid-impedance variation," *IEEE Trans. Ind. Electron.*, vol. 62, no. 3, pp. 1537–1547, Mar. 2015.
- [26] F. Bosio, L. A. S. Ribeiro, F. D. Freijedo, M. Pastorelli, and J. M. Guerrero, "Effect of state feedback coupling and system delays on the transient performance of stand-alone VSI with LC output filter," *IEEE Trans. Ind. Electron.*, vol. 63, no. 8, pp. 4909–4918, Aug. 2016.
- [27] X. Wang, F. Blaabjerg, and Z. Chen, "Synthesis of variable harmonic impedance in inverter-interfaced distributed generation unit for harmonic damping throughout a distribution network," *IEEE Trans. Ind. Appl.*, vol. 48, no. 4, pp. 1407–1417, Jul./Aug. 2012.
- [28] J. He, Y. W. Li, and M. S. Munir, "A flexible harmonic control approach through voltage-controlled DG-grid interfacing converters," *IEEE Trans. Ind. Electron.*, vol. 59, no. 1, pp. 444–455, Jan. 2012.
- [29] Q. Liu, Y. Tao, X. Liu, Y. Deng, and X. He, "Voltage unbalance and harmonics compensation for islanded microgrid inverters," *IET Power Electron.*, vol. 7, no. 5, pp. 1055–1063, 2014.
- [30] X. Wang, F. Blaabjerg, and Z. Chen, "Autonomous control of inverter interfaced distributed generation units for harmonic current filtering and resonance damping in an islanded microgrid," *IEEE Trans. Ind. Appl.*, vol. 50, no. 1, pp. 452–461, Jan./Feb. 2014.
- [31] X. Wang, Y. W. Li, F. Blaabjerg, and P. C. Loh, "Virtual-impedance-based control for voltage-source and current-source converters," *IEEE Trans. Power Electron.*, vol. 30, no. 12, pp. 7019–7037, Dec. 2015.
- [32] D. Arricibita, P. Sanchis, R. Gonzalez, and L. Marroyo, "Impedance emulation for voltage harmonic compensation in PWM stand-alone Inverters," *IEEE Trans. Energy Convers.*, vol. 32, no. 4, pp. 1335–1344, Dec. 2017.
- [33] X. Wang, F. Blaabjerg, Z. Chen, and W. Wu, "Resonance analysis in parallel voltage-controlled distributed generation inverters," in *Proc. IEEE Appl. Power Electron. Conf. Expo.*, Mar. 2013, pp. 2977–2983.
- [34] J. L. Wyatt, L. O. Chua, J. W. Gannett, I. C. Goknar, and D. N. Green, "Energy concepts in the state-space theory of nonlinear n-ports: Part I – passivity," *IEEE Trans. Circ. Syst.*, vol. CAS–28, no. 1, pp. 48–61, Jan. 1981.
- [35] R. Ortega, A. Loria, P. J. Nicklasson, H. Sira-Ramirez, *Passivity-Based Control of Euler-Lagrange Systems: Mechanical, Electrical and Electromechanical Applications*. Berlin, Germany: Springer Science & Business Media, 1998.

- [36] M. Pérez, R. Ortega, and J. R. Espinoza, "Passivity-based PI control of switched power converters," *IEEE Trans. Control Syst. Tech.*, vol. 12, no. 6, pp. 881–890, Nov. 2004.
- [37] Y. Gui, W. Kim, and C. C. Chuang, "Passivity-based control with nonlinear damping for type 2 STATCOM systems," *IEEE Trans. Power Syst.*, vol. 31, no. 4, pp. 2824–2833, Jul. 2016.
- [38] L. Harnefors, X. Wang, A. G. Yepes, and F. Blaabjerg, "Passivity based stability assessment of grid-connected VSCs—an overview," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 4, no. 1, pp. 116–125, Mar. 2016.
- [39] L. Harnefors, R. Finger, X. Wang, H. Bai, and F. Blaabjerg, "VSC input-admittance modeling and analysis above the Nyquist frequency for passivity-based stability assessment," *IEEE Trans. Ind. Electron.*, vol. 64, no. 8, pp. 6362–6370, Aug. 2017.
- [40] L. Harnefors, L. Zhang, and M. Bongiorno, "Frequency-domain passivity based current controller design," *IET Power Electron.*, vol. 1, no. 4, pp. 455–465, Dec. 2008.
- [41] L. Harnefors, A. G. Yepes, A. Vidal, and J. Doval-Gandoy, "Passivity-based controller design of grid-connected VSCs for prevention of electrical resonance instability," *IEEE Trans. Ind. Electron.*, vol. 62, no. 2, pp. 702–710, Feb. 2015.
- [42] F. Hans, W. Schumacher, S. Chou, and X. Wang, "Passivation of current-controlled grid-connected VSCs using passivity indices," *IEEE Trans. Ind. Electron.*, vol. 66, no. 11, pp. 8971–8980, Nov. 2019.
- [43] X. Wang, F. Blaabjerg, and P. C. Loh, "Passivity-based stability analysis and damping injection for multiparalleled VSCs with LCL filters," *IEEE Trans. Power Electron.*, vol. 32, no. 11, pp. 8922–8935, Nov. 2017.
- [44] L. Harnefors, A. G. Yepes, A. Vidal, and J. Doval-Gandoy, "Passivity-based stabilization of resonant current controllers with consideration of time delay," *IEEE Trans. Power Electron.*, vol. 29, no. 12, pp. 6260–6263, Dec. 2014.
- [45] M. A. Awal, W. Yu, and I. Husain, "Passivity based predictive-resonant current control for resonance damping in LCL-equipped VSCs," *IEEE Trans. Ind. Appl.*, vol. 56, no. 2, pp. 1702–1713, Mar./Apr. 2020.
- [46] H. Bai, X. Wang, and F. Blaabjerg, "Passivity enhancement in renewable energy source based power plant with paralleled grid-connected VSI," *IEEE Trans. Ind. Appl.*, vol. 53, no. 4, pp. 3793–3802, Jul./Aug. 2017.
- [47] H. Yu, M. A. Awal, H. Tu, Y. Du, S. Lukic, and I. Husain, "Passivity-oriented discrete-time voltage controller design for grid-forming inverters," in *Proc. IEEE Energy Convers. Congr. Expo.*, Sep. 2019, pp. 469–475.
- [48] Y. Liao and X. Wang, "Passivity analysis and enhancement of voltage control for voltage-source converters," in *Proc. IEEE Energy Convers. Congr. Expo.*, Sep. 2019, pp. 5424–5429.
- [49] S. Hiti, D. Boroyevich, and C. Cuadros, "Small-signal modeling and control of three-phase PWM converters," in *Proc. IEEE Ind. Appl. Soc. Annu. Meet.*, Oct. 1994, pp. 1143–1150.
- [50] A. G. Yepes, F. D. Freijedo, J. Doval-Gandoy, O. Lopez, J. Malvar, and P. Fernandez-Comesana, "Effects of discretization methods on the performance of resonant controllers," *IEEE Trans. Power Electron.*, vol. 25, no. 7, pp. 1692–1712, Jul. 2010.
- [51] R. Teodorescu, F. Blaabjerg, M. Liserre, and P. C. Loh, "Proportional-resonant controllers and filters for grid-connected voltage-source converters," *IEE Proc. Elec. Power Appl.*, vol. 153, no. 5, pp. 750–762, Sep. 2006.
- [52] L. Harnefors, "Modeling of three-phase dynamic systems using complex transfer functions and transfer matrices," *IEEE Trans. Ind. Electron.*, vol. 54, no. 4, pp. 2239–2248, Aug. 2007.
- [53] D. G. Holmes, T. A. Lipo, B. P. McGrath, and W. Y. Kong, "Optimized design of stationary frame three phase AC current regulators," *IEEE Trans. Power Electron.*, vol. 24, no. 11, pp. 2417–2426, Jan. 2009.
- [54] S. Buso and P. Mattavelli, *Digital Control in Power Electronics*. San Rafael, CA, USA: Morgan & Claypool, 2015.
- [55] D. Yang, X. Ruan, and H. Wu, "A real-time computation method with dual sampling mode to improve the current control performance of the LCL-type grid-connected inverter," *IEEE Trans. Ind. Electron.*, vol. 62, no. 7, pp. 4563–4572, Jul. 2015.
- [56] Y. Liao and X. Wang, "Impedance-based stability analysis for inter-connected converter systems with open-loop RHP poles," *IEEE Trans. Power Electron.*, vol. 35, no. 4, pp. 4388–4397, Apr. 2020.



**YICHENG LIAO** (Student Member, IEEE) received the B.S. degree in electrical engineering and its automation and the M.S. degree in electrical engineering from Southwest Jiaotong University, Chengdu, China, in 2015 and 2018, respectively. She is currently working toward the Ph.D. degree in power electronic engineering in Aalborg University, Aalborg, Denmark. She was a Visiting Student with Ecole Polytechnique and Inria, Paris, France, in July 2017, and has been a Research Assistant with the Department of Energy Technology, Aalborg University since September 2018. Her research interests include the modeling, stability analysis, and control of power electronics-based power systems.



**XIONGFEI WANG** (Senior Member, IEEE) received the B.S. degree from Yanshan University, Qinhuangdao, China, in 2006, the M.S. degree from Harbin Institute of Technology, Harbin, China, in 2008, both in electrical engineering, and the Ph.D. degree in energy technology from Aalborg University, Aalborg, Denmark, in 2013. Since 2009, he has been with the Department of Energy Technology, Aalborg University, where he became an Assistant Professor in 2014, an Associate Professor in 2016, a Professor and Research Program Leader for Electronic Power Grid (eGrid) in 2018, and the Director of Aalborg University-Huawei Energy Innovation Center in 2020. His current research interests include modeling and control of grid-interactive power converters, stability and power quality of converter-based power systems, active and passive filters. Dr. Wang was selected into Aalborg University Strategic Talent Management Program in 2016. He has received six IEEE Prize Paper Awards, the 2016 Outstanding Reviewer Award of IEEE TRANSACTIONS ON POWER ELECTRONICS, the 2018 IEEE PELS Richard M. Bass Outstanding Young Power Electronics Engineer Award, the 2019 IEEE PELS Sustainable Energy Systems Technical Achievement Award, and the 2019 Highly Cited Researcher by Clarivate Analytics (former Thomson Reuters). He serves as a Member at Large for Administrative Committee of IEEE Power Electronics Society, 2020–2022, and an Associate Editor for the IEEE TRANSACTIONS ON POWER ELECTRONICS, the IEEE TRANSACTIONS ON INDUSTRY APPLICATIONS, and the IEEE JOURNAL OF EMERGING AND SELECTED TOPICS IN POWER ELECTRONICS.



**FREDE BLAABJERG** (Fellow, IEEE) was with ABB-Scandia, Randers, Denmark, from 1987 to 1988. From 1988 to 1992, he got the Ph.D. degree in electrical engineering at Aalborg University in 1995. He became an Assistant Professor in 1992, an Associate Professor in 1996, and a Full Professor of power electronics and drives in 1998. From 2017 he became a Villum Investigator. He is honoris causa at University Politehnica Timisoara (UPT), Romania and Tallinn Technical University (TTU) in Estonia. His current research interests include power electronics and its applications such as in wind turbines, PV systems, reliability, harmonics and adjustable speed drives. He has published more than 600 journal papers in the fields of power electronics and its applications. He is the Co-Author of four monographs and Editor of ten books in power electronics and its applications. He has received 32 IEEE Prize Paper Awards, the IEEE PELS Distinguished Service Award in 2009, the EPE-PEMC Council Award in 2010, the IEEE William E. Newell Power Electronics Award 2014, the Villum Kann Rasmussen Research Award 2014, the Global Energy Prize in 2019 and the 2020 IEEE Edison Medal. He was the Editor-in-Chief of the IEEE TRANSACTIONS ON POWER ELECTRONICS from 2006 to 2012. He has been Distinguished Lecturer for the IEEE Power Electronics Society from 2005 to 2007 and for the IEEE Industry Applications Society from 2010 to 2011 as well as 2017 to 2018. In 2019–2020 he serves as President of IEEE Power Electronics Society. He is Vice-President of the Danish Academy of Technical Sciences too. He is nominated in 2014–2019 by Thomson Reuters to be between the most 250 cited researchers in engineering in the world.