

Stochastic Optimal Strategy for Power Management in Interconnected Multi-Microgrid Systems

Javidsharifi, Mahshid; Pourroshanfekr Arabani, Hamoun; Kerekes, Tamas; Sera, Dezso; Guerrero, Josep M.

Published in:
Electronics

DOI (link to publication from Publisher):
[10.3390/electronics11091424](https://doi.org/10.3390/electronics11091424)

Creative Commons License
CC BY 4.0

Publication date:
2022

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Javidsharifi, M., Pourroshanfekr Arabani, H., Kerekes, T., Sera, D., & Guerrero, J. M. (2022). Stochastic Optimal Strategy for Power Management in Interconnected Multi-Microgrid Systems. *Electronics*, 11(9), Article 1424. <https://doi.org/10.3390/electronics11091424>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.


- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Article

Stochastic Optimal Strategy for Power Management in Interconnected Multi-Microgrid Systems

Mahshid Javidsharifi ^{1,*} , Hamoun Pourroshanfekr Arabani ², Tamas Kerekes ¹, Dezso Sera ³  and Josep M. Guerrero ¹ 

¹ Department of AAU Energy, Aalborg University, 9220 Aalborg, Denmark; tak@energy.aau.dk (T.K.); joz@energy.aau.dk (J.M.G.)

² Division of Industrial Electrical Engineering and Automation, Lund University, SE-22100 Lund, Sweden; hamoun.pourroshanfekr_arabani@iea.lth.se

³ Faculty of Science and Engineering, Queensland University of Technology, Brisbane, QLD 4000, Australia; dezso.sera@qut.edu.au

* Correspondence: mja@energy.aau.dk; Tel.: +45-9940-3375

Abstract: A novel stochastic strategy for solving the problem of optimal power management of multi-microgrid (MMG) systems is suggested in this paper. The considered objectives are minimizing the total cost and emission of the system. The suggested algorithm is applied on a MMG consisting of four microgrids (MG), each including fossil fuel-based generator units, wind turbine (WT), photovoltaic (PV) panel, battery, and local loads. The unscented transformation (UT) method is applied to deal with the inherent uncertainties of the renewable energy sources (RES) and forecasted values of the load demand and electricity price. The proposed algorithm is applied to solve the power management of a sample MMG system in both deterministic and probabilistic scenarios. It is justified through simulation results that the suggested algorithm is an efficient approach in satisfying the minimization of the cost and the environmental objective functions. When considering uncertainties, it is observed that the maximum achievable profit is about 23% less than that of the deterministic condition, while the minimum emission level increases 22%. It can be concluded that considering uncertainties has a significant effect on the economic index. Therefore, to present more accurate and realistic results it is essential to consider uncertainties in solving the optimal power management of MMG system.

Keywords: stochastic optimal power management; multi-microgrid systems; uncertainty; unscented transformation; multi-objective JAYA algorithm



Citation: Javidsharifi, M.; Pourroshanfekr Arabani, H.; Kerekes, T.; Sera, D.; Guerrero, J.M. Stochastic Optimal Strategy for Power Management in Interconnected Multi-Microgrid Systems. *Electronics* **2022**, *11*, 1424. <https://doi.org/10.3390/electronics11091424>

Academic Editor: Farhad Rachidi

Received: 4 April 2022

Accepted: 26 April 2022

Published: 28 April 2022

Publisher's Note: MDPI stays neutral with regard to jurisdictional claims in published maps and institutional affiliations.



Copyright: © 2022 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

1. Introduction

Penetration of distributed energy resources (DERs) and especially renewable-based generators is increased because of recent rise in energy demand and environmental issues [1]. To support some benefits, such as reliability, sustainability, and cost-effectiveness, microgrids (MGs) were proposed to aggregate DERs and loads with distribution networks [2]. Due to the rapid development of microgrids in distribution systems, the multi-microgrid (MMG) concept is proposed concerning the interaction and energy exchange among MGs [3].

The energy management of MMGs has turned into a challenging topic in the literature. In [4], a chance-constrained model was proposed for solving the probabilistic optimal energy management of MMG systems. The authors did not yet investigate the efficiency of their model on the emission of greenhouse gases. Penetration of renewable energy sources (RESs) on the performance of the islanded MMG systems was studied in [5]. Though, the cost allocation among MGs, emission of greenhouse gases, and energy not supplied (ENS) were not investigated. The authors of [6] suggested the epsilon constraint method and fuzzy model to define the best plan for the energy hubs in solving

the multi-objective optimization for water management of a MMG system. Nevertheless, the uncertainties of RESs and demand response programs were not considered. To model the interaction among MGs, a cooperative energy planning was presented in [7]. The uncertainties of RESs were not considered in the model. Some authors proposed a probabilistic scheme in [8] to deal with the energy exchange among MGs. However, the efficiency of the cooperation MGs was not investigated. A cooperative game for short-term energy probabilistic planning of the MMG systems was proposed in [9] while modeling the uncertainties of RESs. However, the authors did not consider emission in their model.

A cooperative energy-management framework for “networked multi-carrier systems” was proposed in [10]. The authors, however, did not study the uncertainties of RESs. In [11], an optimal energy-management framework was suggested for the hybrid MMG system. To fairly divide profit among MGs, a cooperative game was applied. An energy trading approach based on the cooperative game was employed in [12]. However, uncertainties were not considered in the model.

In [13], a “two-stage multi-objective optimization” approach was suggested for optimal energy management of MMG systems. The objective functions were minimizing the total cost, energy not supplied (ENS), and greenhouse gas emissions. However, the uncertainties were not studied in the suggested framework. A cooperative game was proposed in [14] to determine the best coalition among microgrids in MMG systems. The problem was considered as a single-objective problem considering cost minimization as the objective function. In addition, the uncertainties of RESs were not considered in the problem.

“A two-stage stochastic programming” method was proposed in [15] for MMG management considering reliability and the emission of the system. The suggested two-stage stochastic optimization strategy in [16] considered capital and operational costs in the optimal design and operation of MMG systems. In [17], the flexibility of MMG system operation was improved through “mobile energy storage systems and power transactions.” To consider energy management of MMGs, some authors studied the uncertainty caused by random electric vehicle charging in [18]. The objective functions were reducing line loss, the generated emissions and minimizing cost. The authors in [17–20] did not investigate an optimal offering of MGs for energy transactions with the distribution system in the considered MMG energy management.

A “software-defined networking system” was presented in [19] to promote energy sharing among MGs through a transactive energy framework. The suggested approach resulted in reducing the total cost of the MMG system. A chance-constrained model was applied in [20] for optimal day-ahead scheduling of a MMG considering emissions of the system. However, optimal bidding strategy and demand response program were not studied. A “risk-constrained stochastic mixed-integer linear programming (MILP) model” was presented in [21] for “optimal bidding strategy of a CHP-based MMG system” considering environmental restrictions and demand response programs.

In [22], a robust decentralized energy-management approach was proposed for the optimal day-ahead scheduling of a MMG system in the presence of hydrogen refueling stations and EV parking. A two-stage probabilistic optimization framework for day-ahead scheduling of MMG systems was proposed in [23] to minimize the total operational cost. Applying a variable weighted multi-objective function in [24], the authors presented a coordinated energy-management approach for optimal operation of MMG systems. The “targeted search shuffled complex evolution optimization algorithm” was then proposed to optimize decision parameters in faulted and normal operation modes. A “stochastic contingency-constrained energy and reserve scheduling model” was presented in [25] for an islanded P2H- equipped MMG considering demand response program. “A multi-period optimal energy scheduling for MMGs

integrated with an urban transportation network” was suggested in [26] which was facilitated by “peer-to-peer communication of transactive energy information among the agents”.

The main advantages of using meta-heuristic algorithms in solving multi-objective problems are reviewed in the literature [1,2]. Different meta-heuristic algorithms were applied in solving a variety of multi-objective problems [27–31]. In [27], a multi-objective memetic search algorithm (MMSA), was suggested to solve the multi-objective permutation flow shop scheduling problem (MOPFSSP). An improved particle swarm optimization (PSO) algorithm with the continuous high-degree Bezier curve was proposed in [28] for solving the problem of smooth path planning for mobile robots. A combination of the whale optimization algorithm (WOA) and PSO was presented in [29] to tackle the problem of the optimal placement of motion sensors in smart homes and intelligent environments. A multi-objective genetic algorithm (GA) was proposed in [30] to optimize multiple design metrics of a stand-alone PV/battery system. The purpose-oriented shuffled complex evolution (POSCE) algorithm was suggested in [31] for solving of energy management of MMG systems for both faulted and normal operation modes.

In this paper, a multi-objective JAYA (MJAYA) algorithm is proposed to investigate the optimal power management in interconnected MMG systems. The burdensome tuning procedure of controlling algorithmic parameters is not required in JAYA algorithm that makes it superior when compared to all other algorithms [32]. In short, the major advantages of the proposed MJAYA algorithm are fast convergence and low computational time as well as its ability to independently control the algorithmic parameters [32–34]. Due to the inherent uncertainties of RESs besides the fluctuations of load demand and electricity price the operation and power management of MMG systems have become complex [35]. Consequently, different strategies have been conducted to analyze the stochastic operation of MGs [36]. To consider the uncertainties related to the forecasted values of load demand, market price and the available outputs of RESs, the unscented transformation (UT) method is employed. UT method is time-efficient and very accurate in solving problems with high data rates [35–37]. To investigate the stochastic optimal power management in inter-connected multi-microgrid systems UT-MJAYA is proposed in this paper. The validity of the suggested UT-MJAYA algorithm in solving probabilistic power management of MMG systems is verified by implementing the algorithm on a grid-connected MMG system of Figure 1, including four interconnected MGs.

The main contributions of this paper are summarized as follows:

1. The proposed UT-MJAYA algorithm can appropriately deal with multi-objective stochastic power management of MMG systems, while considering conflicting objectives;
2. The suggested optimal power management strategy aims to minimize the total cost of day-ahead market transactions and fuel costs, while it is also intent on minimizing emission of the system;
3. The uncertainties related to the forecasted values of the load demand, electricity price, and the available outputs of RESs are considered and investigated competently applying the presented UT-MJAYA algorithm;
4. Since in the considered problem of optimal power management of MMGs the generations of renewable energies (i.e., wind and photovoltaic) as well as the load demand and electricity price are correlated, the correlation between these uncertain variables are considered; and
5. By maximizing the utilization of RESs in the considered region, the suggested approach concentrates on the reduction of dependency of the MMG system on the main grid and the electricity market.

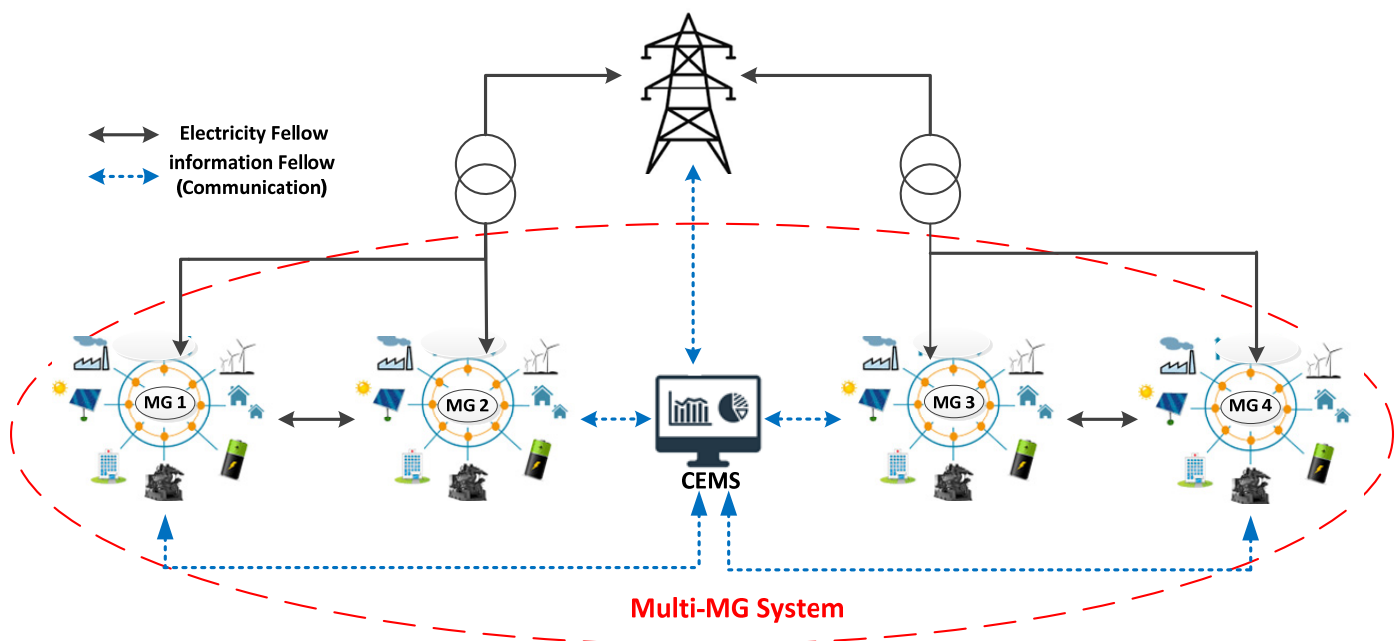


Figure 1. The considered MMG system.

2. Problem Formulation

Figure 1 shows the considered MMG system, which consists of four MGs. According to Figure 2, each MG includes dispatchable (i.e., fossil fuel-based units, which includes diesel generators) and non-dispatchable (wind turbine (WT) and photovoltaic (PV) system) units as well as energy storage (ES) device and local loads. The central energy-management system (CEMS) as a central controller collects information of power consumption and generation as well as ES states and sends commands to the dispatchable units. Decisions and orders can be transferred through information links. considered that the MGs in the MMG system are close to each other to be controlled by one EMS without encountering any problem in the information flow among MGs and the CEMS.

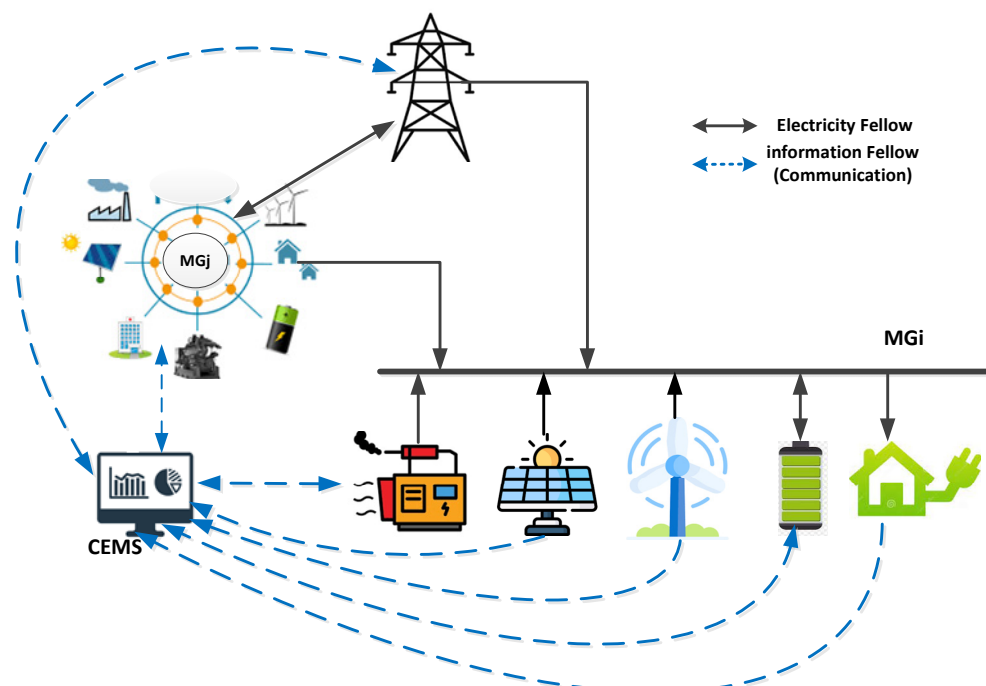


Figure 2. The components of the MMG system.

Stochastic optimal power management of MMG system is solved for 24-h day-ahead. The outputs include the total produced and consumed power of each MG in the MMG, the produced power of each dispatchable unit, the rate, and hours of charging/dis-charging of batteries, the power sharing among the MGs and the hourly power shared between the MMG and the main electricity grid. Moreover, since in the operation of MMG it is aimed to use the maximum produced and achievable power of renewable-based units (WT and PV) CEMS should accurately forecast the available power of WT and PV units. Additionally, since there exist local loads in each MG and due to the power sharing between the MMG and the electricity grid CEMS should decide on an accurate and proper strategy based on load demand and the electricity price while considering the uncertainties. Accordingly, the stochastic optimal power management of MMG problem is considered as a bi-objective optimization problem for minimizing the operational cost and emission.

2.1. Minimizing the Operational Cost

The first objective is to minimize the total operational cost in the power management of an MMG. The total cost consists of the cost of diesel generators plus the cost of power sharing between the MMG and the electricity grid, which is modeled as (1). The CEMS unit of the MMG purchases power from the electricity grid when the electricity price is low while it sells power to the electricity grid during the high price hours. Accordingly, the operational cost is reduced, and this leads to profit from the difference of selling and buying price of electric energy.

$$F_1 = \min(\text{Operation Cost}) = \min \left(\sum_{n=1}^{N_p} \left\{ \sum_{t=1}^T \left\{ \text{Cost}_{DG}^{n,t} + P_{EX}^{n,t} B_{EX}^t \right\} \right\} \right) \quad (1)$$

Operation Cost is the operational cost of MMG, N_p is the number of MGs in the MMG system, T is the horizon of operation which is considered equal to 24 h in this paper and $\text{Cost}_{DG}^{n,t}$ is the hourly operational cost of dispatchable units in \$. $P_{EX}^{n,t}$ is the shared power of n^{th} MG with the electricity grid in MW and the positive values of $P_{EX}^{n,t}$ represent purchasing energy from the electricity grid while the negative values represent selling energy to the grid. B_{EX}^t is the market price in electric market in \$/MWh. Accordingly, $P_{EX}^{n,t} B_{EX}^t$ is representative of income (if $P_{EX}^{n,t}$ is negative) and cost (if $P_{EX}^{n,t}$ is positive) from power sharing with the electricity grid.

2.2. Minimizing the Emission

In order to consider the environmental effects of emissions in the MMG the second objective function is to minimize the total emission of the units. The mathematical model of the second objective function is as follows:

$$F_2 = \min(\text{Emission}) = \min \left(\sum_{n=1}^{N_p} \sum_{t=1}^T \left\{ P_{DG}^{n,t} E_{DG}^{n,t} + P_{EX}^{n,t} E_{EX}^t \right\} \right) \quad (2)$$

where *Emission* represents the value of emission from MMG, $E_{DG}^{n,t}$ is the emission factor in kg for each MWh of the produced power of fossil fuel-based units, E_{EX}^t represents the emission of each MWh received power from the electricity grid in kg. Accordingly, $P_{DG}^{n,t} E_{DG}^{n,t}$ represents the value of emission in kg resulted from the output power of fossil fuel-based units while $P_{EX}^{n,t} E_{EX}^t$ represents the value of emission in kg resulted from purchasing power from the electricity grid.

It should be mentioned that, when the power is delivered to the electricity grid from MMG (i.e., $P_{EX}^{n,t}$ is negative) the emission term related to the electricity grid equals zero and no emission is produced. Moreover, the ES device as well as PV and WT units produce no emission.

2.3. Technical Constraints

The balance of the amount of demanded load and the hourly total generated power of diesel generators, the stored power in ESs, the forecasted power of renewable based units as well as the exchanged power between MGs and the main electricity grid is the most important requirement of the MMG optimal operation problem. The power balance equation can be formulated as follows:

$$P_{DG}^{n,t} + P_{Batt}^{n,t} + P_{EX}^{n,t} + P_{WT}^{n,t} + P_{PV}^{n,t} + \sum_{\substack{m=1 \\ m \neq n}}^{N_p} P_{nm}^t = P_L^{n,t} \quad (3)$$

$$n = 1, 2, 3, 4 \quad t = 1, 2, \dots, 24$$

where $P_L^{n,t}$ is the hourly total demanded load of each MG in MW, $P_{WT}^{n,t}$ and $P_{PV}^{n,t}$ are, respectively, the estimated hourly power of WT and PV units of each MG in MW, $P_{Batt}^{n,t}$ is the battery charging (negative values) and discharging (positive values) values in each MG in MWh. $\sum_{\substack{m=1 \\ m \neq n}}^{N_p} P_{nm}^t$ is the amount of exchanged power among MGs in which P_{nm}^t

presents the hourly exchanged power between the n^{th} and m^{th} MG in MW.

The positive values of P_{nm}^t show the power sharing from the n^{th} MG to the m^{th} MG while the negative values represent the power sharing from the m^{th} MG to the n^{th} MG. Moreover, all the generated and stored powers as well as the exchanged power with the electricity grid should satisfy the power limit constraints as follows:

$$P_{DG,min}^n \leq P_{DG}^{n,t} \leq P_{DG,max}^n \quad (4)$$

$$-P_{nm,max} \leq P_{nm}^t \leq P_{nm,max} \quad (5)$$

$$-P_{EX,max}^n \leq P_{EX}^{n,t} \leq P_{EX,max}^n \quad (6)$$

$$P_{Batt,min}^n \leq P_{Batt}^{n,t} \leq P_{Batt,max}^n \quad (7)$$

$$BL_{Batt,min}^n \leq BL_{Batt}^{n,t} \leq BL_{Batt,max}^n \quad (8)$$

where $P_{DG,min}^n$ and $P_{DG,max}^n$ are the minimum and maximum generated power of DG unit in MW, respectively. $P_{nm,max}$ is the maximum exchangeable power between the n^{th} and the m^{th} MG in the MMG system in MW. $P_{EX,max}^n$ is the maximum exchangeable power with the electricity grid in MW. $P_{Batt,max}^n$ is the maximum hourly charging/discharging value of the battery of each MG in MW. $BL_{Batt,min}^n$ and $BL_{Batt,max}^n$ are, respectively, the minimum and the maximum stored energies in the battery of each MG in MWh.

3. Unscented Transformation (UT) Method

Most of the problems in power system planning deal with uncertainties [35–37]. In order to manage the inherent uncertainties of random variables in power systems efficient approaches should be applied such that the sensitivity of the results to the uncertainties decreases. Due to the existence of renewable-based power generation in MGs the optimum power management of microgrids is considered as a high probabilistic problem with high degree of uncertainties. Moreover, the load variation in MGs is more significant than in conventional power systems. Consequently, an appropriate approach should be considered to carry out the uncertainties in the optimal power management of MMG.

UT method is an efficient approach for modeling uncertainties and solving probabilistic problems [35–37]. Comparing with Monte-Carlo, UT has less computational cost and is inherently developed to model the correlation among uncertain variables [37]. Using covariance matrices enables UT method to model uncertainties in each situation. UT method is efficiently capable of modeling uncertainties of input variables with any linear and nonlinear correlations [36]. Consequently, UT becomes one of the efficient and proper approaches for considering and modeling uncertainties of input variables. UT is a method to calculate a random variable in a nonlinear function and it has been presented to overcome the deficiencies of conventional methods especially those that apply linearization process [35–37]. The major consideration in UT is how to produce proper samples of input variables that maintain appropriate data of the probability density function of input variables [36].

A deterministic sampling approach is employed in UT method and states' distributions are shown by the total minimum sampling points (namely, sigma points) that are selected with high accuracy. In UT procedure, the set of sigma points passes through the system's nonlinear function to achieve new mean value and covariance related to the distribution of new states.

$$y_{\sigma} = f(X) \quad (9)$$

where y_{σ} is a function of the matrix of sigma points that are shown by X . This equation leads to another matrix which includes the transformed sigma points that were passed through the nonlinear function. Using (9), the Gaussian distribution related to the estimated states can be approximated. The main steps of the UT method are as follows:

1. calculating the set of sigma points;
2. assigning weights to each sigma point;
3. converting sigma points using the nonlinear function;
4. calculating the Gaussian distribution of new states and their related assigned weights; and
5. finding the covariance and mean value of the new Gaussian distribution.

The procedure of UT method is as follows:

Step 1: generating the covariance matrix of uncertain variables: the elements of the main diagonal of the covariance matrix are the standard deviation of uncertain variables while the off-diagonal elements show the correlation among uncertain variables;

Step 2: generating sigma points: sigma points should model the behavior of the uncertain variables so they should be generated based on covariance matrix. The following is used to generate the sigma points:

$$X^k = + \left(\sqrt{m \times P_{xx}} \right)_k \quad k = 1, 2, \dots, m \quad (10)$$

$$X^k = - \left(\sqrt{m \times P_{xx}} \right)_k \quad k = 1, 2, \dots, m \quad (11)$$

Step 3: assigning weights to each sigma point: in this step, a weight is assigned to each sigma point based on the following:

$$W^k = \frac{1}{2m} \quad k = 1, 2, \dots, 2m \quad (12)$$

It should be mentioned that the numerical values of weights are between zero and one.

$$\sum_{k=1}^{2m} W^k = 1 \quad 0 < W^k < 1 \quad (13)$$

Step 4: output extraction for sigma points: for each sigma point the outputs of the problem are extracted based on the following:

$$y^k = f(X^k) \quad (14)$$

and

Step 5: achieving the mean value of the output: according to the extracted outputs and the assigned weights, the output of the problem is calculated as follows:

$$\mu_y = \sum_{k=1}^{2m} W^k \times Y^k \quad (15)$$

4. System Structure

Figure 2 shows the components of the considered MMG. In this section, the studied model of each component is represented.

4.1. Generation Units' Model

In order to calculate the available power of WT units the hourly wind speed should be forecasted while it is assumed that the mean value and standard deviation of the wind speed in each hour is known. According to Section 3, using the UT method the hourly wind speed is estimated and two scenarios are assigned for each hourly wind speed value in which the positive value is for the first and the negative value is for the second scenario. The values of other uncertain variables are considered as constant.

$$v^t = \mu_{v^t} \pm \left(\sqrt{\frac{m}{1 - W^0} \times P_{xx}} \right) \quad (16)$$

where v^t is the forecasted hourly wind speed in m/s, μ_{v^t} is the hourly mean value of wind speed in m/s, m is number of uncertain variables and W^0 is the weighted value related to each scenario in which the wind speed in every hour equals to the mean value. P_{xx} is a square matrix the dimension of which is equal to the number of uncertain variables. The elements of the main diagonal equal to the standard deviation of wind speed in each hour. Afterward, the available hourly power is calculated based on (17):

$$P_{WT}^t = \begin{cases} 0 & v^t < v_{in}^c \\ P_{WT}^{rated} \times \left(\frac{v^t - v_{in}^c}{v_{in}^{rated} - v_{in}^c} \right) & v_{in}^c \leq v^t < v_{in}^{rated} \\ P_{WT}^{rated} & v_{in}^{rated} \leq v^t < v_{out}^c \\ 0 & v_{out}^c \leq v^t \end{cases} \quad (17)$$

where P_{WT}^t is the available hourly power of WT in MW, v^t is the hourly wind speed in m/s, P_{WT}^{rated} is the nominal power of WT in MW, v_{in}^c , v_{in}^{rated} and v_{out}^c are, respectively, the cut-in, nominal, and cut-out wind speed in m/s.

For calculating the available power of PV units first, the hourly irradiation should be specified [38]. Assuming that the hourly mean value and standard deviation of solar irradiation are known the hourly irradiation is estimated based on (18). Two scenarios are assigned for each irradiation value where the adding state is considered for the first and the subtracting for the second scenario.

$$R^t = \mu_{R^t} \pm \left(\sqrt{\frac{m}{1 - W^0} \times P_{xx}} \right) \quad (18)$$

R^t is the estimated hourly irradiance in w/m^2 , μ_{R^t} is the mean value of hourly irradiance in w/m^2 , m is number of uncertain variables, W^0 is the weighted value related to the scenario where the irradiance in all hours equals to its mean value. P_{xx} is a square matrix the dimension of which is equal to the number of uncertain variables. The elements of the main diagonal equal to the standard deviation of irradiance in each hour. Afterward, the available hourly power of PV system is calculated based on (19):

$$P_{PV}^t = \begin{cases} P_{PV}^{rated} \times \left(\frac{R^t}{R_{STD} \times R_C} \right) & 0 \leq R^t < R_C \\ P_{PV}^{rated} \times \left(\frac{R^t}{R_{STD}} \right) & R_C \leq R^t < R_{STD} \\ P_{PV}^{rated} & R_{STD} \leq R^t \end{cases} \quad (19)$$

where P_{PV}^t is the available hourly power of PV units in MW, R^t is the hourly irradiance in w/m^2 . P_{PV}^{rated} is the nominal power of PV units in MW, R_{STD} represents the irradiance in standard conditions which equals to 1000 W/m^2 . R_C is the constant solar irradiance which equals to 150 w/m^2 [39].

In order to achieve profit and reduce the operational cost, the MMG system exchanges power with the main electricity grid based on the electricity price. For achieving the maximum profit, using the mutual exchange capability the system operator should forecast the accurate electricity price. If the hourly mean value and standard deviation (SD) of market price are known, the hourly electricity price is estimated based on (20) and two scenarios are defined for each hourly value of electricity price:

$$B_{EX}^t = \mu_{B_{EX}^t} \pm \left(\sqrt{\frac{m}{1 - W^0}} \times P_{xx} \right) \quad (20)$$

B_{EX}^t is the estimated hourly electricity price in $\$/\text{MWh}$, $\mu_{B_{EX}^t}$ is the mean value of hourly electricity price in $\$/\text{MWh}$, m is number of uncertain variables, W^0 is the weighted value related to the scenario where the market price in all hours equals to its mean value. P_{xx} is a square matrix the dimension of which is equal to the number of uncertain variables. The elements of the main diagonal equal to the standard deviation of electricity price in each hour.

The operation of battery as the energy storage device in the MMG system has some constraints including the maximum and minimum charging/discharging limits and the maximum and minimum energy stored in the battery:

$$P_{Batt,min} \leq P_{Batt}^t \leq P_{Batt,max} \quad (21)$$

$$BL_{Batt,min} \leq BL_{Batt}^t \leq BL_{Batt,max} \quad (22)$$

$$BL_{Batt}^t = BL_{Batt}^{t-1} - (\eta_{Batt} \times P_{Batt}^t) \text{ if } P_{Batt}^t < 0 \quad (23)$$

$$BL_{Batt}^t = BL_{Batt}^{t-1} - \left(\frac{P_{Batt}^t}{\eta_{Batt}} \right) \text{ if } P_{Batt}^t > 0 \quad (24)$$

P_{Batt}^t is the hourly received or stored power in the battery in MW. Negative P_{Batt}^t represents charging while positive values represent discharging of the battery. $P_{Batt,max}$ is the maximum charging/discharging power in MW in each hour. BL_{Batt}^t is the energy level stored in the battery, $BL_{Batt,min}$ is the lower and $BL_{Batt,max}$ is the upper energy limit in the battery. η_{Batt} is the battery efficiency during charging and discharging.

The operational cost of fossil fuel-based unit is achieved using the following equation:

$$Cost_{DG}^t = \alpha \times (P_{DG}^t)^2 + \beta \times P_{DG}^t + \gamma \quad (25)$$

where $Cost_{DG}^t$ is the hourly operational cost of the fossil fuel-based unit in \$, P_{DG}^t is the hourly output power of the fossil fuel-based unit in MW, α , β , and γ are the cost function coefficients of the fossil fuel-based unit, respectively, in \$/MW², \$/MW, and \$. Moreover, the output power is limited to upper and lower bands:

$$P_{DG, min} \leq P_{DG}^t \leq P_{DG, max} \quad (26)$$

where $P_{DG, min}$ and $P_{DG, max}$ are, respectively, the minimum and maximum generated power of fossil fuel-based unit in MW.

4.2. Load Model

The hourly load demand of the MMG system is also estimated based on UT assuming that the mean value and SD of the load demand in each hour is known. Two scenarios are defined for each value of hourly load demand:

$$P_L^t = \mu_{P_L^t} \pm \left(\sqrt{\frac{m}{1 - W^0} \times P_{xx}} \right) \quad (27)$$

P_L^t is the estimated hourly load demand in MW, $\mu_{P_L^t}$ is the mean value of hourly load demand in MW, m is number of uncertain variables, W^0 is the weighted value related to the scenario where the load demand in all hours equals to its mean value. P_{xx} is a square matrix the dimension of which is equal to the number of uncertain variables. The elements of the main diagonal equal to the standard deviation of load demand in each hour.

5. Application of the Suggested Multi-Objective JAYA Algorithm (MJAYA)

The major advantage of JAYA over other meta-heuristic algorithms is its independency to algorithmic parameters. Moreover, JAYA algorithm is simpler and faster in dealing with optimization problems comparing to other meta-heuristic algorithms [32–34,40]. Consequently, in this paper MJAYA algorithm is applied to solve the stochastic bi-objective optimal power management of MMG systems. As is mentioned in Section 2, the objectives are minimization of the total operational cost (maximization of profit) and minimization of the environmental pollutant. In the following, a brief overview of the main JAYA algorithm is presented. Afterwards, the flowchart of the UT-MJAYA algorithm is shown.

Assuming $f(x)$ as the objective function that is minimized, where \vec{X} is the vector of design variables of x and $d = 1, 2, \dots, D$ is the counter of design variables where D is the number of design variables. The counter of solutions in the population is presented by $i = 1, 2, \dots, N$ where N is the number of solutions or the size of population. The counter of iterations in the algorithm procedure is defined by $iter = 1, 2, \dots, iter_{max}$ where $iter_{max}$ shows the maximum number of iterations. The best solution and the worst solution in the $iter^{th}$ iteration are updated based on the following:

$$X'_{i,j,iter} = X_{i,j,iter} + r_{1,iter}(X_{i,best,iter} - X_{i,j,iter}) - r_{2,iter}(X_{i,worst,iter} - X_{i,j,iter}) \quad (28)$$

where $X_{i,best,iter}$ is the i^{th} variable in best solutions, and $X_{i,worst,iter}$ is the i^{th} variable in worst solutions in $iter^{th}$ iteration. $X'_{i,j,iter}$ is the modified version of $X_{i,j,iter}$ while $r_{1,iter}$ and $r_{2,iter}$ are two random values in range $[0, 1]$. The trend of a solution to approach to the best solution and to get far from the worst solution are, respectively, expressed by $r_{1,iter}(X_{i,best,iter} - X_{i,j,iter})$ and $r_{2,iter}(X_{i,worst,iter} - X_{i,j,iter})$. If $X'_{i,j,iter}$ results in a better objective function value than that of $X_{i,j,iter}$, it will be accepted. Based on the values of objective functions, at the end of each iteration, best solutions are maintained and will be considered as the population for the next iteration. The best and worst solutions are determined in the recent maintained population for the next iteration. The process will pursue until the termination criterion is fulfilled [32–34].

Since the bi-objective optimal energy management of MMG system is studied in this paper the multi-objective JAYA (MJAYA) algorithm is applied to solve this optimization problem [41,42]. To solve the problem of stochastic optimal power management of MMG system considering economic and environmental indices, UT-MJAYA algorithm is applied. The flowchart of the implemented algorithm is illustrated in Figure 3.

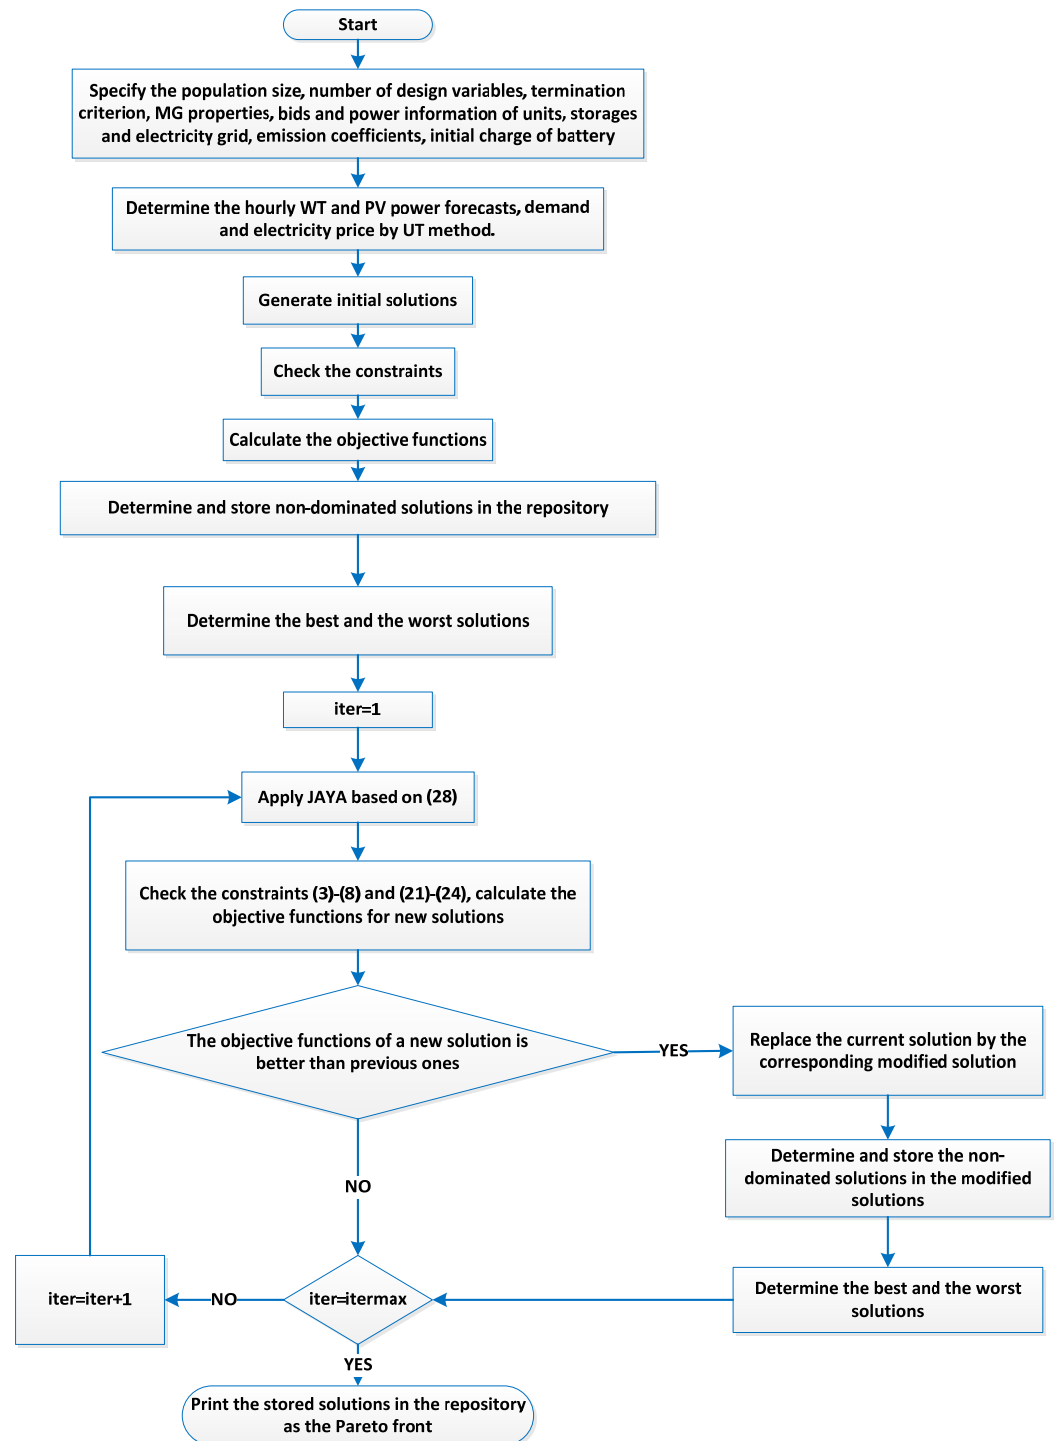


Figure 3. Flowchart of the proposed UT-MJAYA algorithm.

6. Simulation Results

In this section, the simulation results of the suggested approach for solving the problem of optimal power management of the studied MMG system are presented. First, the single objective problem is solved to minimize the operational cost of the MMG system. Afterwards, the minimization of emission is considered as the objective function. In the next section, the two objective functions of minimization of the total cost and the emission are considered simultaneously to solve the multi-objective optimal power management of MMG by implementing the suggested approach. Moreover, the results of deterministic and stochastic optimal power management of MMG components are compared.

The MMG system consists of four MGs each includes one fossil fuel-based unit, two RES-based units, ES, and local load. RES unit in MG1 and MG3 are PV unit, while in MG2 and MG4 WT is considered as the RES-based unit. Each MG can share power with the main electricity grid based on the electricity price. Moreover, power sharing up to 1 MW between MG1 and MG2 as well as MG3 and MG4 is considered.

In this paper, we assumed that the main electricity grid is not renewable-based, which leads to the high amount of emission from the electricity grid.

Considering the population size and the number of maximum iterations in the proposed MJAYA algorithm equal to 50 and 200, respectively, the problem is solved in MATLAB (MathWorks corporate, Natick, MA, USA) environment.

The parameters related to the diesel generators are listed in Table 1. In Table 2, the batteries' parameters are shown assuming that the initial charge of batteries is $E_{int,Batt} = 0.375$ MWh. Parameters related to PV and WT are tabulated in Tables 3 and 4, respectively. The range of the maximum exchangeable power of each MG is listed in Table 5. The emission coefficient of each unit is observed in Table 6 [43].

Table 1. Parameters of diesel generator units.

MG	$P_{DG,Min}$ (MW)	$P_{DG,Max}$ (MW)	α (\$/MWh ²)	B (\$/MWh)	γ (\$)
1, 2	0	1.285	0.0345	44.5	26.5
3, 4	0	2.47	0.0435	56	12.5

Table 2. Parameters of ES.

MG	$P_{Batt,Min}$ (MW)	$P_{Batt,Max}^n$ (MW)	$BL_{Batt,Min}$ (MWh)	$BL_{Batt,Max}$ (MWh)	$E_{int,Batt}$ (MWh)	η_{Batt}
1, 2, 3, 4	−0.4	0.4	0.240	1.2	0.375	0.75

Table 3. Parameters of PV units.

MG	P_{PV}^{rated} (MW)	R_c (W/m ²)	R_{std} (W/m ²)
1, 3	0.3	150	1000

Table 4. Parameters of WT units.

Plant	P_{WT}^{rated} (MW)	v_{in}^C (m/s)	v_{rated} (m/s)	v_{out}^C (m/s)
2, 4	0.45	3.5	13.5	25

Table 5. Exchanged power with the electricity grid.

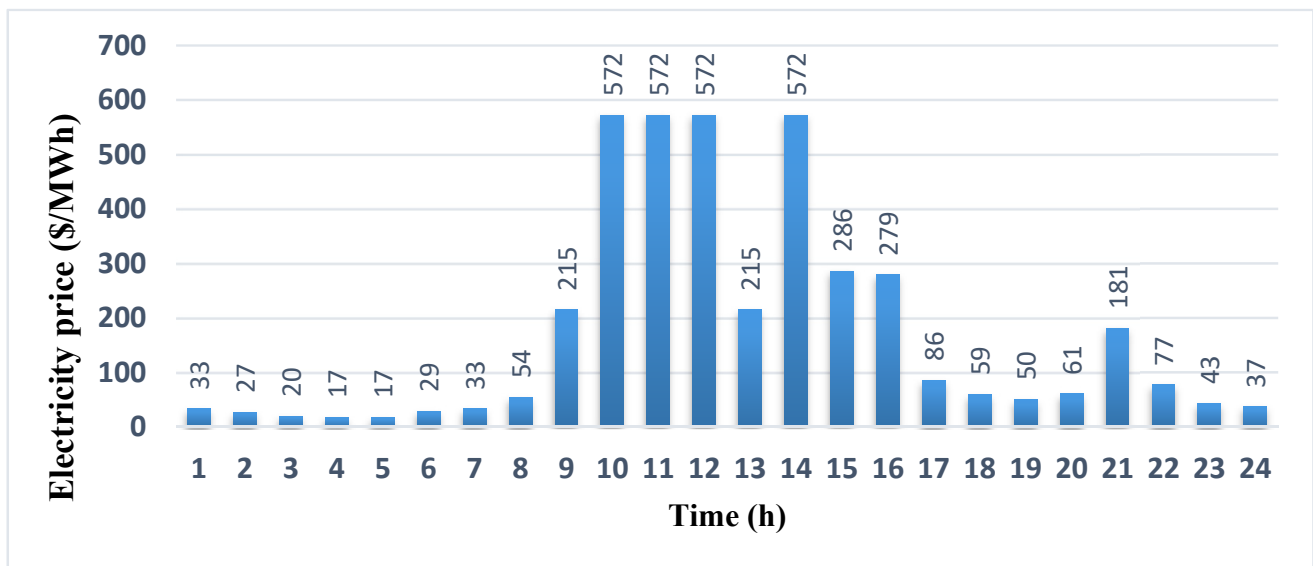
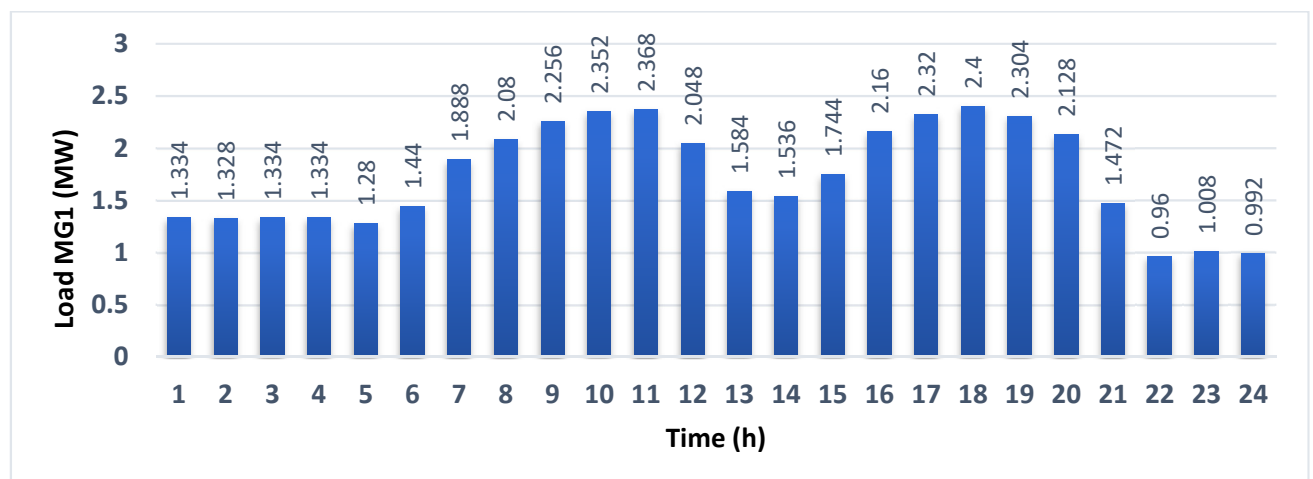
MG1 $P_{EX,Max}^1$ (MW)	MG2 $P_{EX,Max}^2$ (MW)	MG3 $P_{EX,Max}^3$ (MW)	MG4 $P_{EX,Max}^4$ (MW)
2.5	3.5	4	7

Table 6. Emission coefficients.

E_{DG} (Kg/MWh)	E_{Grid} (Kg/MWh)
725	927

Figures 4–10, respectively, represent the forecasted values of electricity price, load demand, output power of PV, and WT units in the 24-h day-ahead [43].

In the deterministic analysis, it is assumed that the values of wind speed, solar irradiance, load demand, and electricity price are equal to their forecasted values without any uncertainties. However, in the stochastic analysis, the MMG system parameters are assumed similar to the deterministic analysis while the wind speed, solar irradiance, load demand, and electricity price are considered as uncertain variables and follow the normal distribution function. The mean values for the normal distribution function of these variables are considered equal to the forecasted values of these parameters and their SDs are considered 5% of their mean values. The stochastic optimal operation of MMG system is solved by applying the suggested UT-MJAYA approach in single and multi-objective frame works considering the uncertainties of WT, PV, electricity price, and load demand.

**Figure 4.** The forecasted day ahead electricity price.**Figure 5.** The forecasted load demand in MG1.

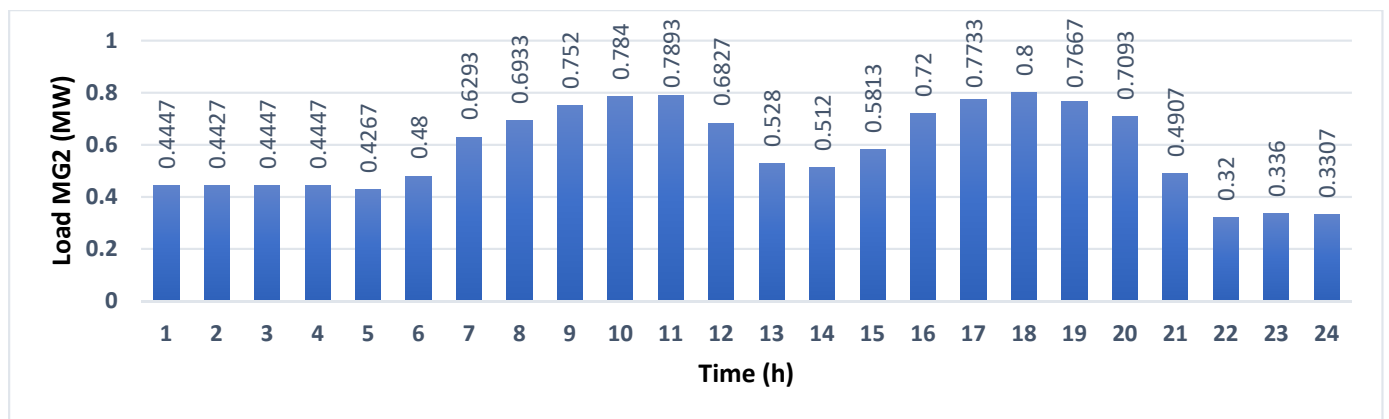


Figure 6. The forecasted load demand in MG2.

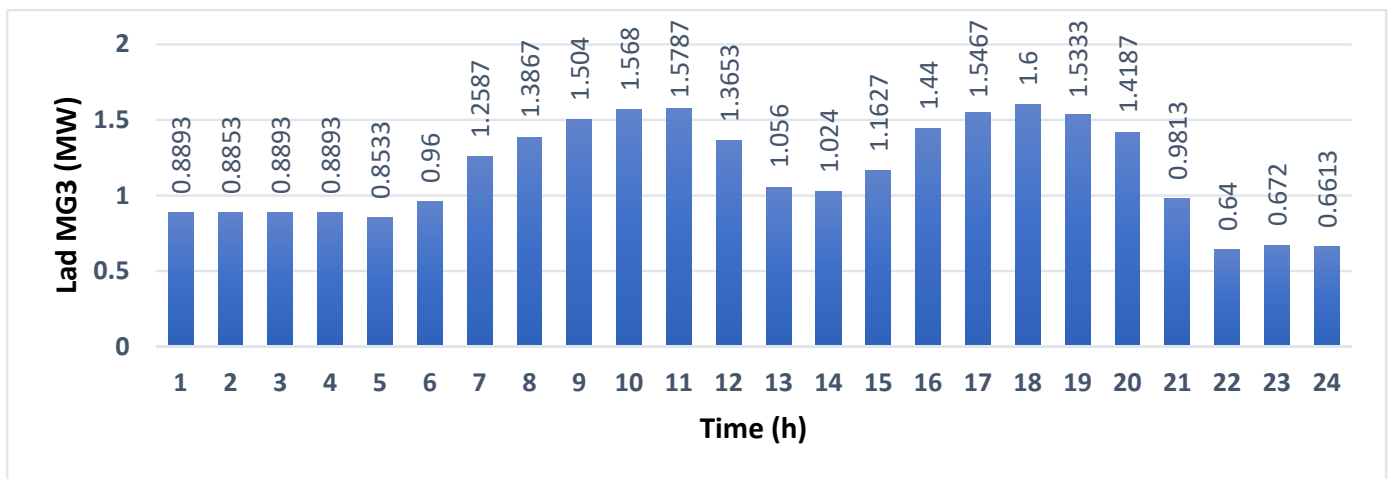


Figure 7. The forecasted load demand in MG3.

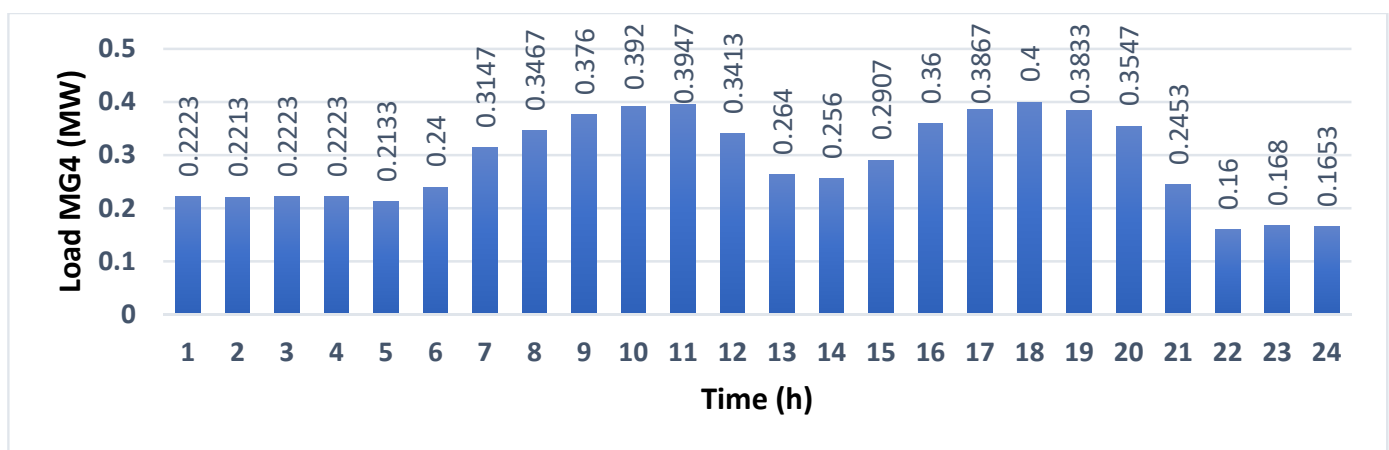


Figure 8. The forecasted load demand in MG4.

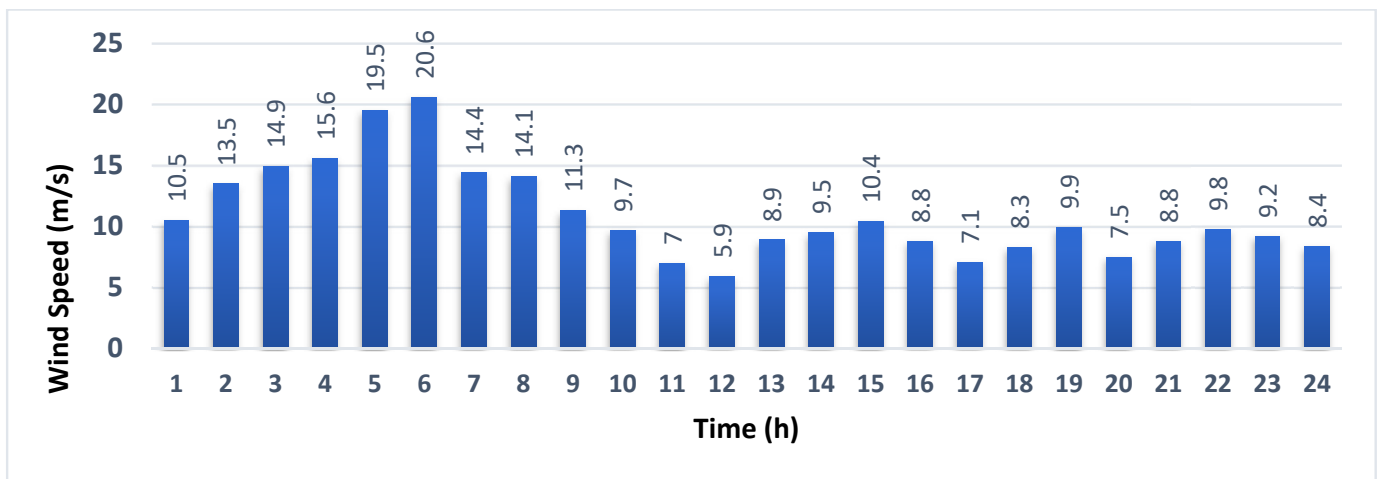


Figure 9. The day ahead forecasted wind speed.

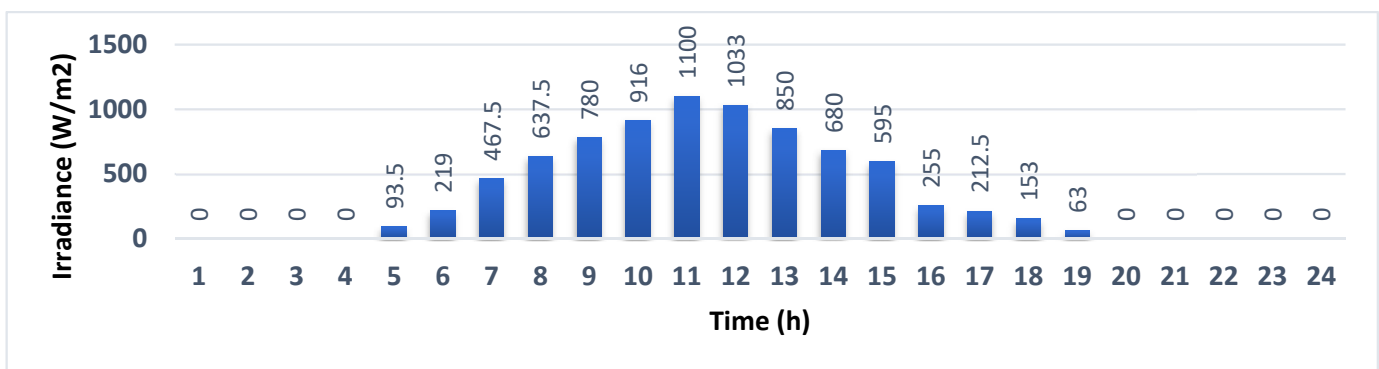


Figure 10. The day ahead forecasted solar irradiance.

6.1. Minimizing the Operational Cost

This section is devoted to investigating the results of solving the optimal operation of MMG while considering the economic index as the only objective function. The values of the achieved profit and the expected profit of each MG are shown in Table 7. From Table 7, it can be concluded that the MMG operator should pay a cost for operation of MG1 while it can gain profit from MG2, MG3, and MG4. The total achieved profit is more than the total operational cost. Since the load demand of MG1 is more than that of other MGs and since the generation capacity of diesel unit in MG1 is less than other MGs and MG1 has less maximum exchangeable power with the electricity grid the operation of MG1 leads to paying a cost. MG2 has lower load than MG1 and higher exchangeable power with the electricity grid, consequently the operation of MG2 leads to profit. The diesel generator capacity in MG3 is more than MG2 and MG1; and MG3 has a higher maximum exchangeable power with the electricity grid, therefore the operation of MG3 leads to a higher profit than MG2. MG4 has a lower load demand and higher maximum exchangeable power with the electricity grid than other MGs, therefore, the achieved profit in operation of MG4 is the highest.

According to Table 7, the achieved profit is decreased 6% when the uncertainties are considered. When considering uncertainties, the demanded load in every MGs, the available power of renewable-based units and the electricity price will change, consequently, in comparison with the situation that these variables are considered constant the operational cost as well as the achieved profit will change. If the load demand, the available power of renewable-based units and the electricity price decrease the operational profit will also decrease and vice-versa. According to Table 7, when the uncertainties are considered the

profit of operation of MG1 and MG3 decrease while the operational profit of MG2 and MG4 increase.

Table 7. The values of the achieved profit of all MGs and the total profit of the system in both deterministic and probabilistic analysis.

	MG1	MG2	MG3	MG4	Multi MG System	Run Time (s)
Expected Profit (\$)	−3631	1985	2232	7425	8011	262
Profit (\$)	−2422	947	3625	6382	8559	1902

Figures 11 and 12, respectively, present the deterministic and stochastic accumulated optimal operation of different elements of MMG system in different hours of a day for while considering economic index as the objective function.

In Figures 11 and 12, load and any units, which is a consumer, are shown with negative power values in each hour while the producers have positive power values. Since the diesel generators are always power producers the related values are positive. ES units can play the role of both power producer and consumer. During the charging hours, ES units are considered as consumer with negative values while during discharging hours they are considered as power producer with positive values. Furthermore, negative values related to the exchanged power with the electricity grid reveal selling power to the electricity grid while positive values present purchasing power from the grid and power sharing is from the electricity grid to the MMG system.

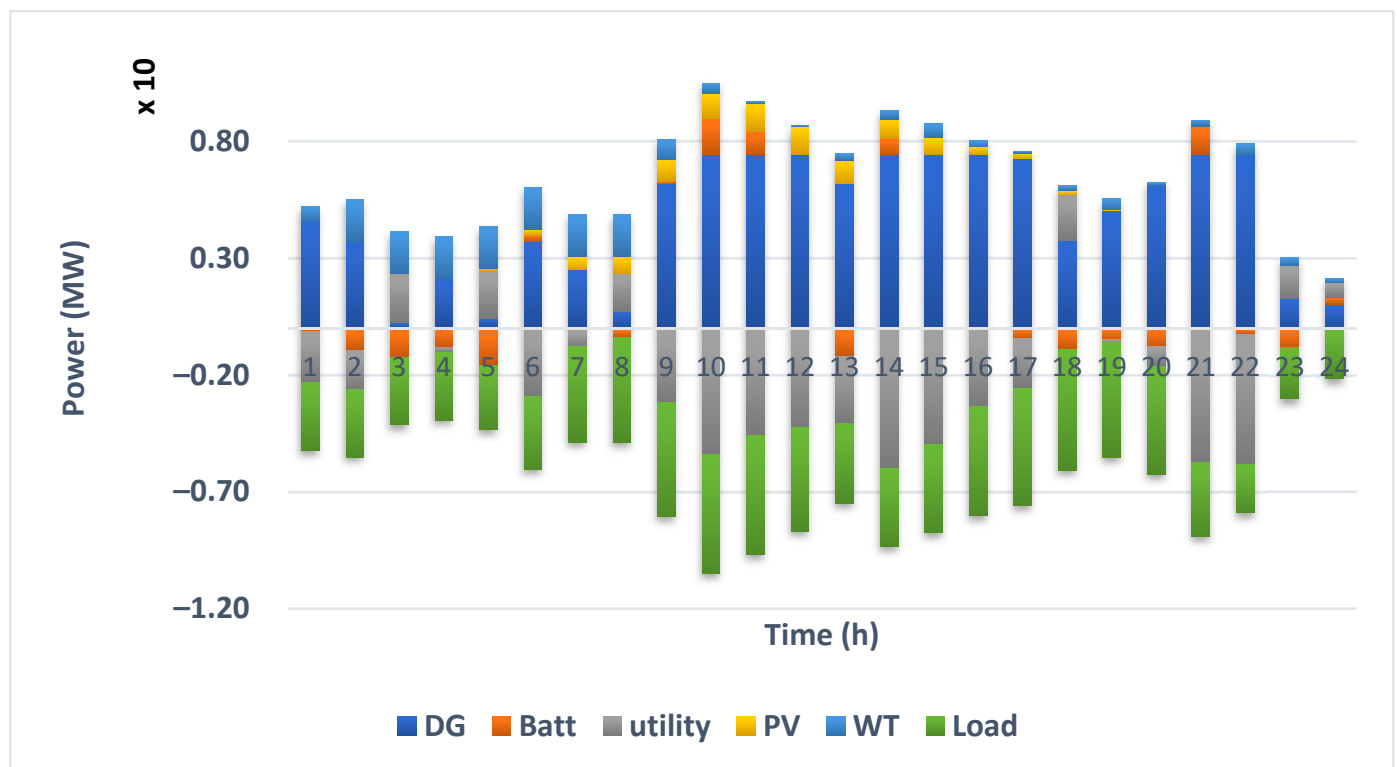


Figure 11. Accumulated optimal operation of MMG elements for minimizing the cost (maximizing the profit) in deterministic conditions.

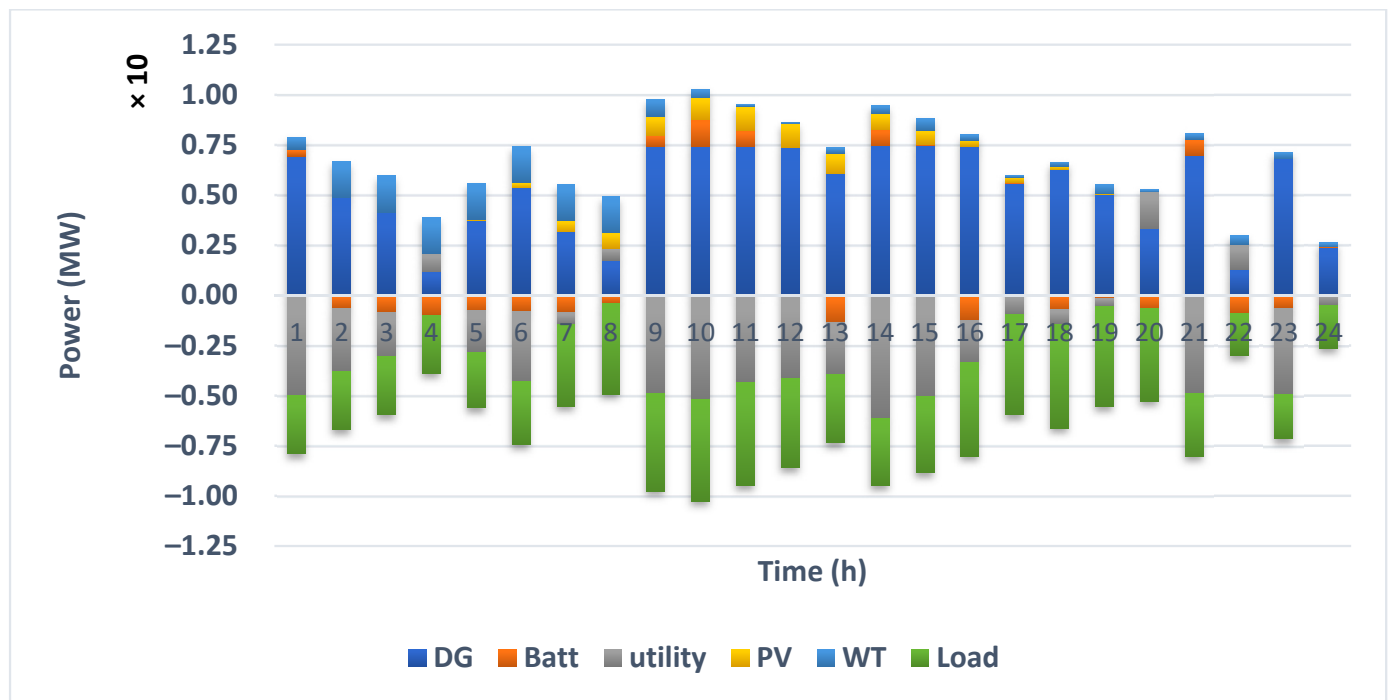


Figure 12. Accumulated optimal operation of MMG elements for minimizing the cost (maximizing the profit) in probabilistic conditions.

By comparing Figures 11 and 12, it is observed that in deterministic operation of MMG system in the 3rd, 5th, 18th, 20th, 23rd, and 24th the power is purchased from the electricity grid while in the stochastic operation of MMG the power is sold to the electricity grid in these mentioned hours. Accordingly, when considering uncertainties in the variables, the operation of units is different from the deterministic operation. Consequently, to prevent economic loss, the impact of uncertainties should be considered in the optimal power management of MMG system to have a proper vision in the variables' changes on the operation of the system.

6.2. Minimizing Emission

In this section, the results of optimal power management of MMG system are shown while considering the environmental index. The values of the emission of all the MGs and the total emission of the system in both deterministic and probabilistic analysis as well as the execution time are observed in Table 8.

Table 8. The values of the emission of all MGs and the total emission of the system in both deterministic and probabilistic analysis.

	MG1	MG2	MG3	MG4	Multi MG System	Run Time (s)
Expected Emission (kg)	21,822	13,939	17,708	7816	61,285	262
Emission (kg)	26,555	10,515	18,244	4725	60,039	1715

According to Table 8, the operation of MMG leads to 60 tons of emission. Since the emission coefficient of diesel generators is less than that of the electricity grid, it is observed that when the objective is minimizing emission, more power is received from diesel generators to satisfy the load and, consequently, the emission from these units is more than the emission of the electricity grid.

Since the load demand of MG1 is more than other MGs, MG1 has the highest sharing in producing emission in the system. MG2 has lower demanded load than MG1 and lower sharing of emission production. MG3 has lower load demand than MG1 and, consequently, the resulted emission is less than MG1. While the demanded load of operation of MG3 comparing to MG2 is higher which leads to more emission production than MG2. MG4 has the lowest load demand profile and, consequently, the lowest sharing in emission production.

According to Table 8, considering uncertainties in the problem leads to a 2% increase in the value of emission. In probabilistic analysis, the expected emission in MG1 and MG3 decreases while it increases in MG2 and MG4. Since the produced emission depends on the load and the available renewable energy, the decrease of emission in MG1 and MG3 is due to the reduction of load demand or the increase of available solar energy when considering uncertainty in the variables. Furthermore, the increase of emission in MG2 and MG4 is the result of the increase of load demand or the decrease of available wind.

Figures 13 and 14 show, respectively, the deterministic and probabilistic accumulated optimal operation of each unit to minimize the total emission of the system.

By comparing Figures 11 and 12 with Figures 13 and 14, it is obvious that when the objective is changed from maximizing the profit into minimizing the emission the management of units changed significantly. Since in order to maximize the profit the MMG system shares more power with the electricity grid, when the objective is to minimize the emission less power can be exchanged with the electricity grid since the emission coefficient of the electricity grid has a high value. It should be mentioned that, when the power is sold to the electricity grid no emission is produced, and the emission coefficient of the electricity grid equals to zero during these hours.

According to the results, in the single objective problem in order to reduce emission since the power supplying from the electricity grid results in high emission the aim is to supply the load through the generation units in the MGs in all hours. However, during the hours that the amount of load is higher than the total produced power of the generation units of the MGs in the MMG the operator should purchase power from the electricity grid to satisfy the load of each MG.

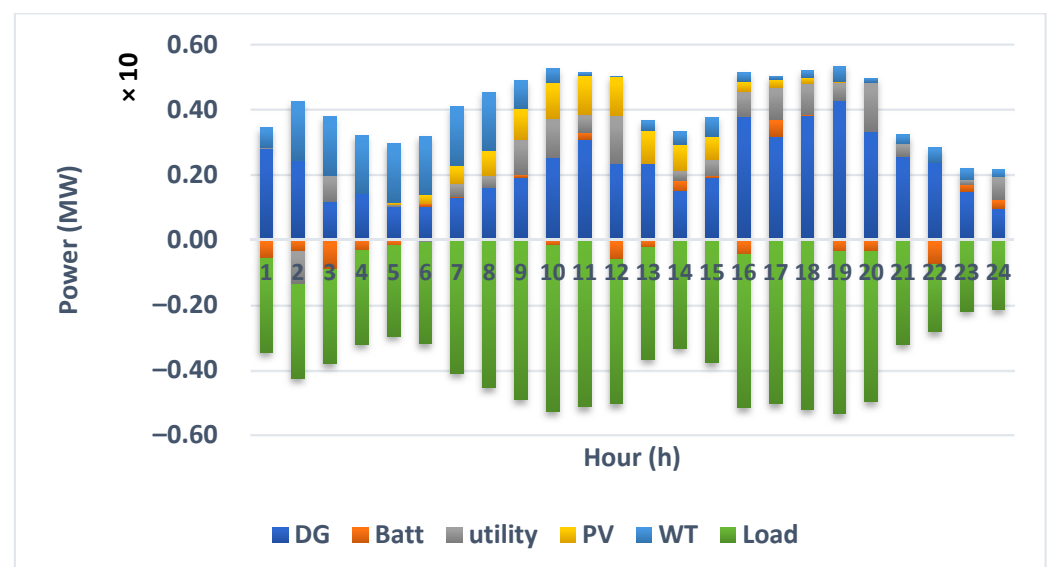


Figure 13. Accumulated optimal operation of MMG elements for minimizing emission in deterministic conditions.



Figure 14. Accumulated optimal operation of MMG elements for minimizing emission in probabilistic conditions.

By comparing Figure 13 with Figure 14, it is observed that planning of diesel generators, ES and power sharing with the electricity grid in deterministic and probabilistic analysis of the MMG system are not the same. In deterministic analysis, the total output power of diesel generators is half of the probabilistic analysis. Moreover, in hours 7th and 11th, the ES is discharged in deterministic analysis while in probabilistic analysis the battery is charged during these hours. In deterministic analysis, from 3rd to 6th hour and in 8th hour the power is purchased from the electricity grid while in the probabilistic analysis the power is sold to the grid during these hours.

6.3. Multi-Objective Optimal Operation of MMG

As it is shown in the single objective analysis section, the two objective functions (minimizing the cost and emission) conflict each other and consequently the problem can be solved as a multi-objective problem. When considering the problem as multi-objective, based on the dominance and Pareto optimal concept, there exists a set of solutions with different values for objective functions instead of one single solution (Figure 15). According to Figure 15, the MMG operator decides to choose one of the solutions in the set of solutions with different economic/ environmental indices based on the priority of the indices.

In Figure 15, the Pareto optimal fronts of both probabilistic and deterministic optimal operation of MMG system are shown. It is observed that when the uncertainties are considered in the parameters, the obtained operational cost in the solutions of Pareto front decrease significantly. It can be concluded that, the influence of uncertainties on the costs of MMG system is higher comparing to their influence on the emission.

According to Figure 15, when investigating the probabilistic problem, the maximum achievable profit decreases by 23% while the minimum emission level increases 22%. Consequently, when considering the effect of uncertainties on the optimal power management of MMG system the operational cost will increase 23% and the emission increases 22%.

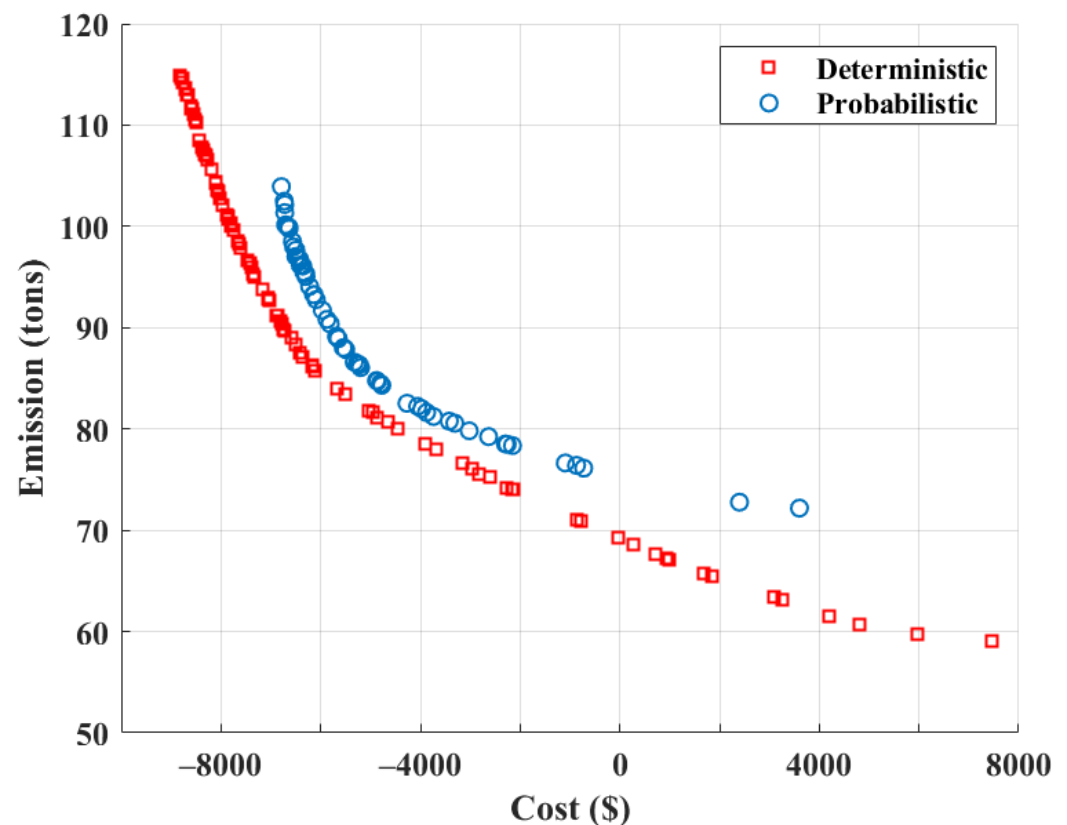


Figure 15. Comparison of Pareto optimal fronts of environmental–economic optimal power management of MMG system in deterministic and probabilistic scenarios.

7. Conclusions

In this paper, the problem of optimal power management of MMG systems by considering a sample MMG for two deterministic and probabilistic analyzes in single-objective and bi-objective scenarios is investigated. In the case of deterministic analysis, it is assumed that the predicted values for wind speed and solar irradiation, the load demand and the electricity price are not uncertain, and the best solution obtained in each case is obtained using the JAYA algorithm. In order to consider the effect of uncertainties on the power management of the considered MMG system, the UT method is used. The best solution in each case is presented using the proposed UT-MJAYA approach. Comparing the obtained values, it is observed that when considering the uncertainties, the value obtained in each case for probabilistic analysis is different from the deterministic analysis. The maximum amount of profit that can be obtained by the MMG, taking into account the uncertainties, is about 23% less than in the case where uncertainties are not taken into account. Moreover, in the probabilistic analysis, the minimum emission increases 22%. Given this issue, it is observed that the effect of considering uncertainty on the economic index is very significant. Therefore, to provide a more accurate and realistic solution and to achieve a planning that is economically and environmentally optimal, it is necessary to carefully address the uncertainties in the problem. Also, according to the problem formulation and the simulation results, it is concluded that the effect of changes in the amount of battery efficiency, energy price, fossil fuel-based unit capacity, the maximum exchangeable power between the MMG system and the electricity grid, the exchange between adjacent MGs in the MMG system and the price of electricity is very significant on the economic index, and, in the case of using more efficient batteries, the use of more suitable distributed generation resources, the operation of the MMG system can be more profitable. Also, the effect of changing the amount of load demand on both economic and environmental indices is very significant. Furthermore, it is observed that changing the capacity of renewable-based units (WT

and PV) on the environmental index is significant and the effect of changing the capacity of PV units on the minimum amount of pollutant production is more noticeable. Future work can focus on solving the stochastic power management of MMG systems while considering reliability and risk management indices. Presenting an efficient approach for real-time optimal power flow of MMG systems while considering network constraints can also be considered for future studies.

Author Contributions: Conceptualization, M.J. and H.P.A.; methodology, M.J., H.P.A. and T.K.; software, M.J. and H.P.A.; validation, M.J., H.P.A. and T.K.; formal analysis, M.J.; investigation, M.J.; writing—original draft preparation, M.J.; writing—review and editing, T.K., D.S. and J.M.G.; supervision, T.K., D.S. and J.M.G. All authors have read and agreed to the published version of the manuscript.

Funding: This research was funded by the European Union’s Horizon 2020 research and innovation programme under the Marie Skłodowska-Curie grant agreement No 812991. J. M. Guerrero was supported by VILLUM FONDEN under the VILLUM Investigator Grant (no. 25920): Center for Research on Microgrids (CROM).

Institutional Review Board Statement: Not applicable.

Informed Consent Statement: Not applicable.

Data Availability Statement: Not applicable.

Conflicts of Interest: The authors declare no conflict of interest.

References

- Javidsharifi, M.; Niknam, T.; Aghaei, J.; Mokryani, G.; Papadopoulos, P. Multi-objective day-ahead scheduling of microgrids using modified grey wolf optimizer algorithm. *J. Intell. Fuzzy Syst.* **2019**, *36*, 2857–2870. [\[CrossRef\]](#)
- Javidsharifi, M.; Niknam, T.; Aghaei, J.; Mokryani, G. Multi-objective short-term scheduling of a renewable-based microgrid in the presence of tidal resources and storage devices. *Appl. Energy* **2018**, *216*, 367–381. [\[CrossRef\]](#)
- Ahmadi, S.E.; Rezaei, N. A new isolated renewable based multi microgrid optimal energy management system considering uncertainty and demand response. *Int. J. Electr. Power Energy Syst.* **2020**, *118*, 105760. [\[CrossRef\]](#)
- Sefidgar-Dezfouli, A.; Joorabian, M.; Mashhour, E. A multiple chance-constrained model for optimal scheduling of microgrids considering normal and emergency operation. *Int. J. Electr. Power Energy Syst.* **2019**, *112*, 370–380. [\[CrossRef\]](#)
- Park, S.H.; Hussain, A.; Kim, H.M. Impact analysis of survivability-oriented demand response on islanded operation of networked microgrids with high penetration of renewables. *Energies* **2019**, *12*, 452. [\[CrossRef\]](#)
- Pakdel, M.J.V.; Sohrabi, F.; Mohammadi-Ivatloo, B. Multi-objective optimization of energy and water management in networked hubs considering transactive energy. *J. Clean. Prod.* **2020**, *266*, 121936. [\[CrossRef\]](#)
- Xing, X.; Xie, L.; Meng, H. Cooperative energy management optimization based on distributed MPC in grid-connected microgrids community. *Int. J. Electr. Power Energy Syst.* **2019**, *107*, 186–199. [\[CrossRef\]](#)
- Jani, A.; Karimi, H.; Jadid, S. Hybrid energy management for islanded networked microgrids considering battery energy storage and wasted energy. *J. Energy Storage* **2021**, *40*, 102700. [\[CrossRef\]](#)
- Karimi, H.; Jadid, S. Optimal energy management for multimicrogrid considering demand response programs: A stochastic multiobjective framework. *Energy* **2020**, *195*, 116992. [\[CrossRef\]](#)
- Bahmani, R.; Karimi, H.; Jadid, S. Cooperative energy management of multi-energy hub systems considering demand response programs and ice storage. *Int. J. Electr. Power Energy Syst.* **2021**, *130*, 106904. [\[CrossRef\]](#)
- Khavari, F.; Badri, A.; Zangeneh, A. Energy management in multimicrogrids considering point of common coupling constraint. *Int. J. Electr. Power Energy Syst.* **2020**, *115*, 105465. [\[CrossRef\]](#)
- Tan, M.; Zhou, Y.; Wang, L.; Su, Y.; Duan, B.; Wang, R. Fair-efficient energy trading for microgrid cluster in an active distribution network. *Sustain. Energy Grids Netw.* **2021**, *26*, 100453. [\[CrossRef\]](#)
- Karimi, H.; Jadid, S. Two-stage economic, reliability, and environmental scheduling of multi-microgrid systems and fair cost allocation. *Sustain. Energy Grids Netw.* **2021**, *28*, 100546. [\[CrossRef\]](#)
- Karimi, H.; Jadid, S. A strategy-based coalition formation model for hybrid wind/PV/FC/MT/DG/battery multi-microgrid systems considering demand response programs. *Int. J. Electr. Power Energy Syst.* **2022**, *136*, 107642. [\[CrossRef\]](#)
- Karimi, H.; Jadid, S.; Makui, A. Stochastic energy scheduling of multi-microgrid systems considering independence performance index and energy storage systems. *J. Energy Storage* **2021**, *33*, 102083. [\[CrossRef\]](#)
- Han, D.; Lee, J.H. Two-stage stochastic programming formulation for optimal design and operation of multi-microgrid system using data-based modeling of renewable energy sources. *Appl. Energy* **2021**, *291*, 116830. [\[CrossRef\]](#)
- Qu, Z.; Chen, J.; Peng, K.; Zhao, Y.; Rong, Z.; Zhang, M. Enhancing stochastic multimicrogrid operational flexibility with mobile energy storage system and power transaction. *Sustain. Cities Soc.* **2021**, *71*, 102962. [\[CrossRef\]](#)

18. Tan, B.; Chen, H. Multi-objective energy management of multiple microgrids under random electric vehicle charging. *Energy* **2020**, *208*, 118360. [\[CrossRef\]](#)
19. Zargar, R.H.M.; Yaghmaee, M.H. Energy exchange cooperative model in SDNbased interconnected multi-microgrids. *Sustain. Energy Grids Netw.* **2021**, *27*, 100491. [\[CrossRef\]](#)
20. Aghdam, F.H.; Kalantari, N.T.; Mohammadi-Ivatloo, B. A stochastic optimal scheduling of multi-microgrid systems considering emissions: A chance constrained model. *J. Clean. Prod.* **2020**, *275*, 122965. [\[CrossRef\]](#)
21. Rezaei, N.; Pezhmani, Y.; Khazali, A. Economic-environmental risk-averse optimal heat and power energy management of a grid-connected multi microgrid system considering demand response and bidding strategy. *Energy* **2022**, *240*, 122844. [\[CrossRef\]](#)
22. Mansour-Saatloo, A.; Pezhmani, Y.; Mirzaei, M.A.; Mohammadi-Ivatloo, B.; Zare, K.; Marzband, M.; Anvari-Moghaddam, A. Robust decentralized optimization of multi-microgrids integrated with power-to-X technologies. *Appl. Energy* **2021**, *304*, 117635. [\[CrossRef\]](#)
23. Sadeghi Sarcheshmeh, M.; Taher, S.A.; Mazidi, M. A stochastic frequency security constrained optimization model for day-ahead energy and reserve scheduling of islanded multi-microgrids systems. *Int. Trans. Electr. Energy Syst.* **2020**, *30*, e12386. [\[CrossRef\]](#)
24. Afrakhte, H.; Bayat, P. A contingency based energy management strategy for multimicrogrids considering battery energy storage systems and electric vehicles. *J. Energy Storage* **2020**, *27*, 101087. [\[CrossRef\]](#)
25. Rezaei, N.; Pezhmani, Y. Optimal islanding operation of hydrogen integrated multi-microgrids considering uncertainty and unexpected outages. *J. Energy Storage* **2022**, *49*, 104142. [\[CrossRef\]](#)
26. Liu, Y.; Wang, Y.; Li, Y.; Gooi, H.B.; Xin, H. Multi-agent based optimal scheduling and trading for multi-microgrids integrated with urban transportation networks. *IEEE Trans. Power Syst.* **2020**, *36*, 2197–2210. [\[CrossRef\]](#)
27. Li, X.; Ma, S. Multi-objective memetic search algorithm for multi-objective permutation flow shop scheduling problem. *IEEE Access* **2016**, *4*, 2154–2165. [\[CrossRef\]](#)
28. Song, B.; Wang, Z.; Zou, L. An improved PSO algorithm for smooth path planning of mobile robots using continuous high-degree Bezier curve. *Appl. Soft Comput.* **2021**, *100*, 106960. [\[CrossRef\]](#)
29. Nasrollahzadeh, S.; Maadani, M.; Pourmina, M.A. Optimal motion sensor placement in smart homes and intelligent environments using a hybrid WOA-PSO algorithm. *J. Reliab. Intell. Environ.* **2021**, *1*, 1–13. [\[CrossRef\]](#)
30. Virgili, M.; Forysth, A.J.; James, P. A Multi-Objective Genetic Algorithm Methodology for the Design of Standalone Energy Systems. In Proceedings of the 2021 IEEE Design Methodologies Conference (DMC), Bath, UK, 14–15 July 2021; pp. 1–6.
31. Bayat, P.; Afrakhte, H. A purpose-oriented shuffled complex evolution optimization algorithm for energy management of multi-microgrid systems considering outage duration uncertainty. *J. Intell. Fuzzy Syst.* **2020**, *38*, 2021–2038. [\[CrossRef\]](#)
32. Rao, R. Jaya: A simple and new optimization algorithm for solving constrained and unconstrained optimization problems. *Int. J. Ind. Eng. Comput.* **2016**, *7*, 19–34.
33. Javidsharifi, M.; Pourroshanfekr, H.; Kerekes, T.; Sera, D.; Spataru, S.; Guerrero, J.M. Optimum Sizing of Photovoltaic and Energy Storage Systems for Powering Green Base Stations in Cellular Networks. *Energies* **2021**, *14*, 1895. [\[CrossRef\]](#)
34. Ahmadi, S.; Arabani, H.P.; Haghighi, D.A.; Guerrero, J.M.; Ashgevari, Y.; Akbarimajd, A. Optimal use of vehicle-to-grid technology to modify the load profile of the distribution system. *J. Energy Storage* **2020**, *31*, 101627. [\[CrossRef\]](#)
35. Javidsharifi, M.; Pourroshanfekr Arabani, H.; Kerekes, T.; Sera, D.; Spataru, S.; Guerrero, J.M. Effect of Battery Degradation on the Probabilistic Optimal Operation of Renewable-Based Microgrids. *Electricity* **2022**, *3*, 53–74. [\[CrossRef\]](#)
36. Aien, M.; Fotuhi-Firuzabad, M.; Aminifar, F. Probabilistic load flow in correlated uncertain environment using unscented transformation. *IEEE Trans. Power Syst.* **2012**, *27*, 2233–2241. [\[CrossRef\]](#)
37. Javidsharifi, M.; Niknam, T.; Aghaei, J.; Shafie-khah, M.; Catalão, J.P. Probabilistic model for microgrids optimal energy management considering AC network constraints. *IEEE Syst. J.* **2019**, *14*, 2703–2712. [\[CrossRef\]](#)
38. Javidsharifi, M.; Pourroshanfekr Arabani, H.; Kerekes, T.; Sera, D.; Spataru, S.V.; Guerrero, J.M. Optimum sizing of photovoltaic-battery power supply for drone-based cellular networks. *Drones* **2021**, *5*, 138. [\[CrossRef\]](#)
39. Rokrok, E.; Javidsharifi, M.; Pourroshanfekr, H.; Javidsharifi, B. Adaptive Nonlinear Control Scheme for Three-Phase Grid-Connected PV Central Inverters. In Proceedings of the 29th International Power System Conference (PSC), Terhan, Iran, 27 October 2014; pp. 1–7.
40. Pourroshanfekr, H.; Javidsharifi, M.; Javidsharifi, B. Solving Non-convex Economic Dispatch with Valve Point Loading Effect using Imperialist Competitive Algorithm. *Majlesi J. Energy Manag.* **2015**, *4*, 41–45.
41. Narimani, M.R.; Vahed, A.A.; Azizipanah-Abarghooee, R.; Javidsharifi, M. Enhanced gravitational search algorithm for multi-objective distribution feeder reconfiguration considering reliability, loss and operational cost. *IET Gener. Transm. Distrib.* **2014**, *8*, 55–69. [\[CrossRef\]](#)
42. Mahboubi-Moghaddam, E.; Narimani, M.R.; Khooban, M.H.; Azizivahed, A. Multi-objective distribution feeder reconfiguration to improve transient stability, and minimize power loss and operation cost using an enhanced evolutionary algorithm at the presence of distributed generations. *Int. J. Electr. Power Energy Syst.* **2016**, *76*, 35–43. [\[CrossRef\]](#)
43. Hadayeghparsat, S.; Farsangi, A.S.; Shayanfar, H. Day-ahead stochastic multi-objective economic/emission operational scheduling of a large scale virtual power plant. *Energy* **2019**, *172*, 630–646. [\[CrossRef\]](#)