



AALBORG UNIVERSITY
DENMARK

Aalborg Universitet

CLIMA 2016 - proceedings of the 12th REHVA World Congress

volume 1

Heiselberg, Per Kvols

Publication date:
2016

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):
Heiselberg, P. K. (Ed.) (2016). *CLIMA 2016 - proceedings of the 12th REHVA World Congress: volume 1*.
Department of Civil Engineering, Aalborg University.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- ? Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- ? You may not further distribute the material or use it for any profit-making activity or commercial gain
- ? You may freely distribute the URL identifying the publication in the public portal ?

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Renovation of a single family house in a social housing garden city in Brussels: Indoor climate and post-occupancy monitoring

Peter Foldbjerg^{#1}, Sabine Pauquay^{*2} and Jeroen Geuens^{*3}

First Author^{#1}, Second Author^{*2}, Third Author^{#3}

[#] VELUX A/S, Department of Daylight, Energy and Indoor Climate, Hørsholm, Denmark

¹ peter.foldbjerg@velux.com

^{*} VELUX Belgium, Wavre, Belgium

² sabine.pauquay@velux.com

³ jeroen.geuens@velux.com

Abstract

RenovActive is a renovation project in Brussels based on the concept of Climate Renovation that implies achieving an excellent indoor climate as well as energy performance. The house is part of a social housing association, and is renovated within the financial frame for social housing, and renovated using standard solutions and products to facilitate future replications of the result. The different renovation scenarios have been analysed with dynamic simulation and daylight analyses, and the Active House specification has been used to evaluate the scenarios. The house will be equipped with a mechanical extract ventilation system for winter use, and demand-controlled natural ventilation for warm periods and peak loads during winter. When building works have been completed, the house will be occupied by a family, and physical measurements as well as social scientific enquiries will be carried out.

Keywords – Renovation; dwellings; indoor climate; ventilation; affordability

1. Introduction

RenovActive House is a single family house of the social housing company Foyer Anderlechtois, located in Brussels, in the garden city Bon Air in Anderlecht. The renovation is based on the concept of “Climate Renovation”: to renovate houses to create an excellent indoor climate with a good energy performance. Several renovation scenarios were considered, their performance was analysed according to the Active House specifications.

RenovActive follows the Model Home 2020 project: During 2009-2011, a demonstration project programme of five model homes were built in Denmark (Home for Life, HFL, 2009), Austria (Sunlighthosue, SLH, 2010), Germany (LichtAktiv Haus, LAH, 2010), France (Maison Air et Lumière, MAL, 2011) and United Kingdom (CarbonLight Homes, CLH, 2011). The Model Home 2020 project demonstrated that 2020 building performance targets can be achieved with today’s solutions [1]. It has

previously been found that these houses provide good daylight conditions without compromising thermal comfort [2]. It is the aim of the present project to extend the good performance in a renovation case that is affordable and can be easily reproduced.

The projects has several specific targets:

- Ambitious energy performance for a renovation case with net energy demand for heating and a primary energy use that complies with the Flemish EPB legislation until 2021 and the Walloon EPB legislation until 2017 for new built
- Excellent indoor climate with a particular focus on high daylight levels, prevention of overheating and good indoor air quality through demand-control
- Affordability, as the renovation incl. all technical equipment must be executed within the financial frame given by the social housing company of Brussels
- Reproducibility, using a scenario approach to determine the best set up according to priorities and technical choices, in order to make the concept reproducible for the Foyer Anderlechtois (3.600 dwellings in Brussels area), on a larger scale in other housing communities as well as for private building owners.

The house from the mid-1920s is compact, semi-detached and in a very bad condition. An architecture competition was organised to generate new ideas and innovative concepts for the climate renovation. The Antwerp-based architecture office ONO architectuur won the competition and is developing the project.



Figure 1. The existing house is a semi-detached house. The house unit to the right will be renovated. Photo of the present state (above) and the architect's proposal (below).

2. Methods

Design targets

The design targets for indoor climate, energy and environmental impact are based on the Active House Specification [3]. As there is a clear financial frame for the house, the approach in the design process was to evaluate different scenarios that combined different technical solutions. Each scenario was evaluated according to the Active House radar diagram. The scenario that was chosen as the scenario that will be realised is the scenario that provided the best overall performance in the three aspects and meets the construction cost and reproducibility requirements.

Ventilation system

The window design has been optimised for daylight and natural ventilation. The staircase window e.g. functions as an extract for natural ventilation that helps prevent overheating. In Belgium, ventilation systems are categorised in four categories, as illustrated in Figure 2.

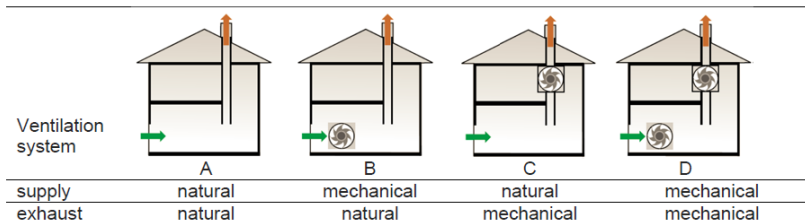


Figure 2. Categorization of domestic ventilation system types in Belgium.

To minimise energy consumption and to maximise thermal comfort during summer, natural ventilation was identified as the best solution when there was no need for heat recovery. Supported by a study by Holzer [4], the outdoor temperature will be used to identify the most favourable mode of ventilation. During cold periods, the ventilation will be a mechanical extract system (type C+). The “+” indicates demand-control based on sensors, a solution based on a product by the company Renson. The house is divided into different zones, each with dedicated sensors of temperature, humidity, CO₂ and VOC installed in the extract ducts.

When the outside temperature exceeds approximately 14°C, the flow through the C+ system will be reduced to 25% to minimise electricity consumption but with the sensors still active. The control system will then use automated windows in each zone to maintain the target CO₂ levels and prevent overheating, profiting from the stack effect. The system will therefore be a “hybrid” ventilation system, combining the benefits of mechanical and natural ventilation. The switching between natural and mechanical ventilation mode will be limited to maximum once per morning and evening.

External, dynamic and automatically operated solar shading is foreseen on façade and roof windows facing south and west.

To ensure a simple and affordable control solution, the windows and solar shading is controlled by room units without a central computer. The room units use CO₂ and possible temperature to control window openings, and in addition external solar radiation is used to control shading. In addition to the sensor-based control, timer based control may be used in rooms with a predictable usage pattern.

Daylight performance

The daylight performance is improved by adding and enlarging the windows in the existing house, see Figure 3.

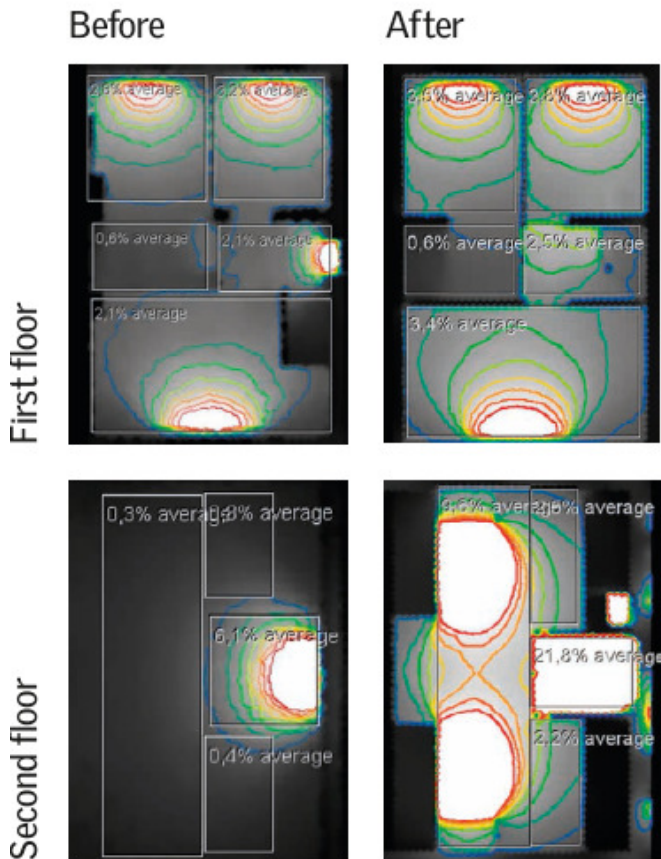


Figure 3. Daylight performance (daylight factor) for the room on first and second floor in the existing (left) and renovated (right) situation.

3. Results

The different potential design scenarios for the house were evaluated according to Active House Specification; 10+ scenarios were evaluated in total. Dynamic thermal simulation and daylight simulations were used in addition to the Belgian EPBD energy performance tool. Figure 4 illustrates the performance of the unrenovated house as well as the calculated performance for the renovated house.

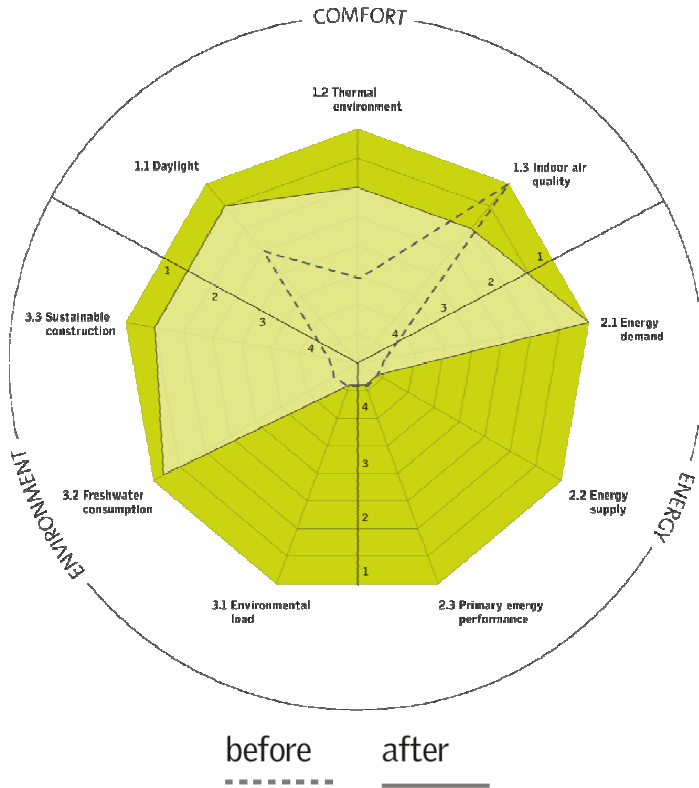


Figure 4. Performance of the unrenovated house according to the Active House Specification.

The house will be connected to a gas grid after renovation and uses a condensing gas boiler. No renewable energy sources are used, to align to the local area and to facilitate reproducibility for other housing units in Foyer Anderlechtois.

The indoor climate is predicted to perform well, achieving a score of 2 in the main categories daylight, thermal comfort and indoor air quality. This is an improvement from the unrenovated situation, and is considered a very satisfying result.

Occupation and post-occupancy evaluation

After completion of the renovation works (foreseen in the beginning of 2016), the house will be open for visits during 1 year. After this, it will be handed to the Foyer Anderlechtois and inhabited by a social housing beneficiary. During the first 2 years of occupation, the performance of the house will be monitored; technically by measuring indoor climate parameters and energy performance, and also by psycho-social techniques like questionnaires.

The technical monitoring will be made with a room-based system, e.g. NetAtmo, which stores data in the cloud.

4. Conclusions

The project is an example of affordable and replicable renovation techniques that not only improves the energy efficiency of the dwelling but perhaps more importantly, focuses on providing the best possible indoor environment.

References

- [1] Feifer, L, Foldbjerg, P, Asmussen, TF and Andersen, PA. 2014. Tomorrows buildings today – results, conclusions and learnings from a cross-european demonstration programme. Proceedings of World Sustainable Buildings 2014, Barcelona.
- [2] Foldbjerg, P, Asmussen, TF and Holzer, P, 2014. Ventilative Cooling of Residential Buildings - Strategies, Measurements results and lessons learned from three Active Houses in Austria, Germany and Denmark, International Journal of Ventilation, September 2014.
- [3] Active House (2011) Active House Specification, Active House Alliance, activehouse.info
- [4] Holzer, P and Foldbjerg, P. 2014. Control of Indoor Climate Systems in Active Houses. Proceedings of World Sustainable Buildings 2014, Barcelona.