Negative Sequence Controllers to Reduce Power Oscillations During Electric Faults in the Offshore Wind Power Grid

Chaudhary, Sanjay Kumar

Publication date:
2010

Document Version
Publisher's PDF, also known as Version of record

Negative Sequence Controllers to Reduce Power Oscillations During Electric Faults in the Offshore Wind Power Grid

Researcher: S. K. Chaudhary, Aalborg Univ. and Univ. of Manitoba, email:skc@et.aau.dk

Advisor: Dr. R. Teodorescu (AAU), Dr. P. Rodriguez (T.U. Catalonia)

Co-Advisors: Dr. A. M. Gole (UoM), Dr. P. C. Kjær (Vestas A/S)

Main Objectives:

To reduce the power oscillations and subsequent dc voltage oscillations in the VSC-HVDC transmission connecting an offshore wind power plant to an onshore grid.

- To develop a PSCAD/EMTDC simulation model of an offshore WPP with VSC-HVDC connection to the Onshore grid.
- To simulate the symmetrical and asymmetrical faults in the offshore grid and study the oscillations in the VSC-HVDC transmission system
- To estimate the content of positive and negative sequence voltage and current components in real time using DSOGI filters.
- To propose a negative sequence current control algorithm and compare the results with the negative sequence voltage control algorithm.

System Layout and Single Line Diagram

A 400MW offshore wind power plant has been modeled as 4 aggregated wind turbines with full scale converters. VSC-HVDC transmission connects the offshore grid to the onshore grid.

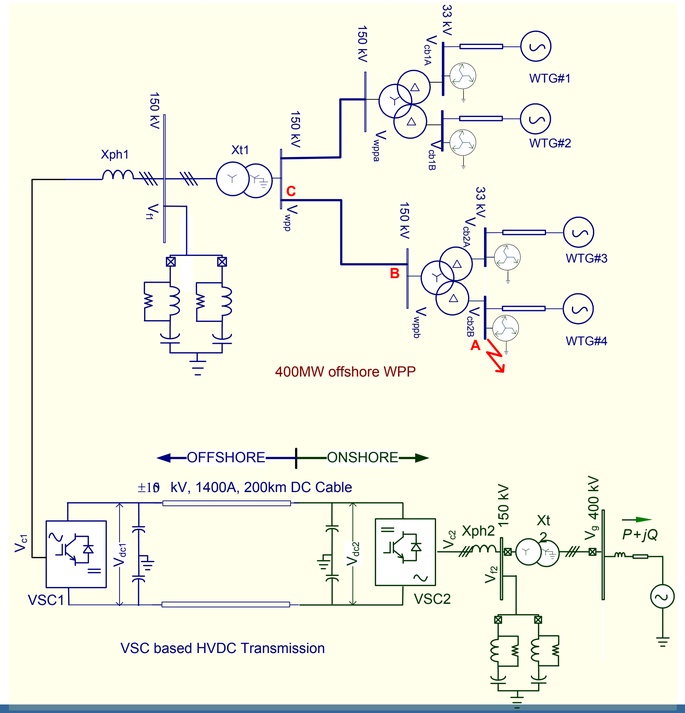

VSC-HVDC Controllers

Onshore VSC Controller: Control of dc voltage and reactive power or ac voltage measured at the point of common coupling.

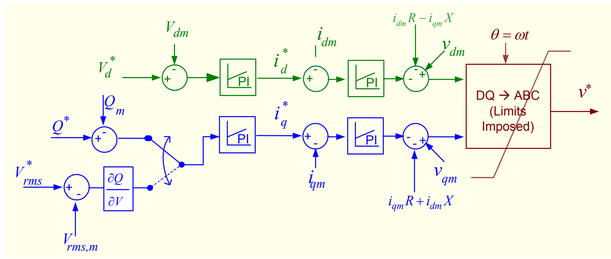

Offshore VSC Controller: Control of offshore grid terminal ac voltage and frequency.

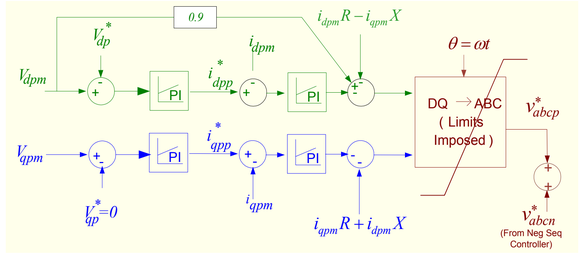

Negative Sequence Controller
(for offshore VSC Controller)

Negative Sequence Voltage Control: Negative sequence voltage references in the d and q axes are set to 0. The outer PI controller generates the negative sequence current references.

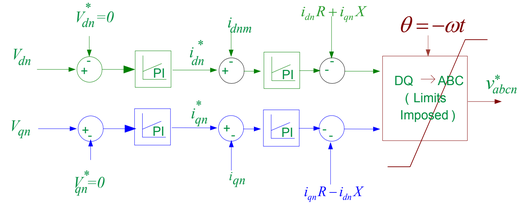

Negative Sequence Current Control: Negative sequence current references in the α and β axes are solved from the equations given below, in the stationary reference frame,

$$v_{\alpha n} i_{\alpha p} + v_{\alpha p} i_{\alpha n} + v_{\beta n} i_{\beta p} + v_{\beta p} i_{\beta n} = 0$$

$$v_{\beta n} i_{\alpha p} + v_{\beta p} i_{\alpha n} - v_{\alpha n} i_{\beta p} - v_{\alpha p} i_{\beta n} = 0$$

The –ve sequence current references are transformed into the d-q axes components before applying to the controller.

Fault Simulations and Comparison of the Controller Performance

Electrical faults of both symmetric (LLLG & LLL) and asymmetric (LG, LLG & LL) types were simulated at points A/B/C (shown in the layout).

Fault resistance of magnitude 0.10 pu and duration 150ms was used.

DC voltage at the onshore VSC-HVDC terminal, power evacuated from the offshore grid and power injected into the onshore grid have been shown below for some selected cases.

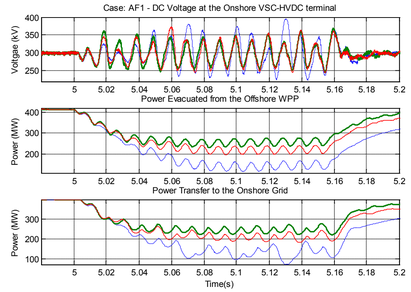

Plots for L-G fault at point A

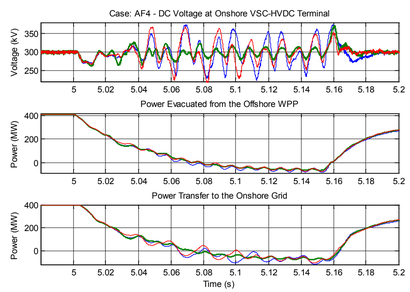

Plots for LL-G fault at point A

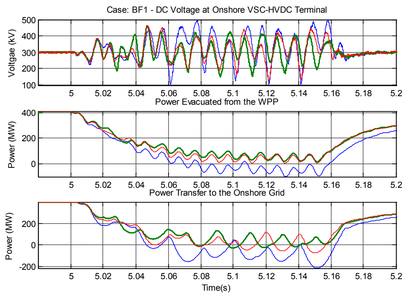

Plots for L-G fault at point B

Legends:

1. Without negative sequence controller
2. With negative sequence voltage controller
3. With negative sequence current controller

Conclusion

- Negative sequence current controller is effective in decreasing the power and voltage oscillations in the VSC-HVDC system.
- Even in the case of symmetric faults, the peak overvoltage arising out of sudden power unbalance is reduced.
- However, the power and voltage oscillations could not be elimiated completely.