

Microgrid For Remote Islanded Communities in Indonesia

Ali, Majid; Vasquez, Juan C.; Guerrero, Josep M.; Bazmohammadi, Najmeh; Guan, Yajuan; De La Cruz, Jorge

Creative Commons License
CC BY 4.0

Publication date:
2024

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Ali, M., Vasquez, J. C., Guerrero, J. M., Bazmohammadi, N., Guan, Y., & De La Cruz, J. (2024). *Microgrid For Remote Islanded Communities in Indonesia*. 1. Poster presented at AAU Energy Research Day 2024 , Aalborg, Denmark.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Majid Ali, Juan C. Vasquez, Josep M. Guerrero, Najmeh Bazmohammadi, Yajuan Guan, Jorge De La Cruz
Center for Research on Microgrids (CROM), AAU Energy, Aalborg University, 9220 Aalborg, Denmark

PROJECT DESCRIPTION AND OBJECTIVES

This study explores, develops, and assesses viable microgrid solutions for isolated islands, using Indonesia as an example. In this case study, we discuss and assess six possible microgrid options, and the two are the most practical, affordable, and environmentally friendly for distant island microgrids by using Homer Pro Software. The first system is photovoltaic cells (PV), a battery energy storage system (BESS), and a diesel generator (DG), and the second is photovoltaic cells and a battery energy storage system.



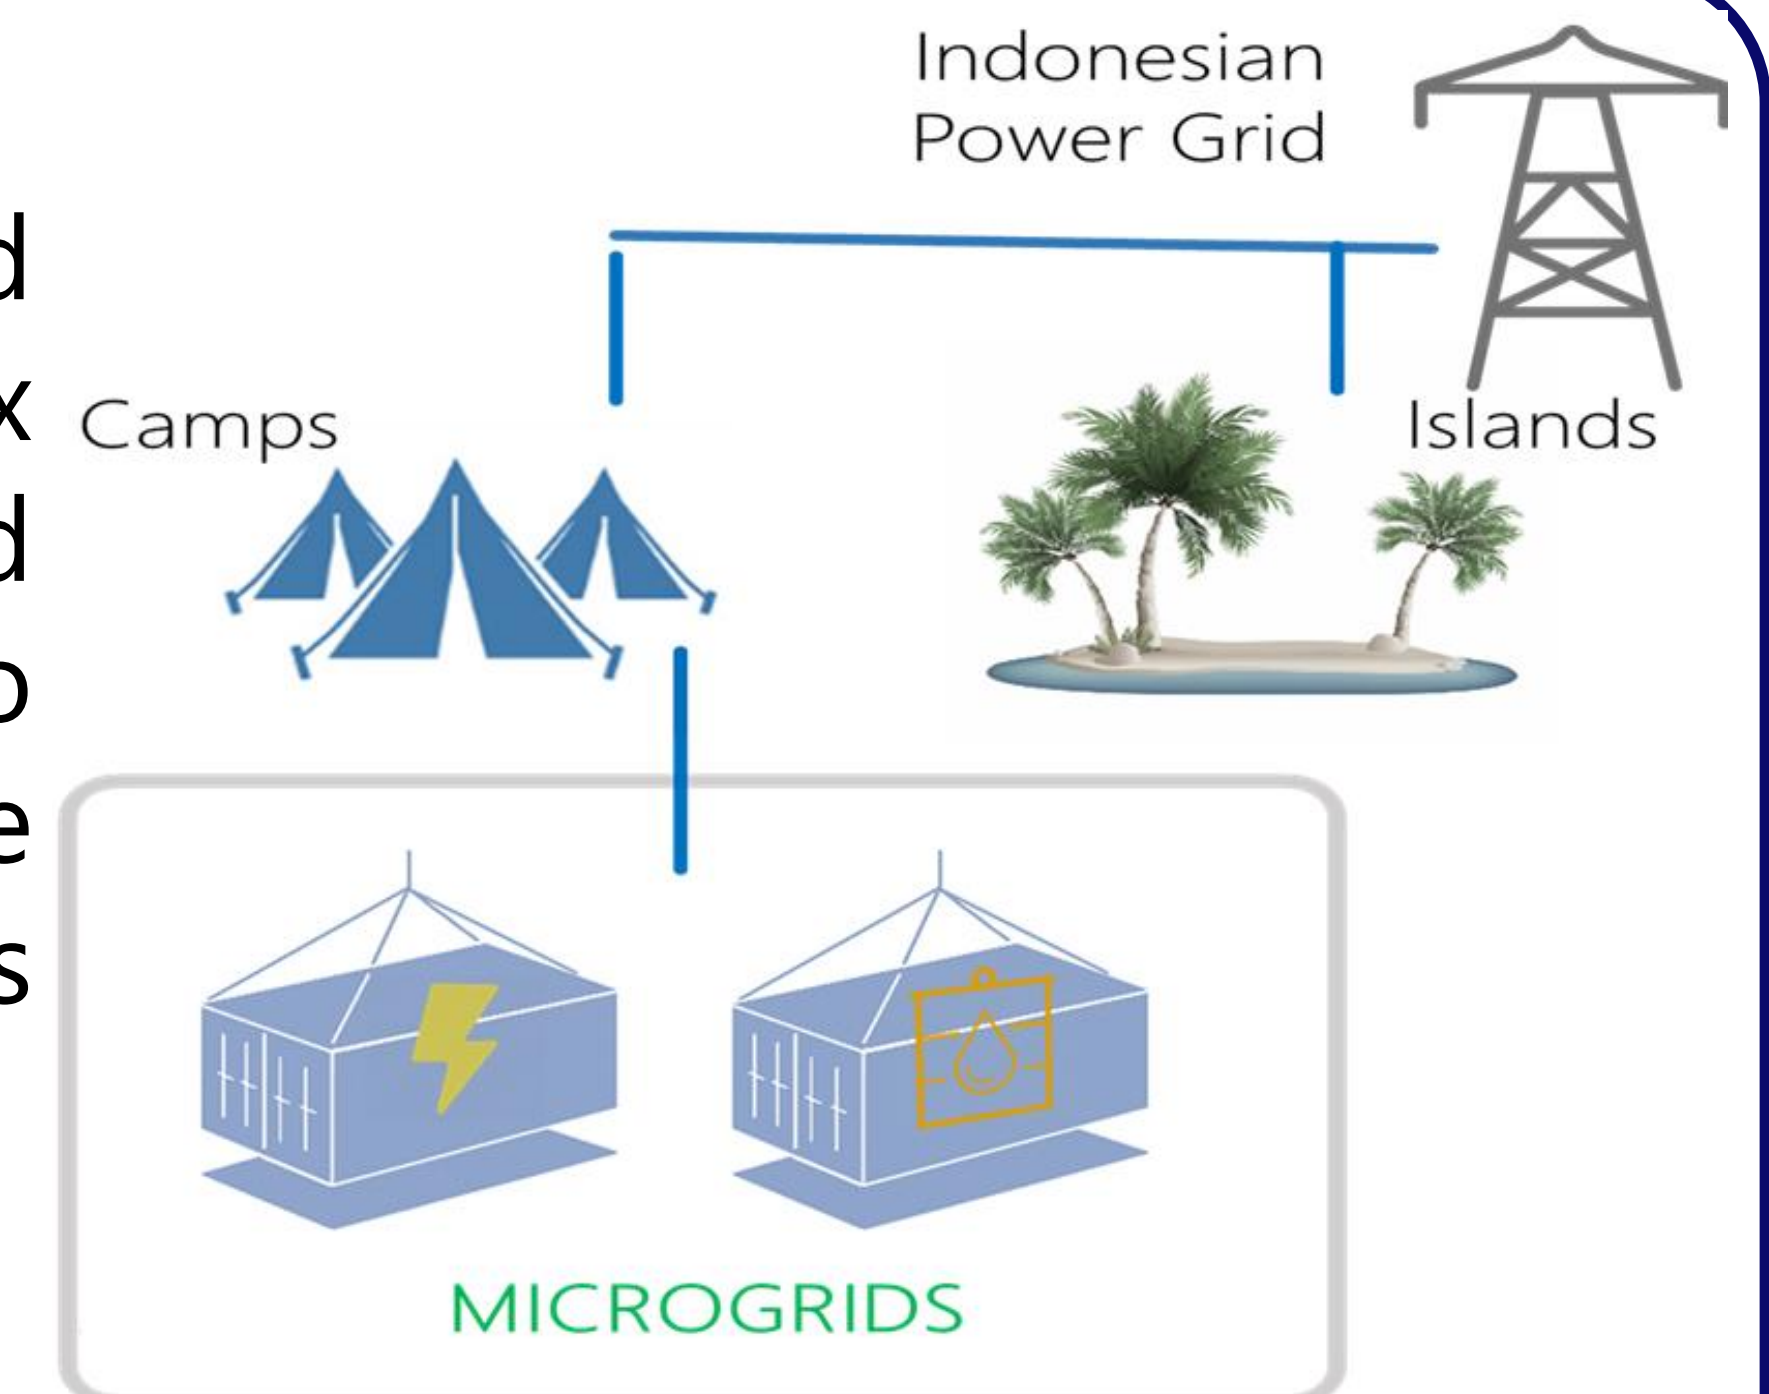


TABLE I: DIFFERENT SOLUTIONS FOR ISLAND MICROGRID

S. #	KEY SOLUTION	DESCRIPTION
1	DG	An independent diesel generator might be the solution.
2	DG+BES	The preceding solution might be improved economically by including a battery.
3	PV+BES	A significant battery capacity in conjunction with a relatively big PV capacity is required to supply electricity during the night.
4	DG+BES+PV	Adding a diesel generator, reduced the number of batteries and solar panels.
5	WT+BES	A huge battery and relatively large capacity of wind turbines are required to meet the demand in hours or even days without wind.
6	DG+BES+WT	A diesel generator generates the required electricity when there is no wind or battery charge.

METHODOLOGY

- The HOMER Grid offered the best technology, system size, and smallest net present cost (NPC) possible.
- The NPC cost is the whole cost of the system, including 1) capital costs, 2) replacement costs, 3) operation and maintenance (O&M) costs, 4) fuel costs, 5) emission costs, and 6) the cost of grid power purchases.
- The project life of 25 years is considered. The 10% increase in electricity cost and operation and maintenance cost per year is considered for simulations.
- An 8% discount rate and 2.8% inflation rate is used by HOMER Grid for simulation

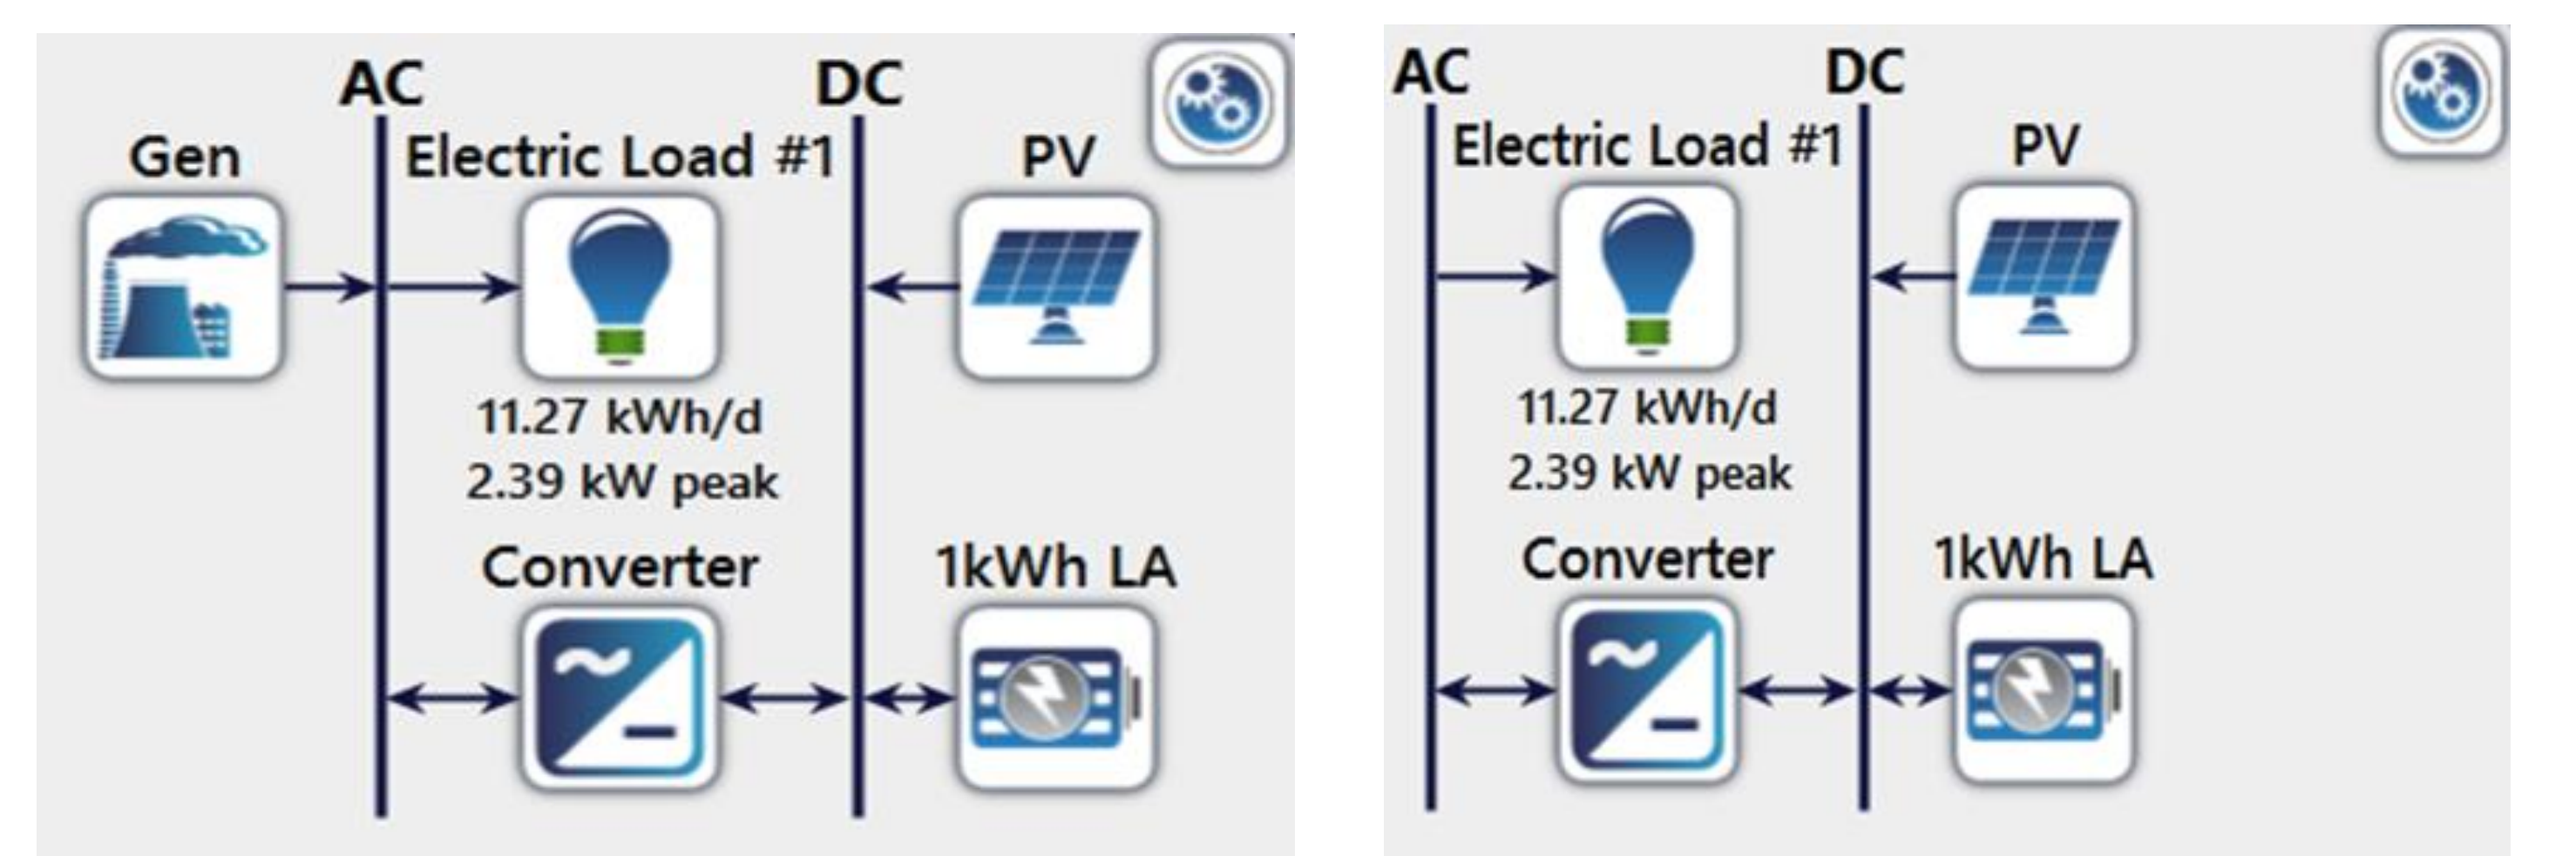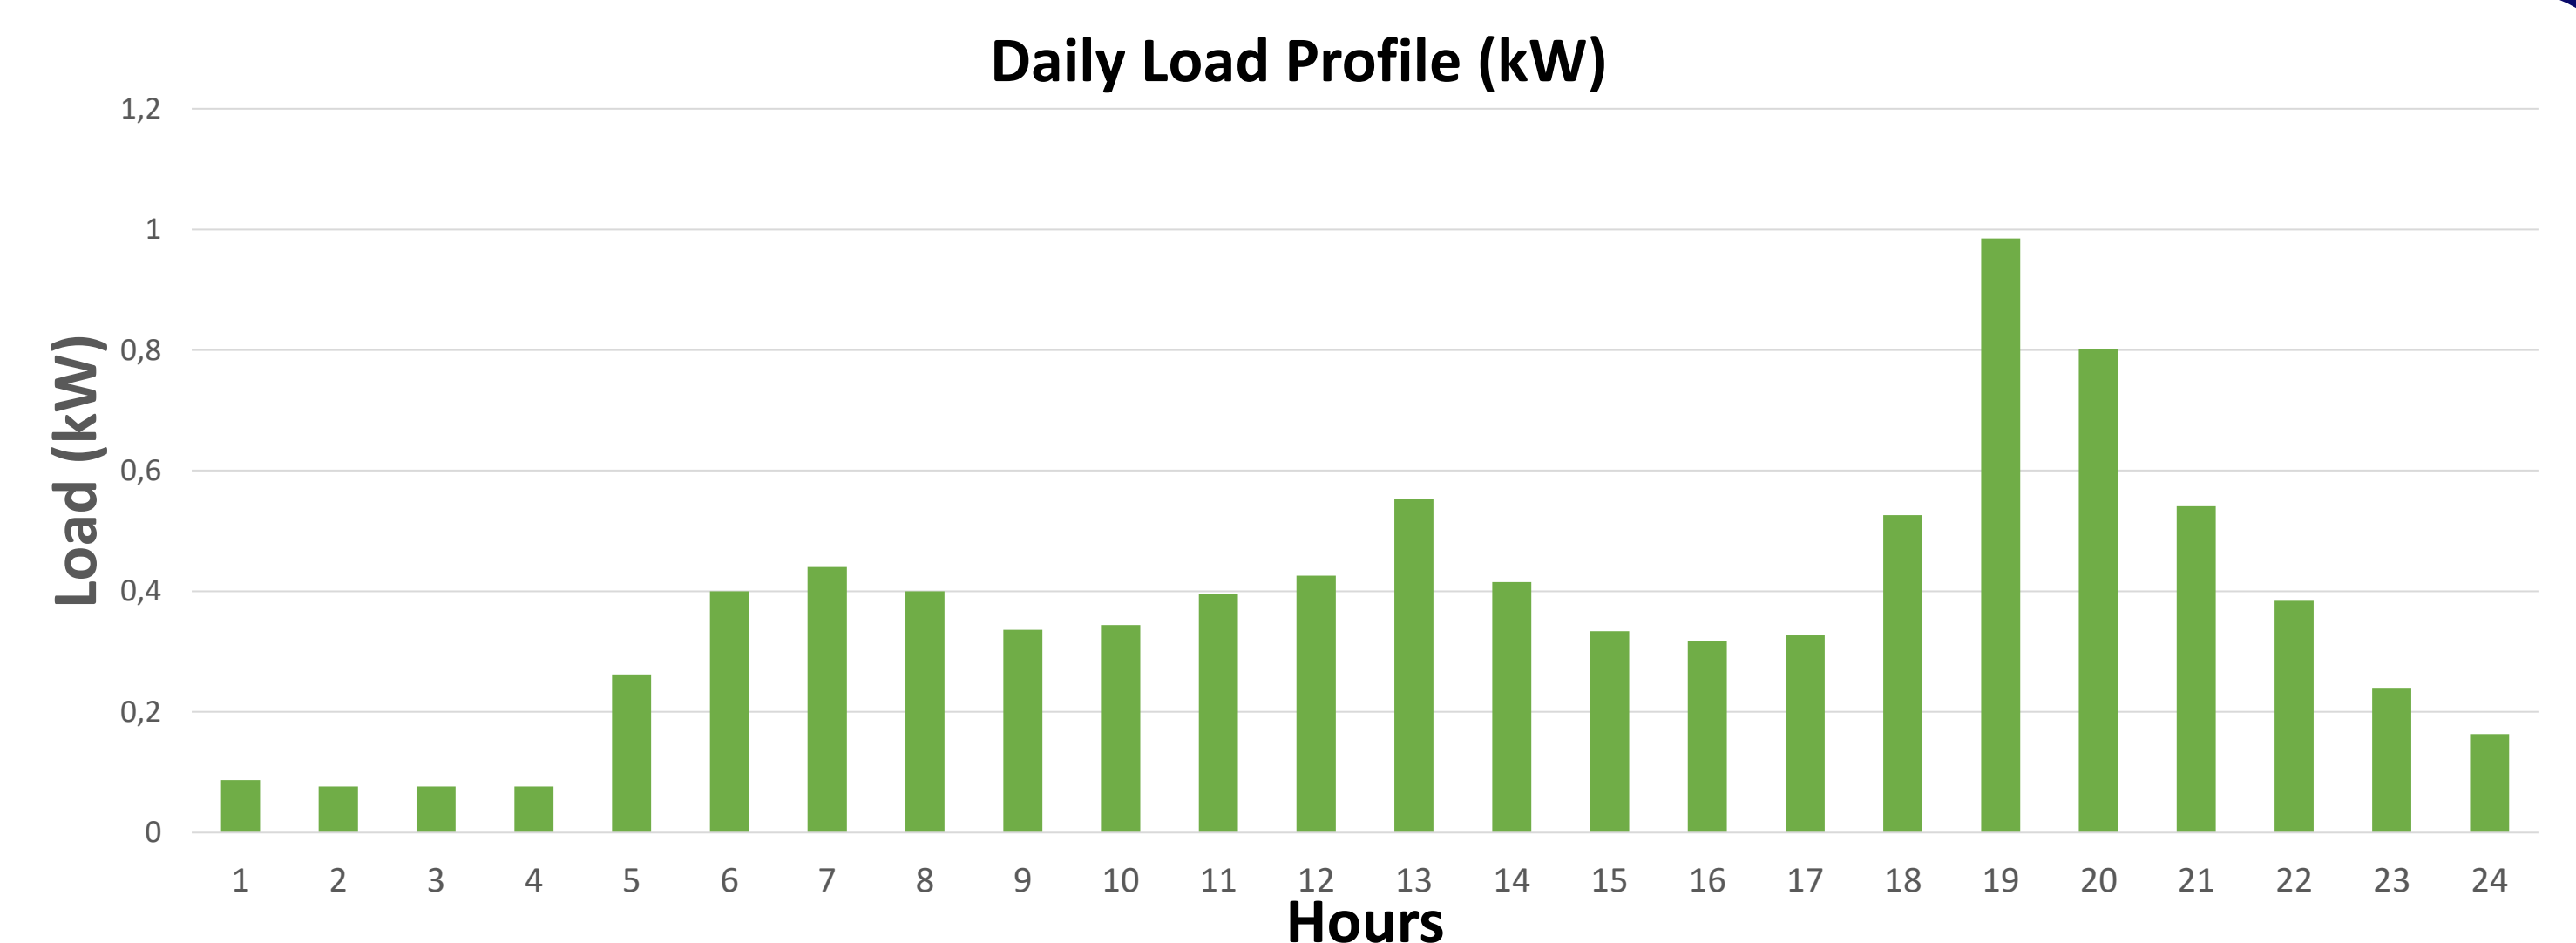

RESULTS

SPECIFICATION	DATA
DG Size (kW)	2.70
PV (kW)	2.69
BES (1kWh)	12 (String)
Converter(kW)	0.985
NPC (\$)	22,981.09
O&M (\$/year)	1,214.43
LCOE (\$/kWh)	0.5029
Initial costs (\$)	11,965

Numerical Results For Winning Solution 1 (S4)

SPECIFICATION	DATA
PV (kW)	5.18
BES (1kWh)	28 (String)
Converter(kW)	2.39
NPC (\$)	35,172.29
O&M (\$/year)	935
LCOE (\$/kWh)	0.6107
Initial costs (\$)	22,068

Numerical Results For Winning Solution 2 (S3)

